

- G. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 6.10 WALKWAY INSTALLATION

- A. Flexible Walkways: Install walkway products in locations indicated. Adhere with compatible adhesive and heat weld walkway products to substrate according to roofing system manufacturer's written instructions. – PVC
- B. Roof-Paver Walkways: Install walkway roof pavers according to manufacturer's written instructions in locations indicated, to form walkways. Leave 3 inches of space between adjacent roof pavers.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 6.11 FIELD QUALITY CONTROL

- A. Final Roof Inspection: Arrange for roofing system manufacturer's technical personnel to inspect roofing installation on completion.
- B. Repair or remove and replace components of roofing system where inspections indicate that they do not comply with specified requirements.
- C. Additional testing and inspecting, at Contractor's expense, will be performed to determine if replaced or additional work complies with specified requirements.

#### 6.12 PROTECTING AND CLEANING

- A. Protect roofing system from damage and wear during remainder of construction period. When remaining construction does not affect or endanger roofing, inspect roofing for deterioration and damage, describing its nature and extent in a written report, with copies to Architect and Owner.
- B. Correct deficiencies in or remove roofing system that does not comply with requirements, repair substrates, and repair or reinstall roofing system to a condition free of damage and deterioration at time of Substantial Completion and according to warranty requirements.
- C. Clean overspray and spillage from adjacent construction using cleaning agents and procedures recommended by manufacturer of affected construction.

END OF SECTION 07 54 19

## SECTION 07 62 00

### SHEET METAL FLASHING AND TRIM

#### PART 7 - GENERAL

##### 7.1 SUMMARY

###### A. Section Includes:

1. Manufactured flashings, counterflashings and reglets.
2. Formed roof-drainage sheet metal fabrications.
3. Formed low-slope roof sheet metal fabrications.

##### 7.2 COORDINATION

- A. Coordinate sheet metal flashing and trim layout and seams with sizes and locations of penetrations to be flashed, and joints and seams in adjacent materials.
- B. Coordinate sheet metal flashing and trim installation with adjoining roofing and wall materials, joints, and seams to provide leakproof, secure, and noncorrosive installation.

##### 7.3 SUBMITTALS

###### A. Product Data: For each type of product.

1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for each manufactured product and accessory.

###### B. Shop Drawings: For sheet metal flashing and trim.

1. Include plans, elevations, sections, and attachment details.
2. Detail fabrication and installation layouts, expansion-joint locations, and keyed details. Distinguish between shop- and field-assembled work.
3. Include identification of material, thickness, weight, and finish for each item and location in Project.
4. Include details for forming, including profiles, shapes, seams, and dimensions.
5. Include details for joining, supporting, and securing, including layout and spacing of fasteners, cleats, clips, and other attachments. Include pattern of seams.
6. Include details of termination points and assemblies.
7. Include details of expansion joints and expansion-joint covers, including showing direction of expansion and contraction from fixed points.
8. Include details of roof-penetration flashing.
9. Include details of edge conditions, including eaves, ridges, valleys, rakes, crickets, and counterflashings as applicable.
10. Include details of special conditions.
11. Include details of connections to adjoining work.

###### C. Samples for Verification: For each type of exposed finish.

1. Sheet Metal Flashing: 12 inches long by actual width of unit, including finished seam and in required profile. Include fasteners, cleats, clips, closures, and other attachments.
2. Trim, Metal Closures, Expansion Joints, Joint Intersections, and Miscellaneous Fabrications: 12 inches long and in required profile. Include fasteners and other exposed accessories.
3. Unit-Type Accessories and Miscellaneous Materials: Full-size Sample.
4. Anodized Aluminum Samples: Samples to show full range to be expected for each color required.

#### 7.4 QUALITY ASSURANCE

- A. Fabricator Qualifications: Employs skilled workers who custom fabricate sheet metal flashing and trim similar to that required for this Project and whose products have a record of successful in-service performance.
- B. Closeout Submittals
  1. Maintenance Data: For sheet metal flashing and trim, and its accessories, to include in maintenance manuals.

#### 7.5 DELIVERY, STORAGE, AND HANDLING

- A. Do not store sheet metal flashing and trim materials in contact with other materials that might cause staining, denting, or other surface damage. Store sheet metal flashing and trim materials away from uncured concrete and masonry.
- B. Protect strippable protective covering on sheet metal flashing and trim from exposure to sunlight and high humidity, except to extent necessary for period of sheet metal flashing and trim installation.

#### 7.6 WARRANTY

- A. Guarantee materials and workmanship for two years.
- B. Provide manufacturer's 20 year guarantee for coating.

### PART 8 - PRODUCTS

#### 8.1 PERFORMANCE REQUIREMENTS

- A. General: Sheet metal flashing and trim assemblies shall withstand wind loads, structural movement, thermally induced movement, and exposure to weather without failure due to defective manufacture, fabrication, installation, or other defects in construction. Completed sheet metal flashing and trim shall not rattle, leak, or loosen, and shall remain watertight.
- B. Sheet Metal Standard for Flashing and Trim: Comply with NRCA's "The NRCA Roofing Manual" and SMACNA's "Architectural Sheet Metal Manual" requirements for dimensions and profiles shown unless more stringent requirements are indicated.

- C. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes to prevent buckling, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base calculations on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.

- 1. Temperature Change: 120 deg F, ambient; 180 deg F, material surfaces.

## 8.2 SHEET METAL

- A. General: Protect mechanical and other finishes on exposed surfaces from damage by applying strippable, temporary protective film before shipping.

- B. Aluminum Sheet: ASTM B 209, alloy as standard with manufacturer for finish required, with temper as required to suit forming operations and performance required; with smooth, flat surface.

- 1. Exposed Coil-Coated Finish:
    - a. Siliconized Polyester: Epoxy primer and silicone-modified, polyester-enamel topcoat; with dry film thickness of not less than 0.2 mil for primer and 0.8 mil for topcoat.
  - 2. Color: As selected by Architect from manufacturer's full range.
  - 3. Concealed Finish: Pretreat with manufacturer's standard white or light-colored acrylic or polyester backer finish, consisting of prime coat and wash coat with minimum total dry film thickness of 0.5 mil.

- C. Metallic-Coated Steel Sheet: Provide zinc-coated (galvanized) steel sheet according to ASTM A 653/A 653M, G90 coating designation or aluminum-zinc alloy-coated steel sheet according to ASTM A 792/A 792M, Class AZ50 coating designation, Grade 40; prepainted by coil-coating process to comply with ASTM A 755/A 755M.

- 1. Surface: Smooth, flat and mill phosphatized for field painting.
  - 2. Exposed Coil-Coated Finish:
    - a. Siliconized Polyester: Epoxy primer and silicone-modified, polyester-enamel topcoat; with dry film thickness of not less than 0.2 mil for primer and 0.8 mil for topcoat.
  - 3. Color: As selected by Architect from manufacturer's full range.
  - 4. Concealed Finish: Pretreat with manufacturer's standard white or light-colored acrylic or polyester backer finish, consisting of prime coat and wash coat with minimum total dry film thickness of 0.5 mil.

## 8.3 MISCELLANEOUS MATERIALS

- A. General: Provide materials and types of fasteners, protective coatings, sealants, and other miscellaneous items as required for complete sheet metal flashing and trim installation and as recommended by manufacturer of primary sheet metal or manufactured item unless otherwise indicated.

- B. Fasteners: Wood screws, annular threaded nails, self-tapping screws, self-locking rivets and bolts, and other suitable fasteners designed to withstand design loads and recommended by manufacturer of primary sheet metal or manufactured item.

- 1. General: Blind fasteners or self-drilling screws, gasketed, with hex-washer head.

- a. Exposed Fasteners: Heads matching color of sheet metal using plastic caps or factory-applied coating. Provide metal-backed EPDM or PVC sealing washers under heads of exposed fasteners bearing on weather side of metal.
  - b. Blind Fasteners: High-strength aluminum or stainless-steel rivets suitable for metal being fastened.
  - c. Spikes and Ferrules: Same material as gutter; with spike with ferrule matching internal gutter width.
2. Fasteners for Aluminum Sheet: Aluminum or Series 300 stainless steel.
- C. Sealant Tape: Pressure-sensitive, 100 percent solids, polyisobutylene compound sealant tape with release-paper backing. Provide permanently elastic, nonsag, nontoxic, nonstaining tape 1/2 inch wide and 1/8 inch thick.
- D. Elastomeric Sealant: ASTM C 920, elastomeric polyurethane polymer sealant; of type, grade, class, and use classifications required to seal joints in sheet metal flashing and trim and remain watertight.
- E. Butyl Sealant: ASTM C 1311, single-component, solvent-release butyl rubber sealant; polyisobutylene plasticized; heavy bodied for hooked-type expansion joints with limited movement.
- F. Epoxy Seam Sealer: Two-part, noncorrosive, aluminum seam-cementing compound, recommended by aluminum manufacturer for exterior nonmoving joints, including riveted joints.

#### 8.4 MANUFACTURED SHEET METAL FLASHING AND TRIM

- A. Reglets: Units of type, material, and profile required, formed to provide secure interlocking of separate reglet and counterflashing pieces, and compatible with flashing indicated with factory-mitered and -welded corners and junctions and with interlocking counterflashing on exterior face, of same metal as reglet.
1. Material: Aluminum, 0.024 inch thick.
  2. Stucco Type: Provide with upturned fastening flange and extension leg of length to match thickness of applied finish materials.
  3. Masonry Type: Provide with offset top flange for embedment in masonry mortar joint.
  4. Accessories:
    - a. Flexible-Flashing Retainer: Provide resilient plastic or rubber accessory to secure flexible flashing in reglet where clearance does not permit use of standard metal counterflashing or where Drawings show reglet without metal counterflashing.
    - b. Counterflashing Wind-Restraint Clips: Provide clips to be installed before counterflashing to prevent wind uplift of counterflashing's lower edge.
  5. Finish: Mill.

#### 8.5 FABRICATION, GENERAL

- A. General: Custom fabricate sheet metal flashing and trim to comply with details shown and recommendations in cited sheet metal standard that apply to design, dimensions, geometry, metal thickness, and other characteristics of item required. Fabricate sheet metal flashing and trim in shop to greatest extent possible.

1. Fabricate sheet metal flashing and trim in thickness or weight needed to comply with performance requirements, but not less than that specified for each application and metal.
  2. Obtain field measurements for accurate fit before shop fabrication.
  3. Form sheet metal flashing and trim to fit substrates without excessive oil canning, buckling, and tool marks; true to line, levels, and slopes; and with exposed edges folded back to form hems.
  4. Conceal fasteners and expansion provisions where possible. Do not use exposed fasteners on faces exposed to view.
- B. Fabrication Tolerances: Fabricate sheet metal flashing and trim that is capable of installation to a tolerance of 1/4 inch in 20 feet on slope and location lines indicated on Drawings and within 1/8-inch offset of adjoining faces and of alignment of matching profiles.
- C. Fabrication Tolerances: Fabricate sheet metal flashing and trim that is capable of installation to tolerances specified in MCA's "Guide Specification for Residential Metal Roofing."
- D. Expansion Provisions: Form metal for thermal expansion of exposed flashing and trim.
1. Form expansion joints of intermeshing hooked flanges, not less than 1 inch (25 mm) deep, filled with butyl sealant concealed within joints.
  2. Use lapped expansion joints only where indicated on Drawings.
- E. Sealant Joints: Where movable, nonexpansion-type joints are required, form metal to provide for proper installation of elastomeric sealant according to cited sheet metal standard.
- F. Fabricate cleats and attachment devices from same material as accessory being anchored or from compatible, noncorrosive metal.
- G. Fabricate cleats and attachment devices of sizes as recommended by cited sheet metal standard and by FM Global Property Loss Prevention Data Sheet 1-49 for application, but not less than thickness of metal being secured.
- H. Seams: Fabricate nonmoving seams with flat-lock seams. Tin edges to be seamed, form seams, and solder.
- I. Seams: Fabricate nonmoving seams with flat-lock seams. Form seams and seal with elastomeric sealant unless otherwise recommended by sealant manufacturer for intended use. Rivet joints where necessary for strength.
- J. Seams for Aluminum: Fabricate nonmoving seams with flat-lock seams. Form seams and seal with epoxy seam sealer. Rivet joints where necessary for strength.
- K. Do not use graphite pencils to mark metal surfaces.

## 8.6 ROOF-DRAINAGE SHEET METAL FABRICATIONS

- A. Hanging Gutters: Fabricate to cross section required, complete with end pieces, outlet tubes, and other accessories as required. Fabricate in minimum 96-inch-long sections. Furnish flat-stock gutter brackets and gutter spacers and straps fabricated from same metal as gutters, of size recommended by cited sheet metal standard but with thickness

not less than twice the gutter thickness. Fabricate expansion joints, expansion-joint covers, gutter bead reinforcing bars, and gutter accessories from same metal as gutters. Shop fabricate interior and exterior corners.

1. Gutter Profile: Style K according to cited sheet metal standard.
  2. Expansion Joints: Lap type.
  3. Accessories: Wire-ball downspout strainer.
  4. Gutters with Girth up to 15 Inches: Fabricate from the following materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch.
  5. Gutters with Girth 16 to 20 Inches: Fabricate from the following materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch.
  6. Gutters with Girth 21 to 25 Inches: Fabricate from the following materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.034 inch thick.
  7. Gutters with Girth 26 to 30 Inches: Fabricate from the following materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.040 inch thick.
  8. Gutters with Girth 31 to 35 Inches: Fabricate from the following materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.052 inch thick.
- B. Downspouts: Fabricate rectangular downspouts to dimensions indicated, complete with mitered elbows. Furnish with metal hangers from same material as downspouts and anchors.
1. Fabricated Hanger Style: Fig 1-35A according to SMACNA's "Architectural Sheet Metal Manual."
  2. Fabricate from the following materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch.
- C. Parapet Scuppers: Fabricate scuppers to dimensions required, with closure flange trim to exterior, 4-inch-wide wall flanges to interior, and base extending 4 inches beyond cant or tapered strip into field of roof. Fabricate from the following materials:
1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.
- D. Conductor Heads: Fabricate conductor heads with flanged back and stiffened top edge and of dimensions and shape required, complete with outlet tubes, exterior flange trim, and built-in overflows. Fabricate from the following materials:
1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.

## 8.7 LOW-SLOPE ROOF SHEET METAL FABRICATIONS

- A. Roof Edge Flashing and Fascia Cap: Fabricate in minimum 96-inch- long, but not exceeding 12-foot-long sections. Furnish with 6-inch- wide, joint cover plates.
1. Joint Style: Overlapped, 4 inches wide.
  2. Fabricate from the Following Materials:
    - a. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.
- B. Copings: Fabricate in minimum 96-inch- long, but not exceeding 12-foot-long, sections. Fabricate joint plates of same thickness as copings. Furnish with continuous cleats to support edge of external leg and interior leg. Miter corners, fasten and seal watertight.
1. Coping Profile: As indicated on drawings.

2. Joint Style: Butted with expansion space and 6-inch-wide, concealed backup plate.
3. Fabricate from the Following Materials:
  - a. Aluminum-Zinc Alloy-Coated Steel: 0.040 inch thick.
- C. Roof and Roof-to-Wall Transitions: Fabricate from the following materials:
  1. Aluminum-Zinc Alloy-Coated Steel: 0.034 inch thick.
- D. Base Flashing: Fabricate from the following materials:
  1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.
- E. Counterflashing: Fabricate from the following materials:
  1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch thick.
- F. Flashing Receivers: Fabricate from the following materials:
  1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch thick.

## 8.8 WALL SHEET METAL FABRICATIONS

- A. Through-Wall Flashing: Fabricate continuous flashings in minimum 96-inch-long, but not exceeding 12-foot-long, sections, under copings, and at shelf angles. Fabricate discontinuous lintel, sill, and similar flashings to extend 6 inches beyond each side of wall openings; and form with 2-inch-high, end dams. Fabricate from the following materials:
  1. Stainless Steel: 0.016 inch thick.
- B. Opening Flashings in Frame Construction: Fabricate head, sill, and similar flashings to extend 4 inches beyond wall openings. Form head and sill flashing with 2-inch-high, end dams. Fabricate from the following materials:
  1. Aluminum-Zinc Alloy-Coated Steel: [0.022 inch (0.56 mm)] <Insert dimension> thick.

## PART 9 - EXECUTION

### 9.1 INSPECTION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances, substrate, and other conditions affecting performance of the Work.
  1. Verify compliance with requirements for installation tolerances of substrates.
  2. Verify that substrate is sound, dry, smooth, clean, sloped for drainage, and securely anchored.
  3. Verify that air- or water-resistant barriers have been installed over sheathing or backing substrate to prevent air infiltration or water penetration.

- B. Proceed with installation only after unsatisfactory conditions have been corrected.

## 9.2 INSTALLATION

- A. General: Anchor sheet metal flashing and trim and other components of the Work securely in place, with provisions for thermal and structural movement. Use fasteners, protective coatings, separators, sealants, and other miscellaneous items as required to complete sheet metal flashing and trim system.
  - 1. Install sheet metal flashing and trim true to line, levels, and slopes. Provide uniform, neat seams with minimum exposure of solder, welds, and sealant.
  - 2. Install sheet metal flashing and trim to fit substrates and to result in watertight performance. Verify shapes and dimensions of surfaces to be covered before fabricating sheet metal.
  - 3. Space cleats not more than 12 inches apart. Attach each cleat with at least two fasteners. Bend tabs over fasteners.
  - 4. Install exposed sheet metal flashing and trim with limited oil canning, and free of buckling and tool marks.
  - 5. Torch cutting of sheet metal flashing and trim is not permitted.
  - 6. Do not use graphite pencils to mark metal surfaces.
- B. Metal Protection: Where dissimilar metals contact each other, or where metal contacts pressure-treated wood or other corrosive substrates, protect against galvanic action or corrosion by painting contact surfaces with bituminous coating or by other permanent separation as recommended by sheet metal manufacturer or cited sheet metal standard.
  - 1. Coat concealed side of uncoated-aluminum and stainless-steel sheet metal flashing and trim with bituminous coating where flashing and trim contact wood, ferrous metal, or cementitious construction.
  - 2. Underlayment: Where installing sheet metal flashing and trim directly on cementitious or wood substrates, install underlayment and cover with slip sheet.
- C. Expansion Provisions: Provide for thermal expansion of exposed flashing and trim. Space movement joints at maximum of 10 feet with no joints within 24 inches of corner or intersection.
  - 1. Form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with sealant concealed within joints.
  - 2. Use lapped expansion joints only where indicated on Drawings.
- D. Fasteners: Use fastener sizes that penetrate wood blocking or sheathing not less than 1-1/4 inches for nails and not less than 3/4 inch for wood screws.
- E. Conceal fasteners and expansion provisions where possible in exposed work and locate to minimize possibility of leakage. Cover and seal fasteners and anchors as required for a tight installation.
- F. Seal joints as required for watertight construction.
  - 1. Use sealant-filled joints unless otherwise indicated. Embed hooked flanges of joint members not less than 1 inch into sealant. Form joints to completely conceal sealant. When ambient temperature at time of installation is between

40 and 70 deg F, set joint members for 50 percent movement each way. Adjust setting proportionately for installation at higher ambient temperatures. Do not install sealant-type joints at temperatures below 40 deg F.

2. Prepare joints and apply sealants to comply with requirements in Section 079200 "Joint Sealants."

### 9.3 ROOF-DRAINAGE SYSTEM INSTALLATION

- A. General: Install sheet metal roof-drainage items to produce complete roof-drainage system according to cited sheet metal standard unless otherwise indicated. Coordinate installation of roof perimeter flashing with installation of roof-drainage system.
- B. Hanging Gutters: Join sections with joints sealed with sealant. Provide for thermal expansion. Attach gutters at eave or fascia to firmly anchor them in position. Provide end closures and seal watertight with sealant. Slope to downspouts.
  1. Fasten gutter spacers to front and back of gutter.
  2. Anchor and loosely lock back edge of gutter to continuous cleat, eave or apron flashing.
  3. Anchor back of gutter that extends onto roof deck with cleats spaced not more than 24 inches apart.
  4. Anchor gutter with gutter straps spaced not more than 36 inches apart to roof deck, unless otherwise indicated, and loosely lock to front gutter bead.
  5. Install gutter with expansion joints at locations indicated, but not exceeding, 50 feet apart. Install expansion-joint caps.
- C. Downspouts: Join sections with 1-1/2-inch telescoping joints.
  1. Provide hangers with fasteners designed to hold downspouts securely to walls. Locate hangers at top and bottom and at approximately 60 inches o.c.
  2. Provide elbows at base of downspout to direct water away from building.
  3. Connect downspouts to underground drainage system.
- D. Parapet Scuppers: Continuously support scupper, set to correct elevation, and seal flanges to interior wall face, over cants or tapered edge strips, and under roofing membrane.
  1. Anchor scupper closure trim flange to exterior wall and seal with elastomeric sealant to scupper.
  2. Loosely lock front edge of scupper with conductor head.
  3. Seal with elastomeric sealant exterior wall scupper flanges into back of conductor head.
- E. Conductor Heads: Anchor securely to wall, with elevation of conductor head rim at minimum of 1 inch below scupper or gutter discharge.
- F. Expansion-Joint Covers: Install expansion-joint covers at locations and of configuration indicated. Lap joints minimum of 4 inches in direction of water flow.

### 9.4 ROOF FLASHING INSTALLATION

- A. General: Install sheet metal flashing and trim to comply with performance requirements, sheet metal manufacturer's written installation instructions, and cited

sheet metal standard. Provide concealed fasteners where possible, and set units true to line, levels, and slopes. Install work with laps, joints, and seams that are permanently watertight and weather resistant.

- B. Roof Edge Flashing: Anchor to resist uplift and outward forces according to recommendations in cited sheet metal standard unless otherwise indicated. Interlock bottom edge of roof edge flashing with continuous cleat anchored to substrate at staggered 3-inch centers.
- C. Roof Edge Flashing: Anchor to resist uplift and outward forces according to recommendations in FM Global Property Loss Prevention Data Sheet 1-49 for FM Approvals' listing for required windstorm classification.
- D. Copings: Anchor to resist uplift and outward forces according to recommendations in cited sheet metal standard unless otherwise indicated.
  - 1. Interlock exterior bottom edge of coping with continuous cleat anchored to substrate at 24-inch centers.
- E. Copings: Anchor to resist uplift and outward forces according to recommendations in FM Global Property Loss Prevention Data Sheet 1-49 for specified FM Approvals' listing for required windstorm classification.
- F. Roof-Penetration Flashing: Coordinate installation of roof-penetration flashing with installation of roofing and other items penetrating roof.

#### 9.5 WALL FLASHING INSTALLATION

- A. General: Install sheet metal wall flashing to intercept and exclude penetrating moisture according to cited sheet metal standard unless otherwise indicated. Coordinate installation of wall flashing with installation of wall-opening components such as windows, doors, and louvers.
- B. Through-Wall Flashing: Installation of through-wall flashing is specified in Section 042000 "Unit Masonry."
- C. Opening Flashings in Frame Construction: Install continuous head, sill, and similar flashings to extend 4 inches beyond wall openings.

#### 9.6 MISCELLANEOUS FLASHING INSTALLATION

- A. Equipment Support Flashing: Coordinate installation of equipment support flashing with installation of roofing and equipment. Weld or seal flashing with elastomeric sealant to equipment support member.
- B. Overhead-Piping Safety Pans: Suspend pans from structure above, independent of other overhead items such as equipment, piping, and conduit, unless otherwise indicated on Drawings. Pipe and install drain line to plumbing waste or drainage system.

9.7 ERECTION TOLERANCES

- A. Installation Tolerances: Shim and align sheet metal flashing and trim within installed tolerance of 1/4 inch in 20 feet on slope and location lines indicated on Drawings and within 1/8-inch offset of adjoining faces and of alignment of matching profiles.
- B. Installation Tolerances: Shim and align sheet metal flashing and trim within installed tolerances specified in MCA's "Guide Specification for Residential Metal Roofing."

9.8 REPAIRING

- A. Repair or replace damaged work.

9.9 CLEANING AND PROTECTION

- A. Clean exposed metal surfaces of substances that interfere with uniform oxidation and weathering.
- B. Clean and neutralize flux materials. Clean off excess solder.
- C. Clean off excess sealants.
- D. Replace sheet metal flashing and trim that have been damaged or that have deteriorated beyond successful repair by finish touchup or similar minor repair procedures.

END OF SECTION 07 62 00

## SECTION 07 92 00

### JOINT SEALANTS

#### PART 10 - GENERAL

##### 10.1 SUMMARY

- A. Section Includes:
  - 1. Urethane joint sealants.
  - 2. Latex joint sealants.

##### 10.2 SUBMITTALS

- A. Product Data: For each joint-sealant product.
- B. Samples for Initial Selection: Manufacturer's color charts consisting of strips of cured sealants showing the full range of colors available for each product exposed to view.
- C. Samples for Verification: For each kind and color of joint sealant required, provide Samples with joint sealants in 1/2-inch- wide joints formed between two 6-inch-long strips of material matching the appearance of exposed surfaces adjacent to joint sealants.
- D. Joint-Sealant Schedule: Include the following information:
  - 1. Joint-sealant application, joint location, and designation.
  - 2. Joint-sealant manufacturer and product name.
  - 3. Joint-sealant color.

##### 10.3 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For qualified testing agency.
- B. Product Test Reports: For each kind of joint sealant, for tests performed by manufacturer and witnessed by a qualified testing agency.
- C. Preconstruction Field-Adhesion-Test Reports: Indicate which sealants and joint preparation methods resulted in optimum adhesion to joint substrates.
- D. Field-Adhesion-Test Reports: For each sealant application tested.
- E. Sample Warranties: For special warranties.

#### 10.4 QUALITY ASSURANCE

- A. Installer Qualifications: An authorized representative who is trained and approved by manufacturer.
- B. Product Testing: Test joint sealants using a qualified testing agency.
  - 1. Testing Agency Qualifications: Qualified according to ASTM C 1021 to conduct the testing indicated.
- C. Informational Submittals
  - 1. Qualification Data: For qualified testing agency.
  - 2. Product Test Reports: For each kind of joint sealant, for tests performed by manufacturer and witnessed by a qualified testing agency.
  - 3. Preconstruction Field-Adhesion-Test Reports: Indicate which sealants and joint preparation methods resulted in optimum adhesion to joint substrates.
  - 4. Field-Adhesion-Test Reports: For each sealant application tested.
  - 5. Sample Warranties: For special warranties.

#### D. PRECONSTRUCTION TESTING

- 1. Locate test joints where indicated on Project or, if not indicated, as directed by Architect.
- 2. Conduct field tests for each kind of sealant and joint substrate.
- 3. Notify Architect seven days in advance of dates and times when test joints will be erected.
- 4. Arrange for tests to take place with joint-sealant manufacturer's technical representative present.
  - a. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1.1 in ASTM C 1193 or Method A, Tail Procedure, in ASTM C 1521.
    - 1) For joints with dissimilar substrates, verify adhesion to each substrate separately; extend cut along one side, verifying adhesion to opposite side. Repeat procedure for opposite side.
- 5. Report whether sealant failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each kind of product and joint substrate. For sealants that fail adhesively, retest until satisfactory adhesion is obtained.
- 6. Evaluation of Preconstruction Field-Adhesion-Test Results: Sealants not evidencing adhesive failure from testing, in absence of other indications of noncompliance with requirements, will be considered satisfactory. Do not use sealants that fail to adhere to joint substrates during testing.

#### 10.5 PROJECT CONDITIONS

- A. Do not proceed with installation of joint sealants under the following conditions:
  - 1. When ambient and substrate temperature conditions are outside limits permitted by joint-sealant manufacturer or are below 40 deg F.

2. When joint substrates are wet.
3. Where joint widths are less than those allowed by joint-sealant manufacturer for applications indicated.
4. Where contaminants capable of interfering with adhesion have not yet been removed from joint substrates.

#### 10.6 WARRANTY

- A. Special Installer's Warranty: Installer agrees to repair or replace joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
  1. Warranty Period: Two years from date of Substantial Completion.

### PART 11 - PRODUCTS

#### 11.1 MATERIALS, GENERAL

- A. Compatibility: Provide joint sealants, backings, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by joint-sealant manufacturer, based on testing and field experience.
- B. Colors of Exposed Joint Sealants: As selected.
- C. Provide VOC-compliant sealants. Products must not produce off-gassing after proper curing is achieved.

#### 11.2 URETHANE JOINT SEALANTS

- A. Urethane, S, NS, 100/50, T, NT: Single-component, nonsag, plus 100 percent and minus 50 percent movement capability, traffic- and nontraffic-use, urethane joint sealant; ASTM C 920, Type S, Grade NS, Class 100/50, Uses T and NT.
  1. Manufacturers: available manufacturers offering products that may be incorporated into the Work:
    - a. Sika Corporation.
    - b. Pecora Corporation.
    - c. Tremco Incorporated.

#### 11.3 LATEX JOINT SEALANTS

- A. Acrylic Latex: Acrylic latex or siliconized acrylic latex, ASTM C 834, Type OP, Grade NF.
  1. Manufacturers: available manufacturers offering products that may be incorporated into the Work:
    - a. Sika Corporation.
    - b. Pecora Corporation.
    - c. Tremco Incorporated.

#### 11.4 JOINT-SEALANT BACKING

- A. Sealant Backing Material, General: Nonstaining; compatible with joint substrates, sealants, primers, and other joint fillers; and approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
  - 1. Manufacturers: available manufacturers offering products that may be incorporated into the Work:
    - a. BASF Construction Chemicals - Building Systems.
    - b. Construction Foam Products; a division of Nomaco, Inc.
- B. Cylindrical Sealant Backings: ASTM C 1330, Type C (closed-cell material with a surface skin), Type O (open-cell material) or any of the preceding types, as approved in writing by joint-sealant manufacturer for joint application indicated, and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
- C. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint. Provide self-adhesive tape where applicable.

#### 11.5 MISCELLANEOUS MATERIALS

- A. Primer: Material recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
- B. Cleaners for Nonporous Surfaces: Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials, free of oily residues or other substances capable of staining or harming joint substrates and adjacent nonporous surfaces in any way, and formulated to promote optimum adhesion of sealants to joint substrates.
- C. Masking Tape: Nonstaining, nonabsorbent material compatible with joint sealants and surfaces adjacent to joints.

#### 11.6 JOINT-SEALANT SCHEDULE

- A. Joint-Sealant Application: Exterior joints in horizontal traffic surfaces.
  - 1. Joint Locations:
    - a. Control and expansion joints.
    - b. Isolation and contraction joints in cast-in-place concrete slabs.
    - c. Tile control and expansion joints.
    - d. Joints between different materials listed above.
    - e. Other joints as indicated on Drawings.
  - 2. Joint Sealant: Urethane.
  - 3. Joint-Sealant Color: As selected.
- B. Joint-Sealant Application: Exterior joints in vertical surfaces and horizontal nontraffic surfaces.

1. Joint Locations:
    - a. Construction joints in cast-in-place concrete.
    - b. Control and expansion joints in unit masonry.
    - c. Joints between different materials listed above.
    - d. Perimeter joints between materials listed above and frames of doors, windows and louvers.
    - e. Control and expansion joints in ceilings and other overhead surfaces.
    - f. Other joints as indicated on Drawings.
  2. Joint Sealant: Urathane.
  3. Joint-Sealant Color: As selected.
- C. Joint-Sealant Application: Interior joints in horizontal traffic surfaces.
1. Joint Locations:
    - a. Isolation joints in cast-in-place concrete slabs.
    - b. Control and expansion joints in tile flooring.
    - c. Other joints as indicated on Drawings.
  2. Joint Sealant: Urethane.
  3. Joint-Sealant Color: As selected.
- D. Joint-Sealant Application: Interior joints in vertical surfaces and horizontal nontraffic surfaces.
1. Joint Locations:
    - a. Control and expansion joints on exposed interior surfaces of exterior walls.
    - b. Tile control and expansion joints.
    - c. Vertical joints on exposed surfaces of unit masonry.
    - d. Other joints as indicated on Drawings.
  2. Joint Sealant: Urethane.
  3. Joint-Sealant Color: As selected.
- E. Joint-Sealant Application: Interior joints in vertical surfaces and horizontal nontraffic surfaces not subject to significant movement.
1. Joint Locations:
    - a. Control joints on exposed interior surfaces of exterior walls.
    - b. Perimeter joints between interior wall surfaces and frames of interior doors and windows.
    - c. Other joints as indicated on Drawings.
  2. Joint Sealant: Acrylic latex.
  3. Joint-Sealant Color: As selected.

## PART 12 - EXECUTION

### 12.1 EXAMINATION

- A. Examine joints indicated to receive joint sealants, with Installer present, for compliance with requirements for joint configuration, installation tolerances, and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

## 12.2 PREPARATION

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions and the following requirements:
1. Remove all foreign material from joint substrates that could interfere with adhesion of joint sealant, including dust, paints (except for permanent, protective coatings tested and approved for sealant adhesion and compatibility by sealant manufacturer), old joint sealants, oil, grease, waterproofing, water repellents, water, surface dirt, and frost.
  2. Clean porous joint substrate surfaces by brushing, grinding, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants. Remove loose particles remaining after cleaning operations above by vacuuming or blowing out joints with oil-free compressed air. Porous joint substrates include but not limited to the following:
    - a. Concrete.
    - b. Masonry.
  3. Remove laitance and form-release agents from concrete.
  4. Clean nonporous joint substrate surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous joint substrates include but not limited to the following:
    - a. Metal.
    - b. Glass.
    - c. Porcelain enamel.
    - d. Glazed surfaces of ceramic tile.
- B. Joint Priming: Prime joint substrates where recommended by joint-sealant manufacturer or as indicated by preconstruction joint-sealant-substrate tests or prior experience. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. Masking Tape: Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

## 12.3 INSTALLATION OF JOINT SEALANTS

- A. General: Comply with joint-sealant manufacturer's written installation instructions for products and applications indicated, unless more stringent requirements apply.
- B. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- C. Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.

1. Do not leave gaps between ends of sealant backings.
  2. Do not stretch, twist, puncture, or tear sealant backings.
  3. Remove absorbent sealant backings that have become wet before sealant application, and replace them with dry materials.
- D. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- E. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
1. Place sealants so they directly contact and fully wet joint substrates.
  2. Completely fill recesses in each joint configuration.
  3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- F. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
1. Remove excess sealant from surfaces adjacent to joints.
  2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
  3. Provide concave joint profile per Figure 8A in ASTM C 1193 unless otherwise indicated.
    - a. Use masking tape to protect surfaces adjacent to recessed tooled joints.

#### 12.4 QUALITY CONTROL

- A. Field-Adhesion Testing: Field test joint-sealant adhesion to joint substrates as follows:
1. Extent of Testing: Test completed and cured sealant joints as follows:
    - a. Perform 5 tests for the first 300 feet of joint length for each kind of sealant and joint substrate.
  2. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C 1193 or Method A, Tail Procedure, in ASTM C 1521.
    - a. For joints with dissimilar substrates, verify adhesion to each substrate separately; extend cut along one side, verifying adhesion to opposite side. Repeat procedure for opposite side.
  3. Inspect tested joints and report on the following:
    - a. Whether sealants filled joint cavities and are free of voids.
    - b. Whether sealant dimensions and configurations comply with specified requirements.
    - c. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each kind of product and joint substrate. Compare these results to determine if adhesion complies with sealant manufacturer's field-adhesion hand-pull test criteria.
  4. Record test results in a field-adhesion-test log. Include dates when sealants were installed, names of persons who installed sealants, test dates, test locations, whether joints were primed, adhesion results and percent elongations, sealant material, sealant configuration, and sealant dimensions.

5. Repair sealants pulled from test area by applying new sealants following same procedures used originally to seal joints. Ensure that original sealant surfaces are clean and that new sealant contacts original sealant.
  - B. Evaluation of Field-Adhesion-Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.
- 12.5 CLEANING
- A. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.
- 12.6 PROTECTION
- A. Protect joint sealants during and after curing period from contact with contaminating substances and from damage resulting from construction operations or other causes so sealants are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out, remove, and repair damaged or deteriorated joint sealants immediately so installations with repaired areas are indistinguishable from original work.

END OF SECTION 07 92 00

**SECTION 09 91 13**  
**EXTERIOR PAINTING**

PART 13 - GENERAL

13.1 SUMMARY

- A. Section includes surface preparation and the application of paint systems on exterior substrates.
  - 1. Steel
  - 2. Galvanized metal

13.2 DEFINITIONS

- A. Gloss Level 1: (Flat) Not more than 5 units at 60 degrees and 10 units at 85 degrees, according to ASTM D 523.
- B. Gloss Level 3: (Eggshell) 10 to 25 units at 60 degrees and 10 to 35 units at 85 degrees, according to ASTM D 523.
- C. Gloss Level 4: (Satin Pearl) 20 to 35 units at 60 degrees and not less than 35 units at 85 degrees, according to ASTM D 523.
- D. Gloss Level 5: (Semi –Gloss) 35 to 70 units at 60 degrees, according to ASTM D 523.
- E. Gloss Level 6: (Gloss) 70 to 85 units at 60 degrees, according to ASTM D 523.
- F. Gloss Level 7: (High Gloss) More than 85 units at 60 degrees, according to ASTM D 523.

13.3 SUBMITTALS

- A. Product Data: For each type of product. Include preparation requirements and application instructions.
- B. Samples for Verification: For each type of paint system and each color and gloss of topcoat.
  - 1. Submit Samples on rigid backing, 8 inches square.
  - 2. Step coats on Samples to show each coat required for system.
  - 3. Label each coat of each Sample.
  - 4. Label each Sample for location and application area.
- C. Product List: For each product indicated, include the following:
  - 1. Cross-reference to paint system and locations of application areas. Use same designations indicated on Drawings and in schedules.

2. Printout of current "MPI Approved Products List" for each product category specified, with the proposed product highlighted.
3. VOC content.

D. MAINTENANCE MATERIAL SUBMITTALS

1. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
2. Paint: 5 percent, but not less than 1 gal. of each material and color applied.

13.4 DELIVERY, STORAGE, AND HANDLING

- A. Store materials not in use in tightly covered containers in well-ventilated areas with ambient temperatures continuously maintained at not less than 45 deg F .
1. Maintain containers in clean condition, free of foreign materials and residue.
  2. Remove rags and waste from storage areas daily.

13.5 PROJECT CONDITIONS

- A. Apply paints only when temperature of surfaces to be painted and ambient air temperatures are between 50 and 95 deg F.
- B. Do not apply paints in snow, rain, fog, or mist; when relative humidity exceeds 85 percent; at temperatures less than 5 deg F above the dew point; or to damp or wet surfaces.

PART 14 - PRODUCTS

14.1 MANUFACTURERS

- A. Manufacturers:
1. Benjamin Moore & Co.
  2. ICI Paints.
  3. Sherwin-Williams Company (The).
- B. Products: Subject to compliance with requirements, provide one of the products listed in other Part 2 articles for the paint category indicated.

14.2 PAINT, GENERAL

- A. Material Compatibility:
1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
  2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.
- B. VOC Content: Provide materials that comply with VOC limits of EPA.

- C. Colors: As selected by Architect from manufacturer's full range.
- 14.3 METAL PRIMERS
- A. Primer, Alkyd, Anti-Corrosive for Metal: MPI # 79
  - B. Primer, Galvanized, Water Based: MPI # 134
  - C. Primer, Galvanized: As recommended in writing by topcoat manufacturer.
- 14.4 WATER-BASED PAINTS
- A. Light Industrial Coating, Exterior, Water Based (Gloss Level 3): MPI # 161
  - B. Light Industrial Coating, Exterior, Water Based, Semi-Gloss (Gloss Level 5): MPI # 161
  - C. Light Industrial Coating, Exterior, Water Based, Gloss (Gloss Level 6): MPI # 164
- 14.5 EXTERIOR PAINTING SCHEDULE
- A. Steel Substrates:
    - 1. Water-Based Light Industrial Coating System:
      - a. Prime Coat: Primer, alkyd, anti-corrosive for metal.
      - b. Prime Coat: Shop primer specified in Division 5 Section where substrate is specified.
      - c. Intermediate Coat: Light industrial coating, exterior, water based, matching topcoat.
      - d. Topcoat: Light industrial coating, exterior, water based, gloss (Gloss Level 6).
  - B. Galvanized-Metal Substrates:
    - 1. Water-Based Light Industrial Coating System:
      - a. Prime Coat: Primer, galvanized metal, as recommended in writing by topcoat manufacturer for exterior use on galvanized-metal substrates with topcoat indicated.
      - b. Intermediate Coat: Light industrial coating, exterior, water based, matching topcoat.
      - c. Topcoat: Light industrial coating, exterior, water based, gloss (Gloss Level 6).

## PART 15 - EXECUTION

### 15.1 EXAMINATION

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work.

- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
  - 1. Concrete: 12 percent.
  - 2. Masonry (Clay and CMU): 12 percent.
- C. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.
- D. Proceed with coating application only after unsatisfactory conditions have been corrected.
  - 1. Application of coating indicates acceptance of surfaces and conditions.

## 15.2 PREPARATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Manual" applicable to substrates and paint systems indicated.
- B. Remove hardware, covers, plates, and similar items already in place that are removable and are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.
  - 1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection.
- C. Clean substrates of substances that could impair bond of paints, including dust, dirt, oil, grease, and incompatible paints and encapsulants.
  - 1. Remove incompatible primers and reprime substrate with compatible primers or apply tie coat as required to produce paint systems indicated.
- D. Concrete Substrates: Remove release agents, curing compounds, efflorescence, and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces to be painted exceeds that permitted in manufacturer's written instructions.
- E. Masonry Substrates: Remove efflorescence and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces or mortar joints exceeds that permitted in manufacturer's written instructions.
- F. Steel Substrates: Remove rust, loose mill scale, and shop primer if any. Clean using methods recommended in writing by paint manufacturer but not less than the following:
  - 1. SSPC-SP 2, "Hand Tool Cleaning."
  - 2. SSPC-SP 3, "Power Tool Cleaning."
  - 3. SSPC-SP 7/NACE No. 4, "Brush-off Blast Cleaning."
  - 4. SSPC-SP 11, "Power Tool Cleaning to Bare Metal."
- G. Shop-Primed Steel Substrates: Clean field welds, bolted connections, and abraded areas of shop paint, and paint exposed areas with the same material as used for shop priming to comply with SSPC-PA 1 for touching up shop-primed surfaces.
- H. Galvanized-Metal Substrates: Remove grease and oil residue from galvanized sheet metal by mechanical methods to produce clean, lightly etched surfaces that promote adhesion of subsequently applied paints.

### 15.3 APPLICATION

- A. Apply paints according to manufacturer's written instructions and recommendations in "MPI Manual."
  - 1. Use applicators and techniques suited for paint and substrate indicated.
  - 2. Paint surfaces behind movable items same as similar exposed surfaces. Before final installation, paint surfaces behind permanently fixed items with prime coat only.
  - 3. Paint both sides and edges of exterior doors and entire exposed surface of exterior door frames.
  - 4. Paint entire exposed surface of window frames and sashes.
  - 5. Do not paint over labels of independent testing agencies or equipment name, identification, performance rating, or nomenclature plates.
  - 6. Primers specified in painting schedules may be omitted on items that are factory primed or factory finished if acceptable to topcoat manufacturers.
- B. Tint undercoats same color as topcoat, but tint each undercoat a lighter shade to facilitate identification of each coat if multiple coats of same material are to be applied. Provide sufficient difference in shade of undercoats to distinguish each separate coat.
- C. If undercoats or other conditions show through topcoat, apply additional coats until cured film has a uniform paint finish, color, and appearance.
- D. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.
- E. Painting Fire Suppression, Plumbing, HVAC, Electrical, Communication, and Electronic Safety and Security Work:
  - 1. Paint the following work where exposed to view:
    - a. Equipment, including panelboards and switch gear.
    - b. Uninsulated metal piping.
    - c. Pipe hangers and supports.
    - d. Metal conduit.
    - e. Tanks that do not have factory-applied final finishes.

### 15.4 FIELD QUALITY CONTROL

- A. Dry Film Thickness Testing: Owner may engage the services of a qualified testing and inspecting agency to inspect and test paint for dry film thickness.
  - 1. Contractor shall touch up and restore painted surfaces damaged by testing.
  - 2. If test results show that dry film thickness of applied paint does not comply with paint manufacturer's written recommendations, Contractor shall pay for testing and apply additional coats as needed to provide dry film thickness that complies with paint manufacturer's written recommendations.

### 15.5 CLEANING AND PROTECTION

- A. At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.

- B. After completing paint application, clean spattered surfaces. Remove spattered paints by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.
- C. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
- D. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

END OF SECTION 09 91 13

## SECTION 22 14 23

### STORM DRAINAGE PIPING SPECIALTIES

#### PART 16 - GENERAL

##### 16.1 SUMMARY

- A. Section Includes:
  - 1. Roof drains.

##### 16.2 SUBMITTALS

- A. Product Data: For each type of product indicated.

##### 16.3 QUALITY ASSURANCE

- A. Drainage piping specialties shall bear label, stamp, or other markings of specified testing agency.

#### PART 17 - PRODUCTS

##### 17.1 METAL ROOF DRAINS

- A. Cast-Iron, Small-Sump, General-Purpose Roof Drains:
  - 1. Standard: ASME A112.6.4, for general-purpose roof drains.
  - 2. Body Material: Cast iron.
  - 3. Dimension of Body: Nominal 8-inch diameter.
  - 4. Combination Flashing Ring and Gravel Stop: Not required.
  - 5. Outlet: Bottom.
  - 6. Extension Collars: Not required.
  - 7. Underdeck Clamp: Not required.
  - 8. Expansion Joint: Required.
  - 9. Sump Receiver Plate: Not required.
  - 10. Dome Material: Cast iron.
  - 11. Wire Mesh: Stainless steel or brass over dome.
  - 12. Vandal-Proof Dome: Not required.

#### PART 18 - EXECUTION

##### 18.1 INSTALLATION

- A. Install roof drains at low points of roof areas according to roof membrane manufacturer's written installation instructions.

1. Install flashing collar or flange of roof drain to prevent leakage between drain and adjoining roofing. Maintain integrity of waterproof membranes where penetrated.
2. Install expansion joints, if indicated, in roof drain outlets.
3. Position roof drains for easy access and maintenance.

18.2 PROTECTION

- A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.
- B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

END OF SECTION 22 14 23

**SECTION 26 41 13**  
**LIGHTNING PROTECTION FOR STRUCTURES**

PART 1 - GENERAL

1.1. SUMMARY:

- A. Section includes maintaining the lightning protection system for the structures.

1.2. STANDARDS:

- A. The following specifications and standards part of this specification:
1. Underwriters Laboratories, Inc., (*UL*)  
Installation Requirements for Lightning Protection Systems, UL 96A
  2. Underwriters Laboratories, Inc., (*UL*)  
Lightning Protection Components, UL 96
  3. National Fire Protection Association, (*NFPA*)  
Standard for the Installation of Lightning Protection Systems, NFPA 780
  4. Lightning Protection Institute, (*LPI*)  
LPI Standard of Practice, LPI-175

1.3. SUBMITTALS:

- A. To repair an existing grounding, roof conductors, down conductors, through-roof connectors and air terminals that may be damaged during construction the contractor shall submit the work to be done to the architect and engineer for approval prior to the commencement of work.
1. Provide unit prices for material and labor for air terminals, bases and cable supports. Provide linear foot price for material and labor of cables. As work is uncovered less or more material may be required and an adjustment to the contract fee will be made on the basis of unit prices.

1.5. QUALITY ASSURANCE:

1. The lightning protection system shall conform to the requirements and standards for lightning protection systems in accordance with UL, NFPA and LPI. Upon completion of the installation, application shall be made to the Underwriters Laboratories, Inc. for issuance of the UL Master Label C. Upon receipt of the UL Master Label C from Underwriter Laboratories, said Label will be presented to the owner or the owner's representative.
  - A. Installer Qualifications:
  - B. Certified by LPI as a Master Installer/Designer, trained and approved for installation of units required for this Project.
  - C. System Certificate:

- D. UL Master Label.
  - E. LPI System Certificate.
2. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 780, "Definitions" Article.

## PART 2 – PRODUCTS

- 2.1 STANDARDS: The system furnished under this specification shall be the standard product of a manufacturer regularly engaged in the production of lightning protection equipment and shall be the manufacturer's latest approved design. All equipment shall be UL listed and properly UL labeled. All equipment shall be new, and of a design and construction to suit the application where it is to be used in accordance with accepted industry standards and in accordance with UL, NFPA and LPI requirements.
- 2.2 MATERIALS: All lightning protection materials and components shall comply in weight, size and composition with UL 96, NFPA-780 and LPI-175 lightning protection material requirements for this type of structure. All materials shall be copper/bronze. Aluminum components shall be used in locations where system components are mounted to aluminum surfaces to avoid galvanic corrosion of dissimilar metals. All bolts, nails and screws are to be stainless steel. Class I materials shall be used on structures not more than 75 feet in height; Class II materials shall be used on structures 75 feet and higher.

### Class II Minimum material requirements are as follows:

Copper Conductor: IPC #40, No. 1/0 Size, 375 pounds per 1000', 28 strand of .066" diameter wire, 122,000 circular mils.

Copper Air Terminals: IPC #331, 1/2" diameter by 12" long solid copper.

Aluminum Conductor: IPC #A30, No. 4/0 Size, 200 pounds per 1000', 37 strand of .0756" diameter wire, 211,600 circular mils.

Aluminum Air Terminals: IPC #A332, 5/8" diameter by 12" long solid aluminum.

Ground Rods: IPC #577, 5/8" x 10' long copper weld.

Fittings and Fasteners: In accordance with the standards all fittings and fasteners must be bolt type. No crimp type fittings are to be used. (ie IPC #303, 304, 297A, 121A, A121A, 265P, A265P, 123, A123, etc.)

## PART 3 - EXECUTION

- 3.1 INSTALLATION:
- A. An experienced installation company that is listed with Underwriters Laboratories for lightning protection installation and a member in good standing of the Lightning Protection Institute shall accomplish the repairs.
- 3.2 PROTECTION
- A. Do not combine materials that can form an electrolytic couple that will accelerate

corrosion in the presence of moisture unless moisture is permanently excluded from junction of such materials.

- B. Use conductors with protective coatings where conditions cause deterioration or corrosion of conductors.

### 3.3 COORDINATION:

- A. The lightning protection contractor will work with other trade contractors to ensure a correct, neat and inconspicuous installation. It shall be the responsibility of the lightning protection contractor to assure a proper bond to the appropriate grounded utilities; such as the electric service ground, telephone ground, incoming water and gas pipe, etc.

*Note:* The roofing contractor will be responsible for sealing and flashing all lightning protection roof penetrations as per the roof manufacturer's recommendations.

*Note:* The existing lightning protection system shall remain operational and protect the building structure during all phases of the building reroof project. The lightning protection vendor shall coordinate with the roofing contractor for phasing of the reroof project.

### 3.4 INSPECTION AND CERTIFICATION:

- A. Upon completion of the installation, the contractor shall furnish the Master Label C issued by Underwriters Laboratories, Inc. for this system. If the protected structure is an addition to or is attached to an existing structure that does not have a lightning protection system, the contractor shall advise the Owner of installation requirements on the existing structure to obtain the Master Label C.

### 3.5 QUALITY CONTROL:

- A. Notify Architect at least 48 hours in advance of inspection before concealing lightning protection components.
- B. LPI System Inspection: Meet requirements to obtain an LPI System Certificate.

END OF SECTION 26 41 13

**SECTION 5**  
**INSURANCE AND RISK MANAGEMENT PROVISIONS**

## Insurance and Risk Management Provisions

### Justice Center Tower Roof Replacement Project

It is Fulton County Government's practice to obtain Certificates of Insurance from our Contractors and Vendors. Insurance must be written by a licensed agent in a company licensed to write insurance in the State of Georgia, with an A.M. Best rating of at least A- VI, subject to final approval by Fulton County. Respondents shall submit with the bid/proposal evidence of insurability satisfactory to Fulton County Government as to form and content. Either of the following forms of evidence is acceptable:

- A letter from an insurance carrier stating that upon your firm/company being the successful Bidder/Respondent that a Certificate of Insurance shall be issued in compliance with the Insurance and Risk Management Provisions outlined below.
- A Certificate of Insurance complying with the Insurance and Risk Management Provisions outlined below (Request for Bid/Proposal number and Project Name, Number and Description must appear on the Certificate of Insurance).
- A combination of a specific policy written with an umbrella policy covering liabilities in excess of the required limits is acceptable to achieve the applicable insurance coverage levels.

Upon award, the Contractor/Vendor must maintain at their expense, insurance with policy limits equal to or greater than the limits described below. Proof of insurance must be provided to Fulton County Government prior to the start of any activities/construction as described in the bid document(s). Any and all Insurance Coverage(s) and Bonds required under the terms and conditions of the contract shall be maintained during the entire length of the contract, including any extensions or renewals thereto, and until all work has been completed to the satisfaction of Fulton County Government.

**Accordingly the Respondent shall provide a certificate evidencing the following:**

1. **WORKERS COMPENSATION/EMPLOYER'S LIABILITY INSURANCE – STATUTORY (In compliance with the Georgia Workers Compensation Acts, including but not limited to U.S. Longshoremen and Harbor Workers Act and any other State or Federal Acts or Provisions in which jurisdiction may be granted)**

2.	Employer's Liability Insurance	BY ACCIDENT	EACH ACCIDENT	\$1,000,000
	Employer's Liability Insurance	BY DISEASE	POLICY LIMIT	\$1,000,000
	Employer's Liability Insurance	BY DISEASE	EACH EMPLOYEE	\$1,000,000

2. **COMMERCIAL GENERAL LIABILITY INSURANCE (Including contractual Liability Insurance)**

Bodily Injury and Property Damage Liability (Other than Products/Completed Operations) General Aggregate	Each Occurrence	\$1,000,000
\$2,000,000		
Products\Completed Operation	Aggregate Limit	\$2,000,000

Personal and Advertising Injury	Limits	\$1,000,000
Damage to Rented Premises	Limits	
\$100,000		

\*General Liability Policy to include the following:

- Per Project/Location Aggregate and Completed Operations for 3 Years after final payment.
- Policy to provide evidence of X, C, U coverage.
- Policy to have no exclusion for demolition work.

**3. BUSINESS AUTOMOBILE LIABILITY INSURANCE**

<b>Bodily Injury &amp; Property Damage</b>	Each	Occurrence
\$1,000,000		

(Including operation of non-owned, owned, and hired automobiles).

\*Broadened Pollution Endorsement CA9948 and MCS 90\*\*

<b>4. UMBRELLA LIABILITY</b>	Per	Occurrence/Aggregate
\$1,000,000/\$1,000,000		

<b>5. CONTRACTORS POLLUTION LIABILITY</b>	Each	Occurrence
\$1,000,000		

Or by endorsement to General Liability Policy for sudden and accidental\*\*

If Pollution provided by General Liability Endorsement and sudden and accidental, Contractor Pollution Liability policy would not be a requirement.

**Certificates of Insurance**

The aforementioned insurance policies shall contain or be endorsed to contain a Provision that coverage afforded under such policies shall not expire, be cancelled or altered without at least thirty (30) days written notice to Fulton County Government. Certificates of Insurance are to list Fulton County Government as an Additional Insured (except for Workers' Compensation), using ISO Additional Insured Endorsement form CG 20 10 (11/85) version, its' equivalent or on a blanket basis.

This contractor/vendor insurance shall apply as Primary Insurance before any other insurance or self-insurance, including any deductible, non-contributory, and Waiver of Subrogation provided in favor of Fulton County Government. .

If Fulton County Government shall so request, the Respondent, Contractor or Vendor will furnish the County for its inspection and approval such policies of insurance with all endorsements, or confirmed specimens thereof certified by the insurance company to be true and correct copies.

Additional Insured under the General Liability, Auto Liability, Umbrella Policies (with exception of Workers Compensation and Professional Liability), with no Cross Suits exclusion.

**Important:**

It is understood that neither failure to comply nor full compliance with the foregoing insurance requirements shall limit or relieve the Contractor/Vendor from any liability incurred as a result of their activities/operations in conjunction with the Contract and/or Scope of Work. .

**USE OF PREMISES**

Contractor/Vendor shall confine its apparatus, the storage of materials and the operations of its workers to limits/requirements indicated by law, ordinance, permits and any restrictions of Fulton County Government and shall not unreasonably encumber the premises with its materials.

**PROTECTION OF PROPERTY**

Contractor/Vendor will adequately protect its own work from damage, will protect Fulton County Government's property from damage or loss and will take all necessary precautions during the progress of the work to protect all persons and the property of others from damage or loss.

Contractor/Vendor shall take all necessary precautions for the safety of employees of the work and shall comply with all applicable provisions of the Federal, State and local safety laws and building codes to prevent accidents or injury to persons on, about, or adjacent to the premises where work is being performed.

Contractor/Vendor shall erect and properly maintain at all times as required by the conditions and progress of the work, all necessary safeguards for the protection of its employees, Fulton County Government employees and the public and shall post all applicable signage and other warning devices to protect against potential hazards for the work being performed.

CONTRACTOR/VENDOR ACKNOWLEDGES HAVING READ, UNDERSTANDING, AND AGREEING TO COMPLY WITH THE AFOREMENTIONED INSURANCE AND RISK MANAGEMENT PROVISIONS, AND THE REPRESENTATIVE OF THE CONTRACTOR/VENDOR IDENTIFIED BELOW IS AUTHORIZED TO SIGN CONTRACTS ON BEHALF OF THE RESPONDING CONTRACTOR/VENDOR.

COMPANY: \_\_\_\_\_ SIGNATURE: \_\_\_\_\_

NAME: \_\_\_\_\_ TITLE: \_\_\_\_\_

DATE: \_\_\_\_\_

## PURCHASING FORMS & INSTRUCTIONS

This section contains the procurement forms that are required to be executed and submitted with the bid package. This section does not contain all forms required to be included with the bid package submittal.

To be deemed responsive to this ITB, Bidders must provide the information requested and complete in detail all Purchasing Forms. The appropriate individual(s) authorized to commit the Bidder to the Project must sign the Purchasing Forms. Bidders should reproduce each Purchasing Form, as required, and complete the appropriate portions of the forms provided in this section.

- Form A: Non-Collusion Affidavit of Prime Bidder/Offeror
- Form B: Certificate of Acceptance of Request for Bid/Proposal Requirements
- Form C: Professional License Certifications (***not applicable***)
  - Form C1 – Georgia Utility License Contractor License
  - Form C2 – Georgia General Contractors License
  - Form C3 – Georgia Professional License
- Form D: Certification Regarding Debarment
- Form E: Disclosure Form and Questionnaire
- Form F: Georgia Security and Immigration Contractor Affidavit and Agreement
- Form G: Georgia Security and Immigration Subcontractor Affidavit

**FORM A: NON-COLLUSION AFFIDAVIT OF BIDDER/OFFEROR**

**STATE OF GEORGIA**

**COUNTY OF FULTON**

I, \_\_\_\_\_, certify that pursuant to Fulton County Code Section 102-397, this bid or proposal is made without prior understanding, agreement or connection with any corporation, firm or person submitting a bid for the same work, labor or service to be done or the supplies, materials or equipment to be furnished and is in all respects fair and without collusion or fraud. I understand collusive bidding is a violation of state and federal law and can result in fines, prison sentences and civil damages awards. I agree to abide by all conditions of this bid or proposal and certify that I am authorized to sign this bid or proposal for the bidder.

Affiant further states that pursuant to O.C.G.A. Section 36-91-21 (d) and (e), \_\_\_\_\_ has not, by itself or with others, directly or indirectly, prevented or attempted to prevent competition in such bidding or proposals by any means whatsoever. Affiant further states that (s)he has not prevented or endeavored to prevent anyone from making a bid or offer on the project by any means whatever, nor has Affiant caused or induced another to withdraw a bid or offer for the work.

Affiant further states that the said offer of \_\_\_\_\_ is bona fide, and that no one has gone to any supplier and attempted to get such person or company to furnish the materials to the bidder only, or if furnished to any other bidder, that the material shall be at a higher price.

\_\_\_\_\_  
(COMPANY NAME)

\_\_\_\_\_  
(PRESIDENT/VICE PRESIDENT)

Sworn to and subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

\_\_\_\_\_  
(SECRETARY/ASSISTANT SECRETARY)

(Affix corporate seal here, if a corporation)

Notary Public: \_\_\_\_\_

County: \_\_\_\_\_

Commission Expires: \_\_\_\_\_

**NOTE:**

IF THE OFFEROR IS A PARTNERSHIP, ALL OF THE PARTNERS AND ANY OFFICER, AGENT, OR OTHER PERSON WHO MAY HAVE REPRESENTED OR ACTED FOR THEM IN BIDDING FOR OR PROCURING THE CONTRACT SHALL ALSO MAKE THIS OATH.

IF THE OFFEROR IS A CORPORATION, ALL OFFICERS, AGENTS, OR OTHER PERSONS WHO MAY HAVE ACTED FOR OR REPRESENTED THE CORPORATION IN BIDDING FOR OR PROCURING THE CONTRACT SHALL MAKE THE OATH.

**FORM B: FULTON COUNTY CERTIFICATE OF ACCEPTANCE OF BID/PROPOSAL  
REQUIREMENTS**

This is to certify that on this day, offeror acknowledges that he/she has read this solicitation document, pages #\_\_\_\_\_ to #\_\_\_\_\_ inclusive, including any addenda # \_\_\_\_\_ to #\_\_\_\_\_ exhibit(s) #\_\_\_\_\_ to #\_\_\_\_\_, attachment(s) # to #\_\_\_\_\_, and/or appendices #\_\_\_\_\_ to #,\_\_\_\_\_ in its entirety, and agrees that no pages or parts of the document have been omitted, that he/she understands, accepts and agrees to fully comply with the requirements therein, and that the undersigned is authorized by the offeror to submit the proposal herein and to legally obligate the offeror thereto.

This is also to certify that the offeror has reviewed the form Fulton County contract included in the solicitation documents and agrees to be bound by its terms, or that the offeror certifies that it is submitting any proposed modification to the contract terms with its proposal. The offeror further certifies that the failure to submit proposed modifications with the proposal waives the offeror's right to submit proposed modifications later. The offeror also acknowledges that the indemnification and insurance provisions of Fulton County's contract included in the solicitation documents are non-negotiable and that proposed modifications to said terms may be reason to declare the offeror's proposal as non-responsive.

Company: \_\_\_\_\_

Signature: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

(Corporate Seal)

**FORM C1: CONTRACTOR'S GEORGIA UTILITY LICENSE CERTIFICATION**

Contractor's Name: \_\_\_\_\_

Utility Contractor's Name: \_\_\_\_\_

Expiration Date of License: \_\_\_\_\_

I certify that the above information is true and correct and that the classification noted is applicable to the Bid for this Project.

Signed: \_\_\_\_\_

Date: \_\_\_\_\_

**(ATTACH COPY OF LICENSE)**

**FORM C2: CONTRACTOR'S GEORGIA GENERAL CONTRACTOR'S LICENSE  
CERTIFICATION**

Contractor's Name: \_\_\_\_\_

General Contractor's License Number: \_\_\_\_\_

Expiration Date of License: \_\_\_\_\_

I certify that the above information is true and correct and that the classification noted is applicable to the Bid for this Project.

Signed: \_\_\_\_\_

Date: \_\_\_\_\_

**(ATTACH COPY OF LICENSE)**

**FORM C3: GEORGIA PROFESSIONAL LICENSE CERTIFICATION**

**NOTE: Please complete this form for the work your firm will perform on this project.**

Contractor's Name: \_\_\_\_\_

Performing work as: Prime Contractor \_\_\_\_\_ Sub-Contractor \_\_\_\_\_

Professional License Type: \_\_\_\_\_

Professional License Number: \_\_\_\_\_

Expiration Date of License: \_\_\_\_\_

I certify that the above information is true and correct and that the classification noted is applicable to the Bid for this Project.

Signed:

\_\_\_\_\_

Date:

\_\_\_\_\_

**(ATTACH COPY OF LICENSE)**

### FORM D: CERTIFICATION REGARDING DEBARMENT

- (1) The Offeror certifies that neither it or its subcontractors is presently debarred, suspended, proposed for debarment, declared ineligible, or otherwise excluded from doing business with any government agency. Any such exclusion may cause prohibition of your firm from participating in any procurement by the Fulton County Government.
- (2) If the Offeror is unable to certify to any of the statements in this certification, such Offeror or subcontractor shall attach an explanation to this bid or proposal.

#### INSTRUCTIONS FOR CERTIFICATION

By signing and submitting this certification, the Offeror is providing the certification set out below:

- (1) The certification in this clause is a material representation of fact upon which reliance will be placed. If it is later determined that the prospective vendor knowingly rendered a false certification, the Purchasing Agent may pursue all available remedies, including suspension and/or debarment, for withdrawal of award or termination of a contract.
- (2) The prospective Offeror shall provide immediate written notice to the Purchasing Agent if at anytime the Offeror learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- (3) Offeror shall be under a continuing duty to immediately inform the Purchasing Agent in writing of any changes, if as a result of such changes, the Offeror certification regarding debarment is affected.

#### DEBARMENT ORDINANCE

The following Section 102-449 of Fulton County Code of Laws establishes the procedure for the debarment of contractors.

##### **(a) Authority to suspend.**

After reasonable notice to the entity involved and reasonable opportunity for that entity to be heard, the Purchasing Agent, after consultation with user department, the County Manager and the County Attorney shall have the authority to suspend an entity for cause from consideration for award of county contracts. As used in this section, the term entity means any business entity, individual, firm, contractor, subcontractor or business corporation, partnership, limited liability corporation, firm, contractor, subcontractor or business structured; provided, further, that any such entity shall also be subject to suspension under this section if any of its constituents, members, subcontractors at any tier of such entity's and the entity, or any constituent or member, knew or should have known of the commission of the act. The suspension shall be for a period not to exceed three (3) years unless cause is based on a felony conviction for an offense related or associated with fraudulent contracting or misappropriation of funds wherein the suspension shall not exceed seven (7) years.

##### **(b) Causes for Suspension. The causes for suspension include:**

- (1) Conviction for commission of a criminal offense as an incident to obtain or attempting to obtain a public or private contract or subcontract, or in performance of such contract or subcontract;

- (2) Conviction of state or federal statutes of embezzlement, theft, forgery, bribery, falsification or destruction of records, receiving stolen property or other offense indicating a lack of business integrity or business honesty which currently, seriously and directly affects responsibility as a county contractor.
- (3) Conviction of state or federal anti-trust statutes arising out of the solicitation and submission of bids and proposals;
- (4) Violation of contract provisions, as set forth below, of a character which is regarded by the Purchasing Agent to be so serious as to justify suspension action:
  - a. Failure to perform in accordance with the specifications within a time limit provided in a county contract;
  - b. A recent record of failure to perform or unsatisfactory performance in accordance with the terms of one or more contracts; provided, that failure to perform or unsatisfactory performance caused by acts beyond the control of the contractor shall not be considered to be a basis for suspension;
  - c. Material representation of the composition of the ownership or workforce or business entity certified to the county as a minority business enterprise; or
  - d. Falsification of any documents.
- (5) For violation of the ethical standards set forth in Fulton County Code Chapter 9, Code of Ethics.
- (6) Knowing misrepresentation to the county, of the use which a majority owned contractor intends to make a minority business enterprise (a business entity at least 51 percent of which is owned and controlled by minority persons, as defined in Fulton County Code Section 102-431) as a subcontractor or a joint venture partner, in performing work under contract with the County.

Failure to fully and truthfully provide the information required, may result in the disqualification of your bid/proposal from consideration or termination of the Contract, once awarded. This document must be completed and included as a part of the bid/proposal package along with other required documents.

[SIGNATURES ON NEXT PAGE]

Under penalty of perjury, I declare that I have examined this certification and all attachments hereto, if applicable, to the best of my knowledge and belief, and all statements contained hereto are true, correct, and complete.

On this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_

\_\_\_\_\_  
(Legal Name of Offeror) (Date)

\_\_\_\_\_  
(Signature of Authorized Representative) (Date)

\_\_\_\_\_  
(Title)

### FORM E: DISCLOSURE FORM AND QUESTIONNAIRE

1. Please provide the names and business addresses of each of the Offeror's firm's officers and directors.

For the purposes of this form, the term "Offeror" means an entity that responds to a solicitation for a County contract by either submitting a proposal in response to a Request for Proposal or a Request for Qualification or a Bid in response to an Invitation to Bid. Describe accurately, fully and completely, their respective relationships with said Offeror, including their ownership interests and their anticipated role in the management and operations of said Offeror.

2. Please describe the general development of said Offeror's business during the past five (5) years, or such shorter period of time that said Offeror has been in business.

3. Please state whether any employee, agent or representative of said Offeror who is or will be directly involved in the subject project has or has ever: (i) directly or indirectly had a business relationship with Fulton County; (ii) directly or indirectly received revenues from Fulton County; or (iii) directly or indirectly receives revenues from the result of conducting business on Fulton County property or pursuant to any contract with Fulton County. Please describe in detail any such relationship.

**LITIGATION DISCLOSURE:**

Failure to fully and truthfully disclose the information required, may result in the disqualification of your bid or proposal from consideration or termination of the Contract, once awarded.

1. Please state whether any of the following events have occurred in the last five (5) years with respect to said Offeror. If any answer is yes, explain fully the following:

(a) whether a petition under the federal bankruptcy laws or state insolvency laws was filed by or against said Offeror, or a receiver fiscal agent or similar officer was appointed by a court for the business or property of said Offeror;

Circle One:            YES                            NO

(b) whether Offeror was subject of any order, judgment, or decree not subsequently reversed, suspended or vacated by any court of competent jurisdiction, permanently enjoining said Offeror from engaging in any type of business practice, or otherwise eliminating any type of business practice; and

Circle One:            YES                            NO

(c) whether said Offeror's business was the subject of any civil or criminal proceeding in which there was a final adjudication adverse to said Offeror, which directly arose from activities conducted by the business unit or corporate division of said Offeror which submitted a bid or proposal for the subject project. If so please explain.

Circle One:            YES                            NO

2. Have you or any member of your firm or team to be assigned to this engagement ever been indicted or convicted of a criminal offense within the last five (5) years?

Circle One:            YES                            NO

3. Have you or any member of your firm or team been terminated (for cause or otherwise) from any work being performed for Fulton County or any other Federal, State or Local Government?

Circle One:            YES                            NO

4. Have you or any member of your firm or team been involved in any claim or litigation adverse to Fulton County or any other federal, state or local government, or private entity during the last three (3) years?

Circle One:            YES                            NO

5. Has any offeror, member of offeror's team, or officer of any of them (with respect to any matter involving the business practices or activities of his or her employer), been notified within the five (5) years preceding the date of this offer that any of them are the target of a criminal investigation, grand jury investigation, or civil enforcement proceeding?

Circle One:                      YES                      NO

If you have answered "YES" to any of the above questions, please indicate the name(s) of the person(s), the nature, and the status and/or outcome of the information, indictment, conviction, termination, claim or litigation, the name of the court and the file or reference number of the case, as applicable. Any such information should be provided on a separate page, attached to this form and submitted with your proposal.

**NOTE: If any response to any question set forth in this questionnaire has been disclosed in any other document, a response may be made by attaching a copy of such disclosure. (For example, said Offeror's most recent filings with the Securities and Exchange Commission ("SEC") may be provided if they are responsive to certain items within the questionnaire.) However, for purposes of clarity, Offeror should correlate its responses with the exhibits by identifying the exhibit and its relevant text.**

Disclosures must specifically address, completely respond and comply with all information requested and fully answer all questions requested by Fulton County. Such disclosure must be submitted at the time of the bid or proposal submission and included as a part of the bid/proposal submitted for this project. Disclosure is required for Offerors, joint venture partners and first-tier subcontractors.

Failure to provide required disclosure, submit officially signed and notarized documents or respond to any and all information requested/required by Fulton County can result in the bid/proposal declared as non-responsive. This document must be completed and included as a part of the bid/proposal package along with other required documents.

[SIGNATURES ON NEXT PAGE]

Under penalty of perjury, I declare that I have examined this questionnaire and all attachments hereto, if applicable, to the best of my knowledge and belief, and all statements contained hereto are true, correct, and complete.

On this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_\_

\_\_\_\_\_  
(Legal Name of Proponent) (Date)

\_\_\_\_\_  
(Signature of Authorized Representative) (Date)

\_\_\_\_\_  
(Title)

**Sworn to and subscribed before me,**

This \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_\_

\_\_\_\_\_  
(Notary Public) (Seal)

Commission Expires \_\_\_\_\_  
(Date)

**FORM F: GEORGIA SECURITY AND IMMIGRATION CONTRACTOR AFFIDAVIT  
AND AGREEMENT**

**Instructions:**

Contractors must attest to compliance with the requirements of O.C.G.A 13-10-91 and the Georgia Department of Labor Rule 300-10-01-.02 by executing the Contractor Affidavit provided.

**STATE OF GEORGIA**

**COUNTY OF FULTON**

**FORM F: GEORGIA SECURITY AND IMMIGRATION CONTRACTOR AFFIDAVIT  
AND AGREEMENT**

By executing this affidavit, the undersigned contractor verifies its compliance with O.C.G.A. 13-10-91, stating affirmatively that the individual, firm or corporation which is engaged in the physical performance of services<sup>1</sup> under a contract with **[insert name of prime contractor]** \_\_\_\_\_ on behalf of **Fulton County Government** has registered with and is participating in a federal work authorization program\*,<sup>2</sup> in accordance with the applicability provisions and deadlines established in O.C.G.A. 13-10-91.

The undersigned further agrees that, should it employ or contract with any subcontractor(s) in connection with the physical performance of services to this contract with **Fulton County Government**, contractor will secure from such subcontractor(s) similar verification of compliance with O.C.G.A. 13-10-91 on the Subcontractor Affidavit provided in Rule 300-10-01-.08 or a substantially similar form. Contractor further agrees to maintain records of such compliance and provide a copy of each such verification to the **Fulton County Government** at the time the subcontractor(s) is retained to perform such service.

\_\_\_\_\_  
EEV/Basic Pilot Program\* User Identification Number

\_\_\_\_\_  
BY: Authorized Officer of Agent  
(Insert Contractor Name)

\_\_\_\_\_  
Title of Authorized Officer or Agent of Contractor

\_\_\_\_\_  
Printed Name of Authorized Officer or Agent

Sworn to and subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

Notary Public: \_\_\_\_\_

County: \_\_\_\_\_

Commission Expires: \_\_\_\_\_

<sup>1</sup>O.C.G.A. § 13-10-90(4), as amended by Senate Bill 160, provides that "physical performance of services" means any performance of labor or services for a public employer (e.g., Fulton County) using a bidding process (e.g., ITB, RFQ, RFP, etc.) or contract wherein the labor or services exceed \$2,499.99, except for those individuals licensed pursuant to title 26 or Title 43 or by the State Bar of Georgia and is in good standing when such contract is for service to be rendered by such individual.

<sup>2</sup>\*[Any of the electronic verification of work authorization programs operated by the United States Department of Homeland Security or any equivalent federal work authorization program operated by the United States Department of Homeland Security to verify information of newly hired employees, pursuant to the Immigration Reform and Control Act of 1986 (IRCA), P.L. 99-603].

**FORM G: GEORGIA SECURITY AND IMMIGRATION SUBCONTRACTOR  
AFFIDAVIT**

**Instructions:**

In the event that your company is awarded the contract for this project, and will be utilizing the services of any subcontractor(s) in connection with the physical performance of services pursuant to this contract, the following affidavit must be completed by such subcontractor(s). Your company must provide a copy of each such affidavit to Fulton County Government, Department of Purchasing & Contract Compliance with the proposal submittal.

All subcontractor affidavit(s) shall become a part of the contract and all subcontractor(s) affidavits shall be maintained by your company and available for inspection by Fulton County Government at any time during the term of the contract. All subcontractor(s) affidavit(s) shall become a part of any contractor/subcontractor agreement(s) entered into by your company.

STATE OF GEORGIA

COUNTY OF FULTON

FORM G: GEORGIA SECURITY AND IMMIGRATION SUBCONTRACTOR  
AFFIDAVIT

By executing this affidavit, the undersigned subcontractor verifies its compliance with O.C.G.A. 13-10-91, stating affirmatively that the individual, firm or corporation which is engaged in the physical performance of services<sup>3</sup> under a contract with **[insert name of prime contractor]** \_\_\_\_\_ behalf of **Fulton County Government** has registered with and is participating in a federal work authorization program\*,<sup>4</sup> in accordance with the applicability provisions and deadlines established in O.C.G.A. 13-10-91.

\_\_\_\_\_  
EEV/Basic Pilot Program\* User Identification Number

\_\_\_\_\_  
BY: Authorized Officer of Agent  
(Insert Subcontractor Name)

\_\_\_\_\_  
Title of Authorized Officer or Agent of Subcontractor

\_\_\_\_\_  
Printed Name of Authorized Officer or Agent

Sworn to and subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

Notary Public: \_\_\_\_\_

County: \_\_\_\_\_

Commission Expires: \_\_\_\_\_

<sup>3</sup>O.C.G.A. § 13-10-90(4), as amended by Senate Bill 160, provides that "physical performance of services" means any performance of labor or services for a public employer (e.g., Fulton County) using a bidding process (e.g., ITB, RFQ, RFP, etc.) or contract wherein the labor or services exceed \$2,499.99, except for those individuals licensed pursuant to title 26 or Title 43 or by the State Bar of Georgia and is in good standing when such contract is for service to be rendered by such individual.

<sup>4</sup>\*[Any of the electronic verification of work authorization programs operated by the United States Department of Homeland Security or any equivalent federal work authorization program operated by the United States Department of Homeland Security to verify information of newly hired employees, pursuant to the Immigration Reform and Control Act of 1986 (IRCA), P.L. 99-603].

## SECTION 7

### CONTRACT COMPLIANCE REQUIREMENTS

#### NON-DISCRIMINATION IN PURCHASING AND CONTRACTING

It is the policy of Fulton County Government that discrimination against businesses by reason of the race, color, gender or national origin of the ownership of any such business is prohibited. Furthermore, it is the policy of the Board of Commissioners ("Board") that Fulton County and all vendors and contractors doing business with Fulton County shall provide to all businesses the opportunity to participate in contracting and procurement paid, in whole or in part, with monetary appropriations of the Board without regard to the race, color, gender or national origin of the ownership of any such business. Similarly, it is the policy of the Board that the contracting and procurement practices of Fulton County should not implicate Fulton County as either an active or passive participant in the discriminatory practices engaged in by private contractors or vendors seeking to obtain contracts with Fulton County.

#### Implementation of Equal Employment Opportunity (EEO) Policy

The County effectuates Equal Employment Opportunity thru Policy #800-8, Non-Discrimination in Contracting and Procurement. This policy considers racial and gender workforce availability. The availability of each workgroup is derived from the work force demographics set forth in the 2000 Census EEO file prepared by the United States Department of Commerce for the applicable labor pool normally utilized for the contract.

#### Monitoring of EEO Policy

Upon award of a contract with Fulton County, the successful bidder/proposer must complete an Equal Employment Opportunity Report (EEO Report), describing the racial and gender make-up of the firm's work force. If the EEO Report indicates that the firm's demographic composition indicates underutilization of employee's of a particular ethnic group for each job category, the firm will be required to submit an aggressive action plan setting forth steps the firm will take to address the identified underutilization.

#### DETERMINATION OF GOOD FAITH EFFORTS

During the course of the project, the Prime Contractor shall demonstrate that they have made all efforts reasonably possible to ensure that Minority and Female Business Enterprises (MFBE) have had a full and fair opportunity to compete and win subcontracts on this project. The Prime Contractor is required to include all outreach attempts that would demonstrate a "Good Faith Effort" in the solicitation of sub-consultants/subcontractors.

Written documentation demonstrating the Prime Contractor's outreach efforts to identify, contact, contract with or utilize Minority or Female owned businesses shall include holding pre-bid conferences, publishing advertisements in general circulation media, trade association publications, minority-focused media, and the County's bid board, as well as other efforts.

Include a list of publications where the advertisement was placed as well as a copy of the advertisement. Advertisement shall include at a minimum, scope of work, project location, location(s) of where plans and specifications may be viewed or obtained and trade or scopes of

work for which subcontracts are being solicited.

### **EQUAL BUSINESS OPPORTUNITY PLAN (EBO PLAN)**

In addition to the proposal submission requirements, each vendor **must** submit an Equal Business Opportunity Plan (EBO Plan) with their bid/proposal. The EBO Plan is designed to enhance the utilization of a particular racial, gender or ethnic group by a bidder/proposer, contractor, or vendor or by Fulton County. The respondent **must** outline a plan of action to encourage and achieve diversity and equality in the available procurement and contracting opportunities with *this solicitation*.

The EBO Plan **must** identify and include:

1. Potential opportunities within the scope of work of *this solicitation* that will allow for participation of racial, gender or ethnic groups.
2. Efforts that will be made by the bidder/proposer to encourage and solicit minority and female business utilization in *this solicitation*.

Fulton County encourages joint ventures, teaming, partnering and mentor-protégé relationships with minority and female businesses in an effort to achieve contracting and procurement diversity.

**Prompt Payment:** The prime contractor **must** certify in writing and **must** document all subcontractors, sub-consultants and suppliers have been promptly paid for work and materials, (less any retainage by the prime contractor prior to receipt of any further progress payments). In the event the prime contractor is unable to pay subcontractors, sub-consultants or suppliers until it has received a progress payment from Fulton County, the prime contractor shall pay all subcontractors, sub-consultants or suppliers funds due from said progress payment within forty-eight (48) hours of receipt of payment from Fulton County. In no event shall a subcontractor, sub-consultant or supplier be paid later than fifteen (15) days as provided for by state law.

### **REQUIRED FORMS AND EBO PLAN**

In order to be compliant with the intent and provisions of the Fulton County Non-Discrimination in Purchasing and Contracting Ordinance (99-0960), bidders/proposers **must** submit the following completed documents. Failure to provide this information **shall** result in the proposal being deemed non-responsive.

- Exhibit A – Promise of Non-Discrimination
- Exhibit B – Employment Report
- Exhibit C – Schedule of Intended Subcontractor Utilization
- Exhibit D – Letter of Intent to Perform as a Subcontractor or Provide Materials or Services
- Exhibit E – Declaration Regarding Subcontractors Practices
- Exhibit F – Joint Venture Disclosure Affidavit
- Equal Business Opportunity Plan (EBO Plan). This document is not a form rather a statement created by the bidder/proposer on its company letter head addressing the EBO Plan requirements.
- Exhibit H – First Source Jobs Program Information, Form 1

The following document must be completed as instructed if awarded the project:

- Exhibit G – Prime Contractor's Subcontractor Utilization Report
- Exhibit H – First Source Jobs Program Agreement, Form 2

All Contract Compliance documents (Exhibits A – H and EBO Plan) are to be placed in a **separate sealed envelope** clearly marked "Contract Compliance". The EBO Plan must be submitted on company letterhead. These documents are considered part of and should be submitted with the Technical Proposal.

**EXHIBIT A – PROMISE OF NON-DISCRIMINATION**

“Know all persons by these presents, that I/We ( \_\_\_\_\_ ),  
Name

\_\_\_\_\_ Title Firm Name  
Hereinafter “Company”, in consideration of the privilege to bid on or obtain contracts funded, in whole or in part, by Fulton County, hereby consent, covenant and agree as follows:

- 1) No person shall be excluded from participation in, denied the benefit of, or otherwise discriminated against on the basis of race, color, national origin or gender in connection with any bid submitted to Fulton County for the performance of any resulting there from,
- 2) That it is and shall be the policy of this Company to provide equal opportunity to all businesses seeking to contract or otherwise interested in contracting with this Company without regard to the race, color, gender or national origin of the ownership of this business,
- 3) That the promises of non-discrimination as made and set forth herein shall be continuing in nature and shall remain in full force and effect without interruption,
- 4) That the promise of non-discrimination as made and set forth herein shall be made a part of, and incorporated by reference into, any contract or portion thereof which this Company may hereafter obtain,
- 5) That the failure of this Company to satisfactorily discharge any of the promises of non-discrimination as made and set forth herein shall constitute a material breach of contract entitling the Board to declare the contract in default and to exercise any and all applicable rights and remedies, including but not limited to cancellation of the contract, termination of the contract, suspension and debarment from future contracting opportunities, and withholding and/or forfeiture of compensation due and owing on a contract; and
- 6) That the bidder shall provide such information as may be required by the Director of Purchasing & Contract Compliance pursuant to the Fulton County Non-Discrimination in Purchasing and Contracting Ordinance.

**SIGNATURE:** \_\_\_\_\_

**ADDRESS:** \_\_\_\_\_

\_\_\_\_\_  
**TELEPHONE NUMBER:** \_\_\_\_\_

**EXHIBIT B – EMPLOYMENT REPORT**

The demographic employment make-up for the bidder must be identified and submitted with this bid/proposal. In addition, if subcontractors will be utilized by the bidder/proposer to complete this project, then the demographic employment make-up of the subcontractor(s) must be identified and submitted with this bid.

JOB CATEGORIES	TOTAL EMPLOYED		TOTAL MINORITIES		WHITE (Not Hispanic Origin)	BLACK or AFRICAN AMERICAN (Not of Hispanic Origin)		HISPANIC or LATINO	AMERICAN INDIAN or ALASKAN NATIVE (AIAN)		ASIAN		NATIVE HAWAIIAN or OTHER PACIFIC ISLANDER (NHOP)		TWO or MORE RACES		
	M	F	M	F		M	F		M	F	M	F	M	F	M	F	M
EXECUTIVE/SENIOR LEVEL OFFICIALS and MANAGERS																	
FIRST/MID LEVEL OFFICIALS and MANAGERS																	
PROFESSIONALS																	
TECHNICIANS																	
SALES WORKERS																	
ADMINISTRATIVE SUPPORT WORKERS																	
CRAFT WORKERS																	
OPERATIVES																	
LABORERS & HELPERS																	
SERVICE WORKERS																	
<b>TOTAL</b>																	

FIRMS'S NAME  
 ADDRESS  
 TELEPHONE

This completed form is for (Check only one):  
 Submitted by: \_\_\_\_\_ Bidder/Proposer \_\_\_\_\_ Subcontractor \_\_\_\_\_  
 Date Completed: \_\_\_\_\_

**EXHIBIT C - SCHEDULE OF INTENDED SUBCONTRACTOR UTILIZATION**

If the bidder/proposer intends to subcontract any portion of this scope of work/service(s), this form **must be** completed and **submitted with the bid/proposal**. All prime bidders/proposers **must** include Letter(s) of Intent (Exhibit D) in the bid document for all subcontractors who will be utilized under the scope of work/services.

**Prime Bidder/Proposer:** \_\_\_\_\_

**ITB/RFP Number:** \_\_\_\_\_

**Project Name or Description of Work/Service(s):** \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_

1. My firm, as Prime Bidder/Proposer on this scope of work/service(s) is \_\_\_\_\_ is not \_\_\_\_\_ a minority or female owned and controlled business enterprise. (Please indicate below the portion of work, including, percentage of bid/proposal amount that your firm will carry out directly):

\_\_\_\_\_  
\_\_\_\_\_

2. If the Prime Bidder/Proposer is a Joint Venture, please complete Exhibit F: Joint Venture Disclosure Affidavit and attach a copy of the executed Joint Venture Agreement.

3. Sub-Contractors (including suppliers) to be utilized in the performance of this scope of work/service(s), if awarded, are:

SUBCONTRACTOR NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

PHONE: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_

ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_

WORK TO BE PERFORMED: \_\_\_\_\_

DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

**\*Ethnic Groups: African American (AABE); Asian American (ABE); Hispanic American (HBE); Native American (NABE); White Female American (WFBE); \*\*If yes, please attach copy of recent certification.**

SUBCONTRACTOR NAME: \_\_\_\_\_  
ADDRESS: \_\_\_\_\_  
PHONE: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_  
ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_  
WORK TO BE PERFORMED: \_\_\_\_\_  
DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

---

SUBCONTRACTOR NAME: \_\_\_\_\_  
ADDRESS: \_\_\_\_\_  
PHONE: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_  
ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_  
WORK TO BE PERFORMED: \_\_\_\_\_  
DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

---

SUBCONTRACTOR NAME: \_\_\_\_\_  
ADDRESS: \_\_\_\_\_  
PHONE: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_  
ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_  
WORK TO BE PERFORMED: \_\_\_\_\_  
DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

---

SUBCONTRACTOR NAME: \_\_\_\_\_  
ADDRESS: \_\_\_\_\_  
PHONE: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_  
ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_  
WORK TO BE PERFORMED: \_\_\_\_\_  
DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

---

**\*Ethnic Groups: African American (AABE); Asian American (ABE); Hispanic American (HBE); Native American (NABE); White Female American (WFBE); \*\*If yes, please attach copy of recent certification.**

**Total Dollar Value of Subcontractor Agreements: (\$)**

**Total Percentage Value: (%)**

**CERTIFICATION:** The undersigned certifies that he/she has read, understands and agrees to be bound by the Bid/Proposer provisions, including the accompanying Exhibits and other terms and conditions regarding sub-contractor utilization. The undersigned further certifies that he/she is legally authorized by the Bidder/Proposer to make the statement and representation in this Exhibit and that said statements and representations are true and correct to the best of his/her knowledge and belief. The undersigned understands and agrees that if any of the statements and representations are made by the Bidder/Proposer knowing them to be false, or if there is a failure of the intentions, objectives and commitments set forth herein without prior approval of the County, then in any such event the Contractor's acts or failure to act, as the case may be, shall constitute a material breach of the contract, entitling the County to terminate the Contract for default. The right to so terminate shall be in addition to, and in lieu of, any other rights and remedies the County may have for other defaults under the contract.

**Signature:** \_\_\_\_\_ **Title:** \_\_\_\_\_

**Firm or Corporate Name:** \_\_\_\_\_

**Address:** \_\_\_\_\_

**Telephone:** (     ) \_\_\_\_\_

**Fax Number:** (     ) \_\_\_\_\_

**Email Address:** \_\_\_\_\_

EXHIBIT D

LETTER OF INTENT TO PERFORM AS A SUBCONTRACTOR  
OR  
PROVIDE MATERIALS OR SERVICES

This form **must** be completed by **ALL** known subcontractor and submitted with the bid/proposal. The Prime Contractor **must** submit Letters of Intent for **ALL** known subcontractors at time of bid submission.

To: \_\_\_\_\_  
(Name of Prime Contractor Firm)

From: \_\_\_\_\_  
(Name of Subcontractor Firm)

ITB/RFP Number: \_\_\_\_\_

Project Name: \_\_\_\_\_

The undersigned is prepared to perform the following described work or provide materials or services in connection with the above project (specify in detail particular work items, materials, or services to be performed or provided):

Description of Work	Project Commence Date	Project Completion Date	Estimated Dollar Amount

\_\_\_\_\_  
(Prime Bidder)

\_\_\_\_\_  
(Subcontractor)

Signature \_\_\_\_\_

Signature \_\_\_\_\_

Title \_\_\_\_\_

Title \_\_\_\_\_

Date \_\_\_\_\_

Date \_\_\_\_\_

**EXHIBIT E - DECLARATION REGARDING SUBCONTRACTING PRACTICES**

If the bidder/proposer **does not intend to subcontract** any portion of the scope of work services(s), this form **must be** completed and submitted with the bid/proposal.

\_\_\_\_\_ hereby declares that it is my/our intent to  
**(Bidder)**

perform 100% of the work required for \_\_\_\_\_  
**(ITB/RFP Number)**

\_\_\_\_\_  
**(Description of Work)**

In making this declaration, the bidder/proposer states the following:

1. That the bidder/proposer does not customarily subcontract elements of this type project, and normally performs and has the capability to perform and will perform **all elements** of the work on this project with his/her own current work forces;
2. If it should become necessary to subcontract some portion of the work at a later date, the bidder/proposer will comply with all requirements of the County's Non-Discrimination Ordinance in providing equal opportunities to all firms to subcontract the work. The determination to subcontract some portion of the work at a later date shall be made in good faith and the County reserves the right to require additional information to substantiate a decision made by the bidder/proposer to subcontract work following the award of the contract. Nothing contained in this provision shall be employed to circumvent the spirit and intent of the County's Non-Discrimination Ordinances;
3. The bidder will provide, upon request, information sufficient for the County to verify Item Number one.

**AUTHORIZED COMPANY REPRESENTATIVE**

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Date: \_\_\_\_\_

Signature: \_\_\_\_\_

Firm: \_\_\_\_\_

Address: \_\_\_\_\_

Phone Number: \_\_\_\_\_

Fax Number: \_\_\_\_\_

Email Address: \_\_\_\_\_

**EXHIBIT F - JOINT VENTURE DISCLOSURE AFFIDAVIT**

**ITB/RFP No.** \_\_\_\_\_

**Project Name** \_\_\_\_\_

This form must be completed and submitted with the bid/proposal if a joint venture approach is to be undertaken.

In order to evaluate the extent of small, minority and female business involvement being proposed by a Bidder/Proposer, certain relevant information must be provided prior to contract award. The information requested below is to clearly identify and explain the extent of small business participation in the proposed joint venture. All items must be properly addressed before the business entity can be evaluated.

**1. Firms:**

- 1) **Name of Business:** \_\_\_\_\_  
**Street Address:** \_\_\_\_\_  
**Telephone No.:** \_\_\_\_\_  
**Nature of Business:** \_\_\_\_\_
  
- 2) **Name of Business:** \_\_\_\_\_  
**Street Address:** \_\_\_\_\_  
**Telephone No.:** \_\_\_\_\_  
**Nature of Business:** \_\_\_\_\_
  
- 3) **Name of Business:** \_\_\_\_\_  
**Street Address:** \_\_\_\_\_  
**Telephone No.:** \_\_\_\_\_  
**Nature of Business:** \_\_\_\_\_

**NAME OF JOINT VENTURE (If applicable):** \_\_\_\_\_

**ADDRESS:** \_\_\_\_\_

\_\_\_\_\_

**PRINCIPAL OFFICE:** \_\_\_\_\_

**OFFICE PHONE:** \_\_\_\_\_

**Note:** Attach additional sheets as required

1. Describe the capital contributions by each joint venturer and accounting thereof.
2. Describe the financial controls of the joint venture, e.g., will a separate cost center be established? Which venturer will be responsible for keeping the books? How will the expense therefore be reimbursed? What is the authority of each joint venture to commit or obligate the order?
3. Describe any ownership, options for ownership, or loans between the joint ventures. Identify terms thereof.
4. Describe the estimated contract cash flow for each joint venturer.
5. To what extent and by whom will the on-site work be supervised?
6. To what extent and by whom will the administrative office be supervised?
7. Which joint venturer will be responsible for material purchases including the estimated cost thereof? How will the purchase be financed?
8. Which joint venturer will provide equipment? What is the estimated cost thereof? How will the equipment be financed?
9. Describe the experience and business qualifications of each joint venturer.
10. Submit a copy of all joint venture agreements and evidence of authority to do business in the State of Georgia as well as locally, to include all necessary business licenses.
11. Percent of Minority/Female Business Enterprises ownership by each joint venture in terms of profit and loss sharing: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_
12. The authority of each joint venturer to commit or obligate the other: \_\_\_\_\_  
\_\_\_\_\_
13. Number of personnel to be involved in project, their crafts and positions and whether they are employees of the Minority/Female Business Enterprises enterprise, the majority firm or the joint venture: \_\_\_\_\_  
\_\_\_\_\_

14. Identification of control and participation in venture; list those individuals who are responsible for day-to-day management and policy decision-maker, including, but not limited to, those with prime responsibility for areas designated below; (use additional sheets if necessary)

<u>Name</u>	<u>Race</u>	<u>Sex</u>	<u>Financial Decisions</u>	<u>Supervision Field Operation</u>
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____

In connection with any work that these firms, as a joint venture, might be authorized to perform in connection with above captioned contract, we each do hereby authorize representatives of the Fulton County Department of Contract Compliance, Departments of Purchasing and Contract Compliance, and Finance, under the direction of the County Manger's Office, to examine, from time to time, the books, records and files to the extent that such relate to this County project.

**WE DO SOLEMNLY DECLARE AND AFFIRM UNDER THE PENALTIES OF PERJURY THAT THE CONTENTS OF THE FOREGOING DOCUMENT ARE TRUE AND CORRECT, AND THAT WE ARE AUTHORIZED, ON BEHALF OF THE ABOVE FIRMS, TO MAKE THIS AFFIDAVIT AND GRANT THE ABOVE PRIVILEGE.**

FOR \_\_\_\_\_  
(Company)

Date: \_\_\_\_\_  
\_\_\_\_\_  
(Signature of Affiant)  
\_\_\_\_\_  
(Printed Name)

\_\_\_\_\_  
(Company)

Date: \_\_\_\_\_  
\_\_\_\_\_  
(Signature of Affiant)  
\_\_\_\_\_  
(Printed Name)

State of \_\_\_\_\_:

County of \_\_\_\_\_:

On this \_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_, before me, appeared \_\_\_\_\_, the undersigned officer, personally appeared \_\_\_\_\_ known to me to be the person described in the foregoing Affidavit and acknowledges that he (she) executed the same in the capacity therein stated and for the purpose therein contained.

**EXHIBIT – G PRIME CONTRACTOR/SUB-CONTRACTOR UTILIZATION REPORT**

This report **must** be submitted by the **tenth day** of each month, along with a copy of your monthly invoice (schedule of values/payment application) to Contract Compliance. Failure to comply **shall** result in the County commencing proceedings to impose sanctions to the prime contractor, in addition to pursuing any other available legal remedy. Sanctions may include the suspending of any payment or part thereof, termination or cancellation of the contract, and the denial of participation in any future contracts awarded by Fulton County.

<b>REPORTING PERIOD</b>		<b>PROJECT NAME:</b>
<b>FROM:</b>		<b>PROJECT NUMBER:</b>
<b>TO:</b>		<b>PROJECT LOCATION:</b>

PRIME CONTRACTOR		Contract Award Date	Contract Award Amount	Change Order Amount	Contract Period	% Complete to Date
Name:						
Address:						
Telephone #:						

AMOUNT OF REQUISITION THIS PERIOD: \$ \_\_\_\_\_  
 TOTAL AMOUNT REQUISITION TO DATE: \$ \_\_\_\_\_  
 TOTAL AMOUNT REQUISITION TO DATE: \$ \_\_\_\_\_

**SUBCONTRACTOR UTILIZATION (add additional rows as necessary)**

Name of Sub-Contractor	Description of Work	Contract Amount	Amount Paid To Date	Amount Requisition This Period	Contract Period	
					Starting Date	Ending Date



Should you have questions regarding any of the documents contained in Section 6, please feel free to contact the Office of Contract Compliance at (404) 763-6300, for further assistance.

## EXHIBIT H

### FULTON COUNTY FIRST SOURCE JOBS PROGRAM

#### **STATEMENT OF POLICY:**

It is the policy of Fulton County Government to provide employment opportunities to the citizens of Fulton County. This policy will apply to all contracts procured through the Department of Purchasing & Contract Compliance valued in excess of \$200,000. The Prime Contractor is expected to utilize the First Source Jobs Program to fill 50% of the entry level jobs which arise as a result of any project funded in whole or in part with County funds with residents of Fulton County.

#### **PURPOSE:**

The purpose of this policy is to create a pool of employable persons who are residents of Fulton County to be called upon as a source to fill jobs created as a result of any eligible project funded in whole or in part with County funds in order to provide stable economic opportunities for families throughout the County. The First Source Jobs Program will be implemented by the Department of Purchasing & Contract Compliance and the Office of Workforce Development.

#### **MONITORING POLICY:**

Upon execution of a contract with Fulton County Government, the First Source Jobs Agreement (FSJ Form 1) will become a part of the contract between the bidder/proposer and Fulton County Government. The First Source Jobs Program will be monitored during routine site visits by the Office of Contract Compliance along with the Office of Workforce Development.

**FULTON COUNTY**

**First Source Jobs Program Information**

**Company Name:** \_\_\_\_\_

**Project Number:** \_\_\_\_\_

**Project Name:** \_\_\_\_\_

The following entry-level positions will become available as a result of the above referenced contract with Fulton County.

1. \_\_\_\_\_
2. \_\_\_\_\_
3. \_\_\_\_\_
4. \_\_\_\_\_
5. \_\_\_\_\_
6. \_\_\_\_\_

Include a job description and all required qualifications for each position listed above.

Identify a company representative and contact phone number who will be responsible for coordinating with the First Source Jobs Program:

**Company Representative:** \_\_\_\_\_

**Phone Number:** \_\_\_\_\_

**Email Address:** \_\_\_\_\_

**FULTON COUNTY  
First Source Jobs Program Agreement**

Awarded Contractor's Name: \_\_\_\_\_

Formal Contract Name: \_\_\_\_\_

RFP/ITB Number: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Contact Phone: \_\_\_\_\_

The contractor listed above agrees to the following:

1. The contractor shall make a good faith effort to fill 50% of the entry level position(s) created by this project using the Fulton County First Source Jobs Program.
2. The contractor shall provide the applicable details of every entry level job in writing within the required form.
3. The contractor shall be expected to present documentation that confirms employment terms to both the employee and Fulton County.

The Office of Contract Compliance will assist with monitoring the participation of First Source Jobs Program employees during routine site visits and report findings to the Office of Workforce Development for confirmation and follow-up. The Office of Workforce Development shall notify the Director of Human Services and the Purchasing Agent of any determination of non-compliance with the requirements of this policy and recommend a resolution or action to be taken.

Upon a determination by the Purchasing Agent and the Director of Human Services that a contractor has failed to comply with any portion of this policy, the County may impose the following:

1. Ten percent (10%) of all future payments under the involved eligible project shall be entitled to be withheld from a contractor that has violated this policy until the contractor complies with the provisions of this policy.

The undersigned agrees to the terms and conditions set forth in this agreement.

Contractor's Official Title: \_\_\_\_\_ Date: \_\_\_\_\_

Contractor's Name: \_\_\_\_\_

Contractor's Signature: \_\_\_\_\_

**FORM 2**

## SECTION 8 GENERAL CONDITIONS

### **00700-1 FAMILIARITY WITH SITE**

Execution of this agreement by the Contractor is a representation that the Contractor has visited the site, has become familiar with the local conditions under which the work is to be performed, and has correlated personal observations with the requirements of this agreement.

### **00700-2 CONTRACT DOCUMENTS**

This agreement consists of Owner's invitation for bid, instructions to bidders, bid form, performance bond, payment bond, acknowledgments, the contract, general conditions, special conditions, specifications, plans, drawings, exhibits, addenda, and written change orders.

- A. Notice of Award of Contract:
- B. Execution of Contract Documents

Upon notification of Award of Contract, the Owner shall furnish the Contractor the conformed copies of Contract Documents for execution by the Contractor and the Contractor's surety.

Within ten (10) days after receipt the Contractor shall return all the documents properly executed by the Contractor and the Contractor's surety. Attached to each document shall be an original power-of-attorney for the person executing the bonds for the surety and certificates of insurance for the required insurance coverage.

After receipt of the documents executed by the Contractor and his surety with the power-of-attorney and certificates of insurance, the Owner shall complete the execution of the documents. Distribution of the completed documents will be made upon completion.

Should the Contractor and/or Surety fail to execute the documents within the time specified; the Owner shall have the right to proceed on the Bid Bond accompanying the bid.

If the Owner fails to execute the documents within the time limit specified, the Contractor shall have the right to withdraw the Contractor's bid without penalty.

Drawings and Specifications:

The Drawings, Specifications, Contract Documents, and all supplemental documents, are considered essential parts of the Contract, and requirements occurring in one are as binding as though occurring in all. They are intended to define, describe and provide for all Work necessary to complete the Project in an acceptable manner, ready for use, occupancy, or operation by the Owner.

In case of conflict between the Drawings and Specifications, the Specifications shall govern. Figure dimensions on Drawings shall govern over scale dimensions, and detailed Drawings shall govern over general Drawings.

In cases where products or quantities are omitted from the Specifications, the description and quantities shown on the Drawings shall govern.

Any ambiguities or need for clarification of the Drawings or Specifications shall be immediately reported to the Construction Manager in writing. Any such ambiguity or need for clarification shall be handled by the Construction Manager in writing. No clarification of the Drawings and Specifications hereunder by the Construction Manager shall entitle the Contractor to any additional monies unless a Change Order has been processed as provided by "Changes in the Contract" hereof.

Any work done by the Contractor following a discovery of such differing site condition or ambiguity or need for clarification in the Contract Drawings and Specifications prior to a written report to the Construction Manager shall not entitle the Contractor to additional monies and shall be done at the Contractor's risk.

The Construction Manager will furnish the Contractor five (5) copies of the Contract Drawings and the Specifications, one copy of which the Contractor shall have available at all times on the Project site.

### **00700-3 DEFINITIONS**

The following terms as used in this agreement are defined as follows to the extent the definitions herein differ or conflict with those in the Instructions for Bidders, Section 00100, the definitions herein shall control.

Alternate bids – the amount stated in the bid or proposal to be added to or deducted from the amount of the base bid or base proposal if the corresponding change in project scope or alternate materials or methods of construction is accepted.

Base bid – the amount of money stated in the bid or proposal as the sum for which the bidder or proposer offers to perform the work.

Change Order - an alteration, addition, or deduction from the original scope of work as defined by the contract documents to address changes or unforeseen conditions necessary for project completion. A written order to the Contractor issued by the County pursuant to Fulton County Policy and Procedures 800-6 for changes in the work within the general scope of the contract documents, adjustment of the contract price, extension of the contract time, or reservation of determination of a time extension.

Construction Manager shall mean the individual designated in writing, by the Director of the Public Works/General Services Department as the Construction Manager.

Contractor shall mean the party of the second part to the Contract Agreement or the authorized and legal representative of such party.

Contract Documents include the Contract Agreement, Contractor's Bid (including all documentation accompanying the Bid and any post-Bid documentation required by the County prior to the Notice of Award), Bonds, all Special Conditions, General Conditions, Supplementary Conditions, Specifications, Drawings and addenda, together with written amendments, change orders, field orders and the Construction Manager's written interpretations and clarifications issued in accordance with the General Conditions on or after the date of the Contract Agreement.

Shop drawing submittals reviewed in accordance with the General Conditions, geotechnical investigations and soils report and drawings of physical conditions in or relating to existing surface structures at or contiguous to the site are not Contract Documents.

Contract Price - The sum specified in the Agreement to be paid to the Contractor in consideration of the Work.

Contract Time shall mean the number of consecutive calendar days as provided in the Contract Agreement for completion of the Work, to be computed from the date of Notice to Proceed.

Owner or County shall mean Fulton County Government, party of the first part to the Contract Agreement, or its authorized and legal representatives.

Day - A calendar day of twenty-four hours lasting from midnight of one day to midnight the next day.

Director - Director of the Public Works/General Services Department of Fulton County, Georgia or the designee thereof.

Engineer of Record – Wiley Wilson, Inc. developed the specifications and drawings referred to herein.

Final Completion shall mean the completion of all work as required in accordance with the terms and conditions of the contract documents.

Liquidated Damages shall mean the amount, stated in the Contract Agreement, which the Contractor agrees to pay to the Owner for each consecutive calendar day beyond the Contract time required to complete the Project or for failing to comply with associated milestones. Liquidated Damages will end upon written notification from the Owner of Final Acceptance of the Project or upon written notification of from the Owner of completion of the milestone.

Notice to Proceed - A written communication issued by the County to the Contractor authorizing it to proceed with the work, establishing the date of commencement and completion of the work, and providing other direction to the Contractor.

Products shall mean materials or equipment permanently incorporated into the work.

Program Manager - Not used in this contract. Delete all references.

Project Manual - The Contract Documents.

Provide shall mean to furnish and install.

Substantial Completion - The date certified by the Construction Manager when all or a part of the work, as established pursuant to General Condition 0700-81, is sufficiently completed in accordance with the requirements of the contract documents so that the identified portion of the work can be utilized for the purposes for which it is intended.

Work or Project - All of the services specified, indicated, shown or contemplated by the contract documents, and furnishing by the Contractor of all materials, equipment, labor, methods, processes, construction and manufacturing materials and equipment, tools, plans, supplies, power, water, transportation and other things necessary to complete such services in accordance with the contract documents to insure a functional and complete facility.

#### **00700-4 CODES**

All codes, specifications, and standards referenced in the contract documents shall be the latest editions, amendments and revisions of such referenced standards in effect as of the date of the request for proposals for this contract.

### **00700-5 REVIEW OF CONTRACT DOCUMENTS**

Before making its proposal to the County, and continuously after the execution of the agreement, the Contractor shall carefully study and compare the contract documents and shall at once report to the Construction Manager any error, ambiguity, inconsistency or omission that may be discovered, including any requirement which may be contrary to any law, ordinance, rule, or regulation of any public authority bearing on the performance of the work. By submitting its proposal, the Contractor agrees that the contract documents, along with any supplementary written instructions issued by or through the Construction Manager that have become a part of the contract documents, appear accurate, consistent and complete insofar as can be reasonably determined. If the Contractor has timely reported in writing any error, inconsistency, or omission to the Construction Manager, has properly stopped the affected work until instructed to proceed, and has otherwise followed the instructions of the Construction Manager, the Contractor shall not be liable to the County for any damage resulting from any such error, inconsistency, or omission in the contract documents. The Contractor shall not perform any portion of the work without the contract documents, approved plans, specifications, products and data, or samples for such portion of the work. For purposes of this section "timely" is defined as the time period in which the contractor discovers, or should have discovered, the error, inconsistency, or omission, with the exercise of reasonable diligence.

### **00700-6 STRICT COMPLIANCE**

No observation, inspection, test or approval of the County or Construction Manager shall relieve the Contractor from its obligation to perform the work in strict conformity with the contract documents except as provided in General Condition 00700-48.

### **00700-7 APPLICABLE LAW**

All applicable State laws, County ordinances, codes, and rules and regulations of all authorities having jurisdiction over the construction of the project shall apply to this agreement. The Contractor shall comply with the requirements of any Fulton County program concerning non-discrimination in contracting. All work performed within the right of way of the Georgia Department of Transportation and any railroad crossing shall be in accordance with Georgia Department of Transportation regulations, policies and procedures and, where applicable, those of any affected railroad. The Contractor shall comply with all laws, ordinances, codes, rules and regulations bearing on the conduct of the work as specified and the Contractor agrees to indemnify and hold harmless the County, its officers, agents and employees, as well as the Construction Manager and the Program Manager against any claim or liability arising from or based on the violation of any law, ordinance, regulation, order or decree affecting the conduct of the work, whether occasioned by the Contractor, his agents or employees.

### **00700-8 PERMITS, LICENSES AND BONDS**

All permits and licenses necessary for the work shall be secured and paid for by the Contractor. If any permit, license or certificate expires or is revoked, terminated, or suspended as a result of any action on the part of the Contractor, the Contractor shall not be entitled to additional compensation or time. The Contractor shall obtain and keep in force at all times performance and payment bonds payable to Fulton County in penal amounts equal to 100% of the Contract price.

### **00700-9 TAXES**

- A. The Contractor shall pay all sales, retail, occupational, service, excise, old age benefit and unemployment compensation taxes, consumer, use and other similar taxes, as well as any other taxes or duties on the materials, equipment, and labor for the work provided by the Contractor which are legally enacted by any municipal, county, state or federal authority, department or agency at the time bids are received, whether or not yet effective. The Contractor shall maintain records pertaining to such taxes and levies as well as payment thereof and shall make the same available to the County at all reasonable times for inspection and copying. The Contractor shall apply for any and all tax exemptions which may be applicable and shall timely request from the County such documents and information as may be necessary to obtain such tax exemptions. The County shall have no liability to the Contractor for payment of any tax from which it is exempt.
- B. The Contractor is obligated to comply with all local and State Sales and Use Tax laws. The Contractor shall provide the Owner with documentation to assist the Owner in obtaining sales and/or use tax refunds for eligible machinery and equipment used for the primary purpose of reducing or eliminating air or water pollution as provided for in Chapter 48-8-3 (36) and (37) of the Official Code of Georgia. All taxes shall be paid by the Contractor. All refunds will accrue to the Owner.

Acceptance of the project as complete and final payment will not be made by the Owner until the Contractor has fully complied with this requirement.

### **00700-10 DELINQUENT CONTRACTORS**

The County shall not pay any claim, debt, demand or account whatsoever to any person firm or corporation who is in arrears to the County for taxes. The County shall be entitled to a counterclaim, backcharge, and offset for any such debt in the amount of taxes in arrears, and no assignment or transfer of such debt after the taxes become due shall affect the right of the County to offset any taxes owed against said debt.

### **00700-11 LIEN WAIVERS**

The Contractor shall furnish the County with evidence that all persons who have performed work or furnished materials pursuant to this agreement have been paid in full prior to submitting its demand for final payment pursuant to this agreement. A final affidavit, Exhibit A, must be completed, and submitted to comply with requirements of 00700-11. In the event that such evidence is not furnished, the County may retain sufficient sums necessary to meet all lawful claims of such laborers and materialmen. The County assumes no obligation nor in any way undertakes to pay such lawful claims from any funds due or that may become due to the Contractor.

### **00700-12 MEASUREMENT**

All items of work to be paid for per unit of measurement shall be subject to inspection, measurement, and confirmation by the Construction Manager.

### **00700-13 ASSIGNMENT**

The Contractor shall not assign any portion of this agreement or moneys due there from (include factoring of receivables) without the prior written consent of the County. The Contractor shall retain personal control and shall provide personal attention to the fulfillment of its obligations pursuant to this agreement. Any assignment without the

express written consent of the County shall render this contract voidable at the sole option of the County.

**00700-14 FOREIGN CONTRACTORS**

In the event that the Contractor is a foreign corporation, partnership, or sole proprietorship, the Contractor hereby irrevocably appoints the Secretary of State of Georgia as its agent for service of all legal process for the purpose of this contract only.

**00700-15 INDEMNIFICATION**

The Contractor hereby assumes the entire responsibility and liability for any and all injury to or death of any and all persons, including the Contractor's agents, servants, and employees, and in addition thereto, for any and all damages to property caused by or resulting from or arising out of any act or omission in connection with this contract or the prosecution of work hereunder, whether caused by the Contractor or the Contractor's agents, Servants, or employees, or by any of the Contractor's subcontractors or suppliers, and the Contractor shall indemnify and hold harmless the County, the Construction Manager, County's Commissioners, officers, employees, successors, assigns and agents, or any of their subcontractors from and against any and all loss and/or expense which they or any of them may suffer or pay as a result of claims or suits due to, because of, or arising out of any and all such injuries, deaths and/or damage, irrespective of County or Construction Manager negligence (except that no party shall be indemnified for their own sole negligence). The Contractor, if requested, shall assume and defend at the Contractor's own expense, any suit, action or other legal proceedings arising there from, and the Contractor hereby agrees to satisfy, pay, and cause to be discharged of record any judgment which may be rendered against the County and the Construction Manager arising there from.

In the event of any such loss, expense, damage, or injury, or if any claim or demand for damages as heretofore set forth is made against the County or the Construction Manager, the County may withhold from any payment due or thereafter to become due to the Contractor under the terms of this Contract, an amount sufficient in its judgment to protect and indemnify it and the Construction Manager, County's Commissioners, officers, employees, successors, assigns and agents from any and all claims, expense, loss, damages, or injury; and the County, in its discretion, may require the Contractor to furnish a surety bond satisfactory to the County providing for such protection and indemnity, which bond shall be furnished by the Contractor within five (5) days after written demand has been made therefore. The expense of said Bond shall be borne by the Contractor.

**00700-16 SUPERVISION OF WORK AND COORDINATION WITH OTHERS**

The Contractor shall supervise and direct the work using the Contractor's best skill and attention. The Contractor shall be solely responsible for all construction methods and procedures and shall coordinate all portions of the work pursuant to the contract subject to the overall coordination of the Construction Manager. All work pursuant to this agreement shall be performed in a skillful and workmanlike manner.

The County reserves the right to perform work related to the Project with the County's own forces and to award separate contracts in connection with other portions of the project, other work on the site under these or similar conditions of the contract, or work which has been extracted from the Contractor's work by the County.

When separate contracts are awarded for different portions of the project or other work on the site, the term "separate contractor" in the Contract Documents in each case shall mean the contractor who executes each separate County Agreement.

The Contractor shall cooperate with the County and separate contractors in arranging the introduction and storage of materials and equipment and execution of their work, and shall cooperate in coordinating connection of its work with theirs as required by the Contract Documents.

If any part of the Contractor's Work depends for proper execution or results upon the work of the County or any separate contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly report to the Construction Manager any apparent discrepancies or defects in such other work that render it unsuitable for such proper execution and results **within fourteen (14) days** of discovery of such discrepancy or defect. Failure of the Contractor to so report in writing shall constitute an acceptance of the County's or separate contractor's work as fit and proper to receive the Work, except as to any defects which may subsequently become apparent in such work by others.

Any costs caused by defective or untimely work shall be borne by the party responsible therefore.

Should the Contractor wrongfully cause damage to the work or property of the County or to other work or property on the site, including the work of separate contractors, the Contractor shall promptly remedy such damage at the Contractor's expense.

Should the Contractor be caused damage by any other contractor on the Project, by reason of such other contractor's failure to perform properly his contract with the County, no action shall lie against the County or the Construction Manager inasmuch as the parties to this agreement are the only beneficiaries hereof and there are no third party beneficiaries and neither the County nor the Construction Manager shall have liabilities therefore, but the Contractor may assert his claim for damages solely against such other contractor. The Contractor shall not be excused from performance of the contract by reason of any dispute as to damages with any other contractor or third party.

Where the Work of this Contract shall be performed concurrently in the same areas as other construction work, the Contractor shall coordinate with the Construction Manager and the separate contractors in establishing mutually acceptable schedules and procedures that shall permit all jobs to proceed with minimum interference.

If a dispute arises between the Contractor and separate contractors as to their responsibility for cleaning up, the County may clean up and charge the cost thereof to the Contractor or contractors responsible therefore as the County shall determine to be just.

#### **00700-17 ADMINISTRATION OF CONTRACT**

The Program Manager and the Construction Manager shall provide administration services as hereinafter described.

For the administration of this Contract, the Construction Manager shall serve as the County's primary representative during design and construction and until final payment to the Contractor is due. The Construction Manager shall advise and consult with the County and the Program Manager. The primary point of contact for the Contractor shall be the Construction Manager. All correspondence from the Contractor to the County shall be forwarded through the Construction Manager. Likewise, all correspondence and instructions to the Contractor shall be forwarded through the Construction Manager.

The Construction Manager will determine in general that the construction is being performed in accordance with design and engineering requirements, and will endeavor to guard the County against defects and deficiencies in the Work.

The Construction Manager will not be responsible for or have control or charge of construction means, methods, techniques, sequences, or procedures, or for safety precautions and programs in connection with the Work, nor will it be responsible for the Contractor's failure to carry out the Work in accordance with the Contract Documents. The Construction Manager will not be responsible for or have control or charge over the acts or omissions of the Contractor, its engineers, consultants, subcontractors, or any of their agents or employees, or any other persons performing the Work.

Based on the Construction Manager's observations regarding the Contractor's Applications for Payment, the Construction Manager shall determine the amounts owing to the Contractor, in accordance with the payment terms of the Contract, and shall issue Certificates for Payment in such amount to the County.

The Construction Manager shall render interpretations necessary for the proper execution or progress of the Work. Either party to the Contract may make written requests to the Construction Manager for such interpretations.

Claims, disputes and other matters in question between the Contractor and the County relating to the progress of the Work or the interpretation of the Contract Documents shall be referred to the Construction Manager for interpretation.

All interpretations of the Construction Manager shall be consistent with the intent of and reasonably inferable from the Contract Documents and shall be in writing or in graphic form.

Except as otherwise provided in this Contract, the Construction Manager shall issue a decision on any disagreement concerning a question of fact arising under this Contract. The Construction Manager shall reduce the decision to writing and mail or otherwise furnish a copy thereof to the Contractor. The decision of the Construction Manager shall be final and conclusive unless, within thirty (30) days from the date of receipt of such copy, the Contractor files a written appeal with the Director of Public Works and mails or otherwise furnishes the Construction Manager a copy of such appeal. The decision of the Director of Public Works or the Director's duly authorized representative for the determination of such appeals shall be final and conclusive. Such final decision shall not be pleaded in any suit involving a question of fact arising under this Contract, provided such is not fraudulent, capricious, arbitrary, so grossly erroneous as necessarily implying bad faith, or is not supported by substantial evidence. In connection with any appeal proceeding under this Article, the Contractor shall be afforded an opportunity to be heard and to offer evidence in support of Contractor's appeal. Pending any final decision of a dispute hereunder, the Contractor shall proceed diligently with the performance of the Contract as directed by the Construction Manager.

The Construction Manager shall have authority to reject Work which does not conform to the Contract Documents. Whenever, in the Construction Manager's opinion, it is considered necessary or advisable for the implementation of the intent of the Contract Documents, the County shall have authority to require special inspection or testing of the Work whether or not such Work be then fabricated, installed or completed. The Contractor shall pay for such special inspection or testing if the Work so inspected or tested is found not to comply with the requirements of the contract; the County shall pay for special inspection and testing if the Work is found to comply with the contract.

Neither the Construction Manager's authority to act under this Subparagraph, nor any decision made by the Construction Manager in good faith either to exercise or not to exercise such authority, shall give rise to any duty or responsibility of the Construction Manager to the Contractor, any subcontractor, any of their agents or employees, or any other person performing any of the Work.

The Contractor shall provide such shop drawings, product data, and samples as may be required by the Construction Manager and/or as required by these Contract Documents.

The Construction Manager shall conduct inspections to determine Substantial Completion and Final Completion, and shall receive and forward to the County for review written warranties and related documents required by the Contract Documents and assembled by the Contractor. The Construction Manager shall approve and issue Certificates for Payment upon compliance with Substantial and Final Completion requirements indicated in General Conditions 00700-81, 00700-82, 00700-84 and 00700-85 of this Agreement.

Except as provided in General Condition 00700-48, the Contractor shall not be relieved from the Contractor's obligations to perform the work in accordance with the contract documents by the activities or duties of the County or any of its officers, employees, or agents, including inspections, tests or approvals, required or performed pursuant to this agreement.

#### **00700-18 RESPONSIBILITY FOR ACTS OF EMPLOYEES**

The Contractor shall employ only competent and skilled personnel. The Contractor shall, upon demand from the Construction Manager, immediately remove any superintendent, foreman or workman whom the Construction Manager may consider incompetent or undesirable.

The Contractor shall be responsible to the County for the acts and omissions of the Contractor's employees, subcontractors, and agents as well as any other persons performing work pursuant to this agreement for the Contractor.

#### **00700-19 LABOR, MATERIALS, SUPPLIES, AND EQUIPMENT**

Unless otherwise provided in this agreement, the Contractor shall make all arrangements with necessary support agencies and utility companies provide and pay for all labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for the execution and completion of the work.

#### **00700-20 DISCIPLINE ON WORK SITE**

The Contractor shall enforce strict discipline and good order among its employees and subcontractors at all times during the performance of the work, to include compliance with the Fulton County Drug Free Work Place Policy. The Contractor shall not employ any subcontractor who is not skilled in the task assigned to it. The Construction Manager may, by written notice, require the Contractor to remove from the work any subcontractor or employee deemed by the Construction Manager to be incompetent.

#### **00700-21 HOURS OF OPERATION**

All work at the construction site shall be performed during regular business hours of the Fulton County government, except upon the Construction Manager's prior written consent to other work hours. It is further understood that the Contractor's construction schedule is based on a normal 40 hours, five day work week, less Fulton County-

recognized holidays. Contractors work schedule shall not violate Fulton County Noise Ordinance by working hours inconsistent with the Fulton County Noise Ordinance. The County's current noise ordinance or other applicable ordinance shall govern. If the Contractor desires to work in excess of this limit, the Contractor shall submit a written request to the Construction Manager, a minimum of five days prior to the desired work date. The Contractor shall be responsible for any additional expenses incurred by the Owner as a result of the extended work hours, including resident inspection overtime. The cost associated with resident inspector overtime shall be deducted from the Contractor monthly payment request.

#### **00700-22 FAMILIARITY WITH WORK CONDITIONS**

The Contractor shall take all steps necessary to ascertain the nature and location of the work and the general and local conditions which may affect the work or the cost thereof. The Contractor's failure to fully acquaint itself with the conditions which may affect the work, including, but not limited to conditions relating to transportation, handling, storage of materials, availability of utilities, labor, water, roads, weather, topographic and subsurface conditions, other separate contracts to be entered into by the County relating to the project which may affect the work of the Contractor, applicable provisions of law, and the character and availability of equipment and facilities necessary prior to and during the performance of the work shall not relieve the Contractor of its responsibilities pursuant to this agreement and shall not constitute a basis for an equitable adjustment of the contract terms. The County reserves the right to perform with its own forces or to contract with other entities for other portions of the project work, in which case the Contractor's responsibility to assure its familiarity with work conditions hereunder shall include all coordination with such other contractors and the County necessary to insure that there is no interference between contractors as will delay or hinder any contractor in its prosecution of work on the project. The County assumes no responsibility for any understandings or representations concerning conditions of the work made by any of its officers, agents, or employees prior to the execution of this agreement.

#### **00700-23 RIGHT OF ENTRY**

The County reserves the right to enter the site of the work by such agent, including the Construction Manager, as it may elect for the purpose of inspecting the work or installing such collateral work as the County may desire. The Contractor shall provide safe facilities for such access so that the County and its agents may perform their functions.

#### **00700-24 NOTICES**

Any notice, order, instruction, claim or other written communication required pursuant to this agreement shall be deemed to have been delivered or received as follows:

Upon personal delivery to the Contractor, its authorized representative, or the Construction Manager on behalf of the County. Personal delivery may be accomplished by in-person hand delivery or bona fide overnight express service.

Three days after depositing in the United States mail a certified letter addressed to the Contractor or the Construction Manager for the County. For purposes of mailed notices, the County's mailing address shall be 141 Pryor Street, 6th Floor, Atlanta, Georgia 30303, or as the County shall have otherwise notified the Contractor. The Contractor's mailing address shall be the address stated in its proposal or as it shall have most recently notified the Construction Manager in writing.

**00700-25 SAFETY**

**A. SAFETY, HEALTH AND LOSS PREVENTION**

The Contractor shall be responsible for implementing a comprehensive project-specific safety, health and loss prevention program and employee substance abuse program for this project. All Sub-Contractors must either implement their own program or follow the Contractor's safety, health and loss prevention program and employee substance abuse program.

The Contractor's safety, health and loss prevention program and employee substance abuse program must meet or exceed all governmental regulations (OSHA, EPA, DOT, State, local), and any other specific Fulton County requirements

**B. COUNTY'S SAFETY, HEALTH, AND LOSS PREVENTION PROCESS GUIDELINES AND REQUIREMENTS**

The County and its agents reserve the right, but assume no duty, to establish and enforce safety, health, and loss prevention guidelines and to make the appropriate changes in the guidelines, for the protection of persons and property and to review the efficiency of all protective measures taken by the Contractor. The Contractor shall comply with all safety, health, and loss prevention process guidelines and requirements and changes made by the County or its agent(s). The issuance of any such guidelines or changes by the County or its agent(s) shall not relieve the Contractor of its duties and responsibilities under this Agreement, and the County or its agent(s) shall not thereby assume, nor be deemed to have assumed, any such duties or responsibilities of the Contractor.

**C. COMPLIANCE OF WORK, EQUIPMENT, AND PROCEDURES WITH ALL APPLICABLE LAWS and REGULATIONS**

All Work, whether performed by the Contractor or its Sub-Contractors of any tier, or anyone directly or indirectly employed by any of them, and all equipment, appliances, machinery, materials, tools and like items incorporated or used in the Work, shall be in compliance with and conform to:

1. All applicable laws, ordinances, rules, regulations and orders of any public, quasi-public or other governmental authority relating to the safety of persons and their protection against injury, specifically including, but in no event limited to, the Federal Occupational Safety and Health Act of 1970, as amended, and all rules and regulations now or hereafter in effect pursuant to said Act.
2. All rules, regulations, and requirements of the County or its agent(s) and its insurance carriers relating there to. In the event of a conflict or differing requirements the more stringent shall govern.

**D. PROTECTION OF THE WORK**

1. The Contractor shall, throughout the performance of the Work, maintain adequate and continuous protection of all Work and temporary facilities against loss or damage from whatever cause, shall protect the property of the County and third parties from loss or damage from whatever cause arising out of the performance of the Work, and shall comply with the requirements of the County or its agent(s) and its insurance carriers, and with all applicable laws, codes, rules and regulations, (as same may be

amended) with respect to the prevention of loss or damage to property as a result of fire or other hazards.

2. The County or its agent(s) may, but shall not be required to, make periodic inspections of the Project work area. In such event, however, the Contractor shall not be relieved of its aforesaid responsibilities and the County or its agent(s) shall not assume, nor shall it be deemed to have assumed, any responsibility otherwise imposed upon the assurance of Contractor by this Agreement.

E. SAFETY EQUIPMENT

1. The Contractor shall provide to each worker on the Project work area the proper safety equipment for the duties being performed by that worker and will not permit any worker on the Project work area who fails or refuses to use the same. The County or its agent shall have the right, but not the obligation, to order the removal of a worker from the Project work site for his/her failure to comply with safe practices or substance abuse policies.

F. EMERGENCIES

1. In any emergency affecting the safety of persons or property, or in the event of a claimed violation of any federal or state safety or health law or regulation, arising out of or in any way connected with the Work or its performance, the Contractor shall act immediately to prevent threatened damage, injury or loss and to remedy said violation. Failing such action the County or its agent(s) may immediately take whatever steps it deems necessary including, but not limited to, suspending the Work as provided in this Agreement.
2. The County or its agent(s) may offset any and all costs or expenses of whatever nature, including attorneys' fees, paid or incurred by the County or its agent(s) (whether such fees are for in-house counsel or counsel retained by the County or its agent), in taking the steps authorized by Section 00700-25(G) (1) above against any sums then or thereafter due to the Contractor. The Contractor shall defend, indemnify and hold the County, its officers, agents, and employees harmless against any and all costs or expenses caused by or arising from the exercise by the County of its authority to act in an emergency as set out herein. If the Contractor shall be entitled to any additional compensation or extension of time change order on account of emergency work not due to the fault or neglect of the Contractor or its Sub-Contractors, such additional compensation or extension of time shall be determined in accordance with General Condition 00700-52 and General Condition 00700-87 of this Agreement.

G. SUSPENSION OF THE WORK

1. Should, in the judgment of the County or its agent(s), the Contractor or any Sub-Contractor fail to provide a safe and healthy work place, the County or its agent shall have the right, but not the obligation, to suspend work in the unsafe areas until deficiencies are corrected. All costs of any nature (including, without limitation, overtime pay, liquidated damages or

- other costs arising out of delays) resulting from the suspension, by whomsoever incurred, shall be borne by the Contractor.
2. Should the Contractor or any Sub-Contractor fail to provide a safe and healthy work place after being formally notified in writing by the County or its agents of such non-compliance, the contract may be terminated following the termination provision of the contract.
- H. **CONTRACTOR'S INDEMNITY OF THE COUNTY FOR CONTRACTOR'S NON-COMPLIANCE WITH SAFETY PROGRAM**
1. The Contractor recognizes that it has sole responsibility to assure its Safety Program is implemented and to assure its construction services are safely provided. The Contractor shall indemnify, defend and hold the County and its agents harmless, from and against any and all liability (whether public or private), penalties (contractual or otherwise), losses, damages, costs, attorneys' fees, expenses, causes of action, claims or judgments resulting, either in whole or in part, from any failure of the Contractor, its Sub-Contractors of any tier or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable, to comply with the safety requirements of the contract. The Contractor shall not be relieved of its responsibilities under the safety requirements of the Contract should the County or its agent(s) act or fail to act pursuant to its rights hereunder.
  2. The Contractor shall not raise as a defense to its obligation to indemnify under this Subparagraph I any failure of those indemnified hereunder to assure Contractor operates safely, it being understood and agreed that no such failure shall relieve the Contractor from its obligation to assure safe operations or from its obligation to so indemnify. The Contractor also hereby waives any rights it may have to seek contribution, either directly or indirectly, from those indemnified hereunder.
  3. In any and all claims against those indemnified hereunder by any employee of the Contractor, any Sub-Contractor of any tier or anyone directly or indirectly employed by any of them or anyone for whose acts any of them may be liable, the indemnification obligation under this Subparagraph I shall not be limited in any way as to the amount or type of damages, compensation or benefits payable by or for the Contractor or any Sub-Contractor of any tier under any workers' compensation act, disability benefit or other employee benefit acts.

#### **00700-26 BLASTING AND EXCAVATION**

The Contractor acknowledges that it is fully aware of the contents and requirements of O.C.G.A. § 25-9-1 through 25-9-12 concerning blasting and excavation near underground gas pipes and facilities and shall fully comply therewith.

#### **00700-27 HIGH VOLTAGE LINES**

The Contractor acknowledges that it is fully aware of the contents and requirements O.C.G.A. § 46-3-30 through 46-3-39 concerning safeguards against contact with high voltage lines, and the Contractor shall fully comply with said provisions.

**00700-28 SCAFFOLDING AND STAGING**

The Contractor acknowledges that it is the person responsible for employing and directing others to perform labor within the meaning of O.C.G.A. § 34-1-1 and agrees to comply with said provisions.

**00700-29 CLEAN-UP**

The Contractor shall clean up all refuse, rubbish, scrap materials, and debris caused by its operations to the end that the site of the work shall present a neat, orderly and workmanlike appearance at all times.

**00700-30 PROTECTION OF WORK**

The Contractor shall be responsible for maintenance and protection of the work, which shall include any County-furnished supplies, material, equipment, until final completion of this agreement and acceptance of the work as defined herein. Any portion of the work suffering injury, damage or loss shall be considered defective and shall be corrected or replaced by the Contractor without additional cost to the County.

**00700-31 REJECTED WORK**

The Contractor shall promptly remove from the project all work rejected by the Construction Manager for failure to comply with the contract documents and the Contractor shall promptly replace and re-execute the work in accordance with the contract documents and without expense to the County. The Contractor shall also bear the expense of making good all work of other Contractors destroyed or damaged by such removal or replacement.

**00700-32 DEFECTIVE WORK**

If the Contractor defaults or neglects to carry out any portion of the work in accordance with the contract documents, and fails within three days after receipt of written notice from the Construction Manager to commence and continue correction of such default or neglect with diligence and promptness, the County may, after three days following receipt by the Contractor of an additional written notice and without prejudice to any other remedy the County may have, make good such deficiencies and complete all or any portion of any work through such means as the County may select, including the use of a separate Contractor. In such case, an appropriate change order shall be issued deducting from the payments then or thereafter due the Contractor the cost of correcting such deficiencies. In the event the payments then or thereafter due the Contractor are not sufficient to cover such amount, the Contractor shall pay the difference to the County on demand.

The County may, at its option, accept defective or nonconforming work instead of requiring its removal or correction. In such case, a change order shall be issued reducing the price due the contractor to the extent appropriate and equitable. Such contract price adjustment shall be effected whether or not final payment has been made.

**00700-33 WARRANTY OF NEW MATERIALS**

The Contractor warrants to the County that all materials and equipment furnished under this contract will be new unless otherwise specified, and the Contractor further warrants that all work will be of good quality, free from faults and defects, and in conformance with the contract documents. The warranty set forth in this paragraph shall survive final acceptance of the work.

**00700-34 CONTRACTOR'S WARRANTY OF THE WORK**

If within one year after the date of issuance of the certificate of final payment pursuant to General Condition 84, or within such longer period of time as may be prescribed by law or by the term of any applicable special warranty required by the contract documents, any of the work is found to be defective or not in accordance with the contract documents, the Contractor shall correct such work promptly after receipt of written notice from the Construction Manager to do so. This obligation shall survive both final payment for the work and termination of the contract.

**00700-35 ASSIGNMENT OF MANUFACTURERS' WARRANTIES**

Without limiting the responsibility or liability of the Contractor pursuant to this agreement, all warranties given by manufacturers on materials or equipment incorporated in the work are hereby assigned by the Contractor to the County. If requested, the Contractor shall execute formal assignments of said manufacturer's warranties to the County. All such warranties shall be directly enforceable by the County.

**00700-36 WARRANTIES IMPLIED BY LAW**

The warranties contained in this agreement, as well as those warranties implied by law, shall be deemed cumulative and shall not be deemed alternative or exclusive. No one or more of the warranties contained herein shall be deemed to alter or limit any other.

**00700-37 STOP WORK ORDERS**

In the event that the Contractor fails to correct defective work as required by the contract documents or fails to carry out the work in accordance with contract documents, the Construction Manager, in writing, may order the Contractor to stop work until the cause for such order has been eliminated. This right of the County to stop work shall not give rise to any duty on the part of the County or the Construction Manager to execute this right for the benefit of the Contractor or for any other person or entity.

**00700-38 TERMINATION FOR CAUSE**

If the Contractor is adjudged bankrupt, makes a general assignment for the benefit of creditors, suffers the appointment of a receiver on account of its insolvency, fails to supply sufficient properly skilled workers or materials, fails to make prompt payment to subcontractors or materialmen, disregards laws, ordinances, rules, regulations, or orders of any public authority having jurisdiction, fails to diligently prosecute the work, or is otherwise guilty of a material violation of this agreement and fails within seven days after receipt of written notice to commence and continue correction of such default, neglect, or violation with diligence and promptness, the County may, after seven days following receipt by the Contractor of an additional written notice and without prejudice to any other remedy the County may have, terminate the employment of the Contractor and take possession of the site as well as all materials, equipment, tools, construction equipment and machinery thereon. The County may finish the work by whatever methods the County deems expedient. In such case, the Contractor shall not be entitled to receive any further payment until the work is completed. If the unpaid balance of the contract price exceeds the cost of completing the work, such excess shall be paid to the Contractor. If such costs exceed the unpaid balance, the Contractor shall pay the difference to the County on demand. This obligation for payment shall survive the termination of the contract. Termination of this agreement pursuant to this paragraph may result in disqualification of the Contractor from bidding on future County contracts.

**00700-39 TERMINATION FOR CONVENIENCE**

The County may, at any time upon written notice to the Contractor, terminate the whole or any portion of the work for the convenience of the County. The effective date of the terminations shall be provided in the written notice. Said termination shall be without prejudice to any right or remedy of the County provided herein. In addition, in the event this agreement has been terminated due to the default of the Contractor, and if it is later determined that the Contractor was not in default pursuant to the provisions of this agreement at the time of termination, then such termination shall be considered a termination for convenience pursuant to this paragraph.

**00700-40 TERMINATION FOR CONVENIENCE - PAYMENT**

If the Contract is terminated for convenience by the Owner as provided in this article, Contractor will be paid compensation for those services actually performed as approved by the Owner or his representative. Partially completed tasks will be compensated for based on a signed statement of completion prepared by the Construction Manager and submitted to the Contractor which shall itemize each task element and briefly state what work has been completed and what work remains to be done. Contractor shall also be paid for reasonable costs for the orderly filing and closing of the project.

**00700-41 TERMINATION FOR CONVENIENCE - PAYMENT LIMITATIONS**

Except for normal spoilage, and except to the extent that the County shall have otherwise expressly assumed the risk of loss, there shall be excluded from the amounts payable to the Contractor the fair value, as determined by the Construction Manager, of property which is destroyed, lost, stolen or damaged so as to become undeliverable to the County or to another buyer.

**00700-42 COST TO CURE**

If the County terminates for cause the whole or any part of the work pursuant to this agreement, then the County may procure upon such terms and in such manner as the Construction Manager may deem appropriate, supplies or services similar to those so terminated, and the Contractor shall be liable to the County for any excess costs for such similar supplies or services. The Contractor shall continue the performance of this agreement to the extent not terminated hereunder.

**00700-43 ATTORNEY'S FEES**

Should the Contractor default pursuant to any of the provisions of this agreement, the Contractor and its surety shall pay to the County such reasonable attorney's fees as the County may expend as a result thereof and all costs, expenses, and filing fees incidental thereto.

**00700-44 CONTRACTOR'S RESPONSIBILITIES UPON TERMINATION**

After receipt of a notice of termination from the County, and except as otherwise directed by the Construction Manager, the Contractor shall:

1. Stop work under the contract on the date and to the extent specified in the notice of termination;
2. Place no further orders or subcontracts for materials, services or facilities, except as may be necessary for completion of such portion of the work under the agreement as is not terminated;

3. Terminate all orders and subcontracts to the extent that they relate to the performance of work terminated by the notice of termination;
4. Assign to the County in the manner, at the times, and to the extent directed by the Construction Manager, all of the rights, title and interest of the Contractor under the orders and subcontracts so terminated, in which case the County shall have the right, at its discretion, to settle or pay any and all claims arising out of the termination of such orders or subcontracts;
5. Settle all outstanding liabilities and all claims arising out of such termination of orders and subcontracts with the approval or ratification of the Construction Manager, to the extent the Construction Manager may require, which approval or ratification shall be final for all purposes;
6. Transfer title and deliver to the entity or entities designated by the Construction Manager, in the manner, at the times, and to the extent, if any, directed by the Construction Manager, and to the extent specifically produced or specifically acquired by the Contractor for the performance of such portion of the work as has been terminated:
  - a. The fabricated or un-fabricated parts, work, and progress, partially completed supplies, and equipment, materials, parts, tools, dyes, jigs, and other fixtures, completed work, supplies, and other material produced as a part of or acquired in connection with the performance of the work terminated by the notice of termination; and
  - b. The completed or partially completed plans, drawings, information, and other property to the work.
7. Use its best efforts to sell in the manner, at the times, to the extent, and at the prices directed or authorized by the Construction Manager, any property described in Section 6 of this paragraph, provided, however, that the Contractor shall not be required to extend credit to any buyer and further provided that the proceeds of any such transfer or disposition shall be applied in reduction of any payments to be made by the County to the Contractor pursuant to this agreement.
8. Complete performance of such part of the work as shall not have been terminated by the notice of termination; and
9. Take such action as may be necessary, or as the Construction Manager may direct, for the protection and preservation of the property related to the agreement which is in the possession of the Contractor and in which the County has or may acquire an interest.

**00700-45 RECORDS**

The Contractor shall preserve and make available to the County all of its records, books, documents and other evidence bearing on the costs and expenses of the Contractor and any subcontractor pursuant to this agreement upon three days advance notice to the Contractor.

**00700-46 DEDUCTIONS**

In arriving at any amount due the Contractor pursuant to the terms of this agreement, there shall be deducted all liquidated damages, advance payments made to the Contractor applicable to the termination portion of the contract, the amount of any claim which the County may have against the Contractor, the amount determined

By the Construction Manager to be necessary to protect the County against loss due to outstanding potential liens or claims, and the agreed price of any materials acquired or sold by the Contractor and not otherwise recovered by or credited to the County.

**00700-47 REIMBURSEMENT OF THE COUNTY**

In the event of termination, the Contractor shall refund to the County any amount paid by the County to the Contractor in excess of the costs properly reimbursable to the Contractor.

**00700-48 SUSPENSION, INTERRUPTION, DELAY, DAMAGES**

The Contractor shall be entitled to only those damages and that relief from termination by the County as specifically set forth in this agreement. The Construction Manager may issue a written order requiring the Contractor to suspend, delay or interrupt all or any part of the work for such period of time as the County may determine to be appropriate for the convenience of the County. If the Construction Manager issues a written order requiring the Contractor to suspend, delay or interrupt all or any part of the work and if the performance of the work is interrupted for an unreasonable period of time by an act of the County or any of its officers, agents, employees, contractors, or consultants in the administration of this agreement, an equitable adjustment may be made for any increase in the Contractor's costs of performance and any increase in the time required for performance of the work necessarily caused by the unreasonable suspension, delay, or interruption. Any equitable adjustment shall be reduced to writing and shall constitute a modification to this agreement. In no event, however, shall an equitable adjustment be made to the extent that performance of this agreement would have been suspended, delayed or interrupted by any other cause, including the fault or negligence of the Contractor. No claim for an equitable adjustment pursuant to this paragraph shall be permitted before the Contractor shall have notified the Construction Manager in writing of the act or failure to act involved, and no claim shall be allowed unless asserted in writing to the Construction Manager within ten days after the termination of such suspension, delay or interruption.

**00700-49 COMMENCEMENT AND DURATION OF WORK**

The County may issue a Notice to Proceed at any time within 120 days following execution of the contract by the County. The Contractor shall commence work pursuant to this agreement within ten days of mailing or delivery of written notice to proceed. The Contractor shall diligently prosecute the work to completion within the time specified therefore in the Agreement. The capacity of the Contractor's construction and manufacturing equipment and plan, sequence and method of operation and forces employed, including management and supervisory personnel, shall be such as to insure completion of the work within the time specified in the Agreement. The Contractor and County hereby agree that the contract time for completion of the work is reasonable taking into consideration the average climatic conditions prevailing in the locality of the work and anticipated work schedules of other contractors whose activities are in conjunction with or may affect the work under this contract.

**00700-50 TIME OF THE ESSENCE**

All time limits stated in this agreement are of the essence of this contract.

**00700-51 IMPACT DAMAGES**

Except as specifically provided pursuant to a stop work order or change order, the Contractor shall not be entitled to payment or compensation of any kind from the County for direct or indirect or impact damages including, but not limited to, costs of acceleration arising because of delay, disruption, interference or hindrance from any cause whatsoever whether such delay, disruption, interference or hindrance is reasonable or unreasonable, foreseeable or unforeseeable, or avoidable, provided, however, that this provision shall not preclude the recovery of damages by the Contractor for hindrances or delays due solely to fraud or bad faith on the part of the County, its agents, or employees. The Contractor shall be entitled only to extensions in the time required for performance of the work as specifically provided in the contract.

**00700-52 DELAY**

The Contractor may be entitled to an extension of the contract time, but not an increase in the contract price or damages, for delays arising from unforeseeable causes beyond the control and without the fault or negligence of the Contractor or its subcontractors for labor strikes, acts of God, acts of the public enemy, acts of the state, federal or local government in its sovereign capacity, by acts of another separate contractor, or by an act or neglect of the County.

**00700-53 INCLEMENT WEATHER**

The Contractor shall not be entitled to an extension of the contract time due to normal inclement weather. Unless the Contractor can substantiate to the satisfaction of the Construction Manager that there was greater than normal inclement weather and that such greater than normal inclement weather actually delayed the work, the Contractor shall not be entitled to an extension of time therefore. The following shall be considered the normal inclement weather days for each month listed, and extensions of time shall be granted in increments of not less than one half day only for inclement weather in excess of the days set out.

January	10 days
February	10 days
March	7 days
April	6 days
May	4 days
June	3 days
July	4 days
August	2 days
September	2 days
October	3 days
November	6 days
December	9 days

**00700-54 DELAY - NOTICE AND CLAIM**

The Contractor shall not receive an extension of time unless a Notice of Delay is filed with the Construction Manager within ten days of the first instance of such delay, disruption, interference or hindrance and a written Statement of the Claim is filed with the Construction Manager within 20 days of the first such instance. In the event that the Contractor fails to comply with this provision, it waives any claim which it may have for an extension of time pursuant to this agreement.

**00700-55 STATEMENT OF CLAIM - CONTENTS**

The Statement of Claim referenced in Article 00700-54 shall include specific information concerning the nature of the delay, the date of commencement of the delay, the construction activities affected by the delay, the person or organization responsible for the delay, the anticipated extent of the delay, and any recommended action to avoid or minimize the delay.

**00700-56 WORK BEHIND SCHEDULE, REMEDY BY CONTRACTOR**

If the work actually in place falls behind the currently updated and approved schedule, and it becomes apparent from the current schedule that work will not be completed within the contract time, the Contractor agrees that it will, as necessary, or as directed by the Construction Manager, take action at no additional cost to the County to improve the progress of the work, including increasing manpower, increasing the number of working hours per shift or shifts per working day, increasing the amount of equipment at the site, and any other measure reasonably required to complete the work in a timely fashion.

**00700-57 DILIGENCE**

The Contractor's failure to substantially comply with the requirements of the preceding paragraph may be grounds for determination by the County that the Contractor is failing to prosecute the work with such diligence as will insure its completion within the time specified. In such event, the County shall have the right to furnish, from its own forces or by contract, such additional labor and materials as may be required to comply with the schedule after 48 hours written notice to the Contractor, and the Contractor shall be liable for such costs incurred by the County.

**00700-58 SET-OFFS**

Any monies due to the Contractor pursuant to the preceding paragraph of this agreement may be deducted by the County against monies due from the County to the Contractor.

**00700-59 REMEDIES CUMULATIVE**

The remedies of the County under Articles 00700-56, 00700-57, and 00700-58 are in addition to and without prejudice to all of the rights and remedies of the County at law, in equity, or contained in this agreement.

**00700-60 TITLE TO MATERIALS**

No materials or supplies shall be purchased by the Contractor or by any Subcontractor subject to any chattel mortgage or under a conditional sales contract or other agreement by which any interest is retained by the seller. The Contractor hereby warrants that it has good and marketable title to all materials and supplies used by it in the work, and

the Contractor further warrants that all materials and supplies shall be free from all liens, claims, or encumbrances at the time of incorporation in the work.

**00700-61 INSPECTION OF MATERIALS**

All materials and equipment used in the construction of the project shall be subject to adequate inspection and testing in accordance with accepted standards and in accordance with the requirements of the contract documents. Additional tests performed after the rejection of materials or equipment shall be at the Contractor's expense.

**00700-62 CONSTRUCTION MANAGER'S PRESENCE DURING TESTING**

All tests performed by the Contractor shall be witnessed by the Construction Manager unless the requirement therefore is waived in writing. The Construction Manager may perform additional tests on materials previously tested by the Contractor, and the Contractor shall furnish samples for this purpose as requested.

**00700-63 MATERIALS INCORPORATED IN WORK**

The Contractor shall furnish all materials and equipment to be incorporated in the work. All such materials or equipment shall be new and of the highest quality available. Manufactured materials and equipment shall be obtained from sources which are currently manufacturing such materials, except as otherwise specifically approved by the Construction Manager.

**00700-64 STORAGE OF MATERIALS**

Materials and equipment to be incorporated in the work shall be stored in such a manner as to preserve their quality and fitness for the work and to facilitate inspection.

**00700-65 PAYROLL REPORTS**

The Contractor may be required to furnish payroll reports to the Construction Manager as required by the Owner Controlled Insurance Program.

**00700-66 CONTRACTORS' REPRESENTATIVE**

Before beginning work, the Contractor shall notify the Construction Manager in writing of one person within its organization who shall have complete authority to supervise the work, receive orders from the Construction Manager, and represent the Contractor in all matters arising pursuant to this agreement. The Contractor shall not remove its representative without first designating in writing a new representative. The Contractor's representative shall normally be present at or about the site of work while the work is in progress. When neither the Contractor nor its representative is present at the work site, the superintendent, foreman, or other of the Contractor's employee in charge of the work shall be an authorized representative of the Contractor.

**00700-67 SPECIALTY SUB-CONTRACTORS**

The Contractor may utilize the services of specialty subcontractors on those parts of the project which, under normal contracting practices, are performed by specialty subcontractors. The Contractor shall not award more than seventy-five percent of the work to subcontractors.

**00700-68 INSPECTION BY THE CONSTRUCTION MANAGER**

All work pursuant to this agreement shall be subject to inspection by the Construction Manager for conformity with contract drawings and specifications. The Contractor shall

give the Construction Manager reasonable advance notice of operations requiring special inspection of a portion of the work.

**00700-69 WORK COVERED PRIOR TO CONSTRUCTION MANAGER'S INSPECTION**

In the event that work is covered or completed without the approval of the Construction Manager, and such approval is required by the specifications or required in advance by the Construction Manager, the Contractor shall bear all costs involved in inspection notwithstanding conformance of such portion of the work to the contract drawings and specifications.

**00700-70 SCHEDULING OF THE WORK**

The work of this contract shall be planned, scheduled, executed, and reported as required by the Contract Documents.

**00700-71 PROGRESS ESTIMATES**

The Contractor shall prepare a written report for the Construction Manager's approval, on County forms, of the total value of work performed and materials and equipment obtained to the date of submission. Such a report must accompany each request for a progress payment and is subject to review and approval by the Construction Manager. Approval of a progress estimate or tendering of a progress payment shall not be considered an approval or acceptance of any work performed, and all estimates and payments shall be subject to correction in subsequent estimates. Progress payments shall be made for all completed activities and for materials suitably stored on-site.

**00700-72 PROGRESS PAYMENTS**

Upon approval of each monthly estimate of work performed and materials furnished, the Construction Manager shall approve payment to the Contractor for the estimated value of such work, materials, and equipment, less the amount of all prior payments and any liquidated damages. The Contractor will be paid 100 percent, less retainage, of the cost of materials received and properly stored on-site but not incorporated into the work. Payments for materials or equipment stored on the site shall be conditioned upon submission by the Contractor of bills of sale to establish the County's title to such materials or equipment. The Contractor's request for payment shall provide sufficient detail as to the work completed or materials purchased for which payment is requested to permit meaningful review by the Construction Manager.

**00700-73 TIME OF PAYMENT**

The Contractor will be paid within 45 days following receipt of an approved Progress Estimate. The Contractor expressly agrees that the payment provisions within this Contract shall supersede the rates of interest, payment periods, and contract and subcontract terms provided for under the Georgia Prompt Pay Act, O.C.G.A. §13-11-1 et seq., and that the rates of interest, payment periods, and contract and subcontract terms provided for under the Prompt Pay Act shall have no application to this Contract. The County shall not be liable for any late payment interest or penalty.

**00700-74 RETAINAGE**

The County shall retain from each progress payment ten percent of the estimated value of the work performed until the progress payments, including retainage, total 50 percent of the contract price. If a contract includes two or more projects or assignments that have been separately priced and have separate budgets, and the performances of such projects or assignments are not related to or dependent upon the performance of any

other, the 50 per cent limit shall be based upon the price for each individual project or assignment. Thereafter, no further retainage shall be withheld so long as the Contractor is making satisfactory progress to insure completion of the work within the time specified therefore. The County may reinstate the ten percent retainage in the event the Construction Manager determines that the Contractor is not making satisfactory progress to complete the work within the time specified in this agreement or in the event that the Construction Manager provides a specific cause for such withholding. The County may also withhold retainage upon substantial completion of the work as provided in O.C.G.A. §13-10-81(c). Interest may be paid upon the retainage in accordance with Georgia law.

**00700-75 PAYMENT OF SUBCONTRACTORS**

The Contractor shall promptly pay each subcontractor upon the receipt of payment from the County. Such payment shall be made from the amount paid to the Contractor pursuant to the subcontractor's work. The Contractor shall also maintain the records of the percentage retained from payments to the Contractor pursuant to such subcontractor's work. The Contractor shall procure agreements from each subcontractor requiring each subcontractor to pay their subcontractors, agents and employees in a similar manner. The County reserves the right to inquire of any subcontractor, supplier, materialmen, or subconsultant, the status of any indebtedness of the Contractor. The County further reserves the right to require the Contractor to designate on each instrument of payment exceeding \$400.00 to subcontractors, suppliers, materialmen, and subconsultants that such payment is on account of the work under this Contract.

**00700-76 COUNTY'S RESPONSIBILITIES TO SUBCONTRACTORS**

Neither the County nor the Construction Manager shall have any obligation to pay any subcontractor except as otherwise required by law.

**00700-77 PROGRESS PAYMENTS - ACCEPTANCE OF WORK**

Certification of progress payments, as well as the actual payment thereof, shall not constitute the County's acceptance of work performed pursuant to this agreement.

**00700-78 PAYMENTS IN TRUST**

All sums paid to the Contractor pursuant to this agreement are hereby declared to constitute trust funds in the hands of the contractor to be applied first to the payment of claims of subcontractors, laborers, and suppliers arising out of the work, to claims for utilities furnished and taxes imposed, and to the payment of premiums on surety and other bonds and on insurance for any other application.

**00700-79 JOINT PAYMENTS**

The County reserves the right to issue any progress payment or final payment by check jointly to the Contractor and any subcontractor or supplier.

**00700-80 RIGHT TO WITHHOLD PAYMENT**

The Construction Manager may decline to approve payment and may withhold payment in whole or in part to the extent reasonable and necessary to protect the County against loss due to defective work, probable or actual third party claims, the Contractor's failure to pay subcontractors or materialmen, reasonable evidence that the work will not be completed within the contract time or contract price or damage to the County or any other contractor on the project.

**00700-81 CERTIFICATE OF SUBSTANTIAL COMPLETION**

Upon the Contractor's submission of a request for a certificate of Substantial Completion, the Construction Manager shall inspect the work and determine whether the work is Substantially Complete. If the work is Substantially Complete, the Construction Manager shall issue a certificate of Substantial Completion of the work which shall establish the date of Substantial Completion, shall state the responsibilities of the County and the Contractor for security, maintenance, heat, utilities, damage to the work and insurance, and shall fix the time within which the Contractor shall complete the items submitted by the Contractor as requiring correction or further work. The certificate of substantial completion of the work shall be submitted to the County and the Contractor for their written acceptance of the responsibilities assigned to them pursuant to such certificate.

If in the sole opinion of the Construction Manager, the work is not substantially complete, the Construction Manager shall notify the Contractor of such, in writing, and outline requirements to be met to achieve Substantial Completion.

**00700-82 PAYMENT UPON SUBSTANTIAL COMPLETION**

Upon Substantial Completion of the work and upon application by the Contractor and approval by the Construction Manager, the County shall make payment reflecting 100% work completed, less value of work remaining as determined by Construction Manager and any authorized retainage.

**00700-83 COMMENCEMENT OF WARRANTIES**

Warranties required by this agreement shall commence on the date of final completion of the project as determined under Article 00700-84 unless otherwise provided in the certificate of Substantial Completion.

**00700-84 FINAL PAYMENT - WAIVER OF CLAIMS, DISPUTE OF FINAL PAYMENT**

The acceptance of the Substantial Completion payment shall constitute a waiver of all claims by the Contractor except those previously made in writing and identified by the Contractor as unsettled at the time of application for payment at Substantial Completion and except for the retainage sums due at final acceptance. Following the Construction Manager's issuance of the certificate of Substantial Completion and the Contractor's completion of the work pursuant to this agreement, the Contractor shall forward to the Construction Manager a written notice that the work is ready for final inspection and acceptance. If after inspection the Construction Manager certifies that the work is complete and issues written notification of such to the Contractor, the Contractor shall forward to the Construction Manager a final application for payment. The Construction Manager shall issue a certificate for payment, which shall approve final payment to the Contractor and shall establish the date of final completion.

In the event the Contractor timely disputes the amount of the final payment, the amount due the Contractor shall be deemed by the Contractor and the County to be an unliquidated sum and no interest shall accrue or be payable on the sum finally determined to be due to the Contractor for any period prior to final determination of such sum, whether such determination be by agreement of the Contractor and the County or by final judgment of the proper court in the event of litigation between the County and the Contractor. The Contractor specifically waives and renounces any and all rights it may have under O.C.G.A. §13-6-13 and agrees that in the event suit is brought by the Contractor against the County for any sum claimed by the Contractor under the Contract

or for any extra or additional work, no interest shall be awarded on any sum found to be due from the County to the Contractor in the final judgment entered in such suit. All final judgments shall draw interest at the legal rate, as specified by law.

**00700-85 DOCUMENTATION OF COMPLETION OF WORK**

Neither the final payment nor the remaining retainage shall become due until the Contractor submits the following documents to the Construction Manager:

- a. An affidavit that all payrolls, bills for materials and equipment, and other indebtedness connected with the work have been paid other otherwise satisfied;
- b. The surety's consent to final payment; and
- c. Any other data reasonably required by the County or Construction Manager establishing payment or satisfaction of all such obligations, including releases, waivers of liens, and documents of satisfaction of debts.

In the event that a subcontractor refuses to furnish a release or waiver as required by the County or Construction Manager, the Contractor may furnish a bond satisfactory to the County to indemnify the County against such loss. In the event that any lien or indebtedness remains unsatisfied after all payments are made, the contractor shall refund to the County all moneys that the County may become compelled to pay in discharging such lien or other indebtedness, including all costs and reasonable attorney's fees.

**00700-86 GOVERNING LAW**

Each and every provision of this agreement shall be construed in accordance with and governed by Georgia law. The parties acknowledge that this contract is executed in Fulton County, Georgia and that the contract is to be performed in Fulton County, Georgia. Each party hereby consents to the Fulton Superior Court's sole jurisdiction over any dispute which arises as a result of the execution or performance of this agreement, and each party hereby waives any and all objections to venue in the Fulton Superior Court.

**00700-87 CHANGES IN THE WORK**

A. CHANGE ORDERS

1. A Change Order is a written order to the Contractor signed to show the approval and the authorization of the County, issued after execution of the Contract, authorizing a change in the Work and/or an adjustment in the Contract Sum or the Contract Time. Change Orders shall be written using forms designated by the County with Contractor providing supporting documentation as required by the Construction Manager. The Contract Sum and the Contract Time may be changed only by approved Change Order pursuant to Fulton County Procedure 800-6. The amount payable by the Change Order is payment in full for all direct and indirect costs incurred and related to the work under said Change Order, including but not limited to delays, imports, acceleration, disruption and extended overhead. A Change Order signed by the Contractor indicates the Contractor's agreement therewith, including the adjustment in either or both of the Contract Sum or the Contract Time.

2. The County, without invalidating the Contract, may order changes in the Work within the general scope of the Contract as defined herein. The time allowed for performance of the work and the contract price to be paid to the Contractor may be adjusted accordingly.
3. The cost or credit to the County resulting from a change in the Work shall be determined in one or more of the following ways:
  - a. By mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
  - b. By unit prices stated in the Contract Documents or subsequently agreed upon;
  - c. By cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
  - d. By the method provided in Subparagraph A4 below.
4. If none of the methods set forth in Subparagraphs 3a, 3b, or 3c above is agreed upon, the Contractor, provided a written order signed by the Construction Manager is received, shall promptly proceed with the Work involved. The cost of such Work shall then be determined by the Construction Manager on basis of the reasonable expenditures and savings of those performing the Work attributable to the change. The cost of the change shall include only the items listed in Subparagraph 5a below, and in the case of either a decrease or an increase in the Contract Sum, an allowance for overhead and profit in accordance with the schedules set forth in Subparagraphs 5b and 6 below shall be applied to the cost or credit.
  - a. In such case, and also under Subparagraph 3a above, the Contractor shall keep and present, in such form as the Construction Manager may prescribe, an itemized accounting of all actual costs expended, together with appropriate supporting data for inclusion in a Change Order.
  - b. All hourly rate charges shall be submitted to the Construction Manager for prior review and approval. All hourly rate charges shall be properly supported as required by the Construction Manager with certified payrolls, or their acceptable equivalent. When authorized to proceed for a given change and actual expenditures have been made prior to execution of a Change Order for the entire change, such actual expenditures may be summarized monthly, and if approved, incorporated into a Change Order. When both additions and credits covering related Work or substitutions are involved in any one change, the allowance for overhead and profit shall be figured on the basis of the net increase or decrease, if any, with respect to that change.
5. In Subparagraphs 3 and 4 above, the items included in "Cost and "Overhead" shall be based on the following schedule:
  - a. Unless otherwise provided in the Contract Documents, "Cost" shall be limited to the following: cost of materials incorporated into the Work, including sales tax and cost of delivery; cost of direct

- labor (labor cost may include a pro rata share of foreman's account of the change) including social security, old age and unemployment insurance, and fringe benefits required by agreement or custom; workers' or workmen's compensation insurance; rental value of equipment and machinery; costs for preparing Shop Drawings.
- b. Unless otherwise provided in the Contract Documents, "Overhead" shall include the following: bond and insurance premiums including increase and decreases from change in the Work, supervision, superintendence, construction parking, wages of timekeepers, watchmen and clerks, small tools, consumable supplies, expendables, incidentals, general office expense, the cost of additional reproduction for the Contractor's subcontractors beyond that agreed upon in the Contract Documents, construction parking, any additional costs of craft supervision by the Contractor's or subcontractors' superintendents, and overhead charges which would be customary and expended regardless of the change in the Work due to other overlapping activities which are included as part of the original Contract, and all other expenses not included in "Cost" above.
  - c. In the event that a change is issued by the County which would require the expenditure of substantial amounts of special supervision (beyond the foreman level) by the Contractor, the Contractor may, at the sole direction of the Construction Manager, be allowed to incorporate these charges into the agreement cost for the change.
6. In Subparagraphs 3 and 4 above, the allowance for overhead and profit combined, included in the total cost or credit to the County, shall be based on the following schedule:
- a. For the Contractor, for any work performed by the Contractor's own forces, ten (10) percent of the cost.
  - b. For the Contractor, for any work performed by a Contractor's subcontractor, five (5) percent of the amount due the subcontractor.
  - c. For each subcontractor or sub-subcontractor involved, for any work performed by that subcontractor's or sub-subcontractor's own forces, ten (10) percent of the cost.
  - d. For each subcontractor, for work performed by a sub-subcontractor, five (5) percent of the amount due to the sub-subcontractor.
  - e. Cost to which overhead and profit is to be applied shall be determined in accordance with Subparagraph 5 above unless modified otherwise.
7. In order to facilitate checking of quotations for extras or credits, all proposals or bids, except those so minor that their propriety can be seen by inspection, shall be accompanied by a complete itemization of costs,

including labor cost, materials and subcontracts. Labor and materials shall be itemized in the manner defined in Subparagraph 4 above. Where major cost items are subcontracts, they shall be itemized also. In no case shall a change be approved without such itemization.

8. No payment shall be made for any changes to the contract that are not included in a fully executed Change Order.

**B. CONCEALED, UNKNOWN AND DIFFERING CONDITIONS**

1. Should concealed conditions be encountered in the performance of the Work below the surface of the ground, or should concealed or unknown conditions in an existing structure be at variance with the conditions indicated by the Contract Documents, or should unknown physical conditions below the surface of the ground or concealed or unknown conditions in an existing structure of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in work of the character provided for in this Contract, be encountered, the Contract Sum and Contract Time shall be equitably adjusted by Change Order upon request by either party made **within twenty (20) days after the first observance** of the conditions. No such request for equitable adjustment shall be valid unless the Contractor complies with this (20) days notice and Subparagraph C.1. below.
2. The Contractor shall promptly, and before such conditions are disturbed, notify the Construction Manager in writing of any claim of concealed, unknown or differing conditions pursuant to this paragraph. The Construction Manager shall authorize the Engineer to investigate the conditions, and if it is found that such conditions do materially so differ and cause an increase or decrease in the Contractor's cost of, or the time required for, performance of any part of the Work under this Contract, whether or not changed as a result of such conditions, an equitable adjustment shall be recommended to the Construction Manager.
3. No claim of the Contractor under this clause shall be allowed unless the Contractor has given the notice required in (a) above, prior to disturbing the condition.
4. No claim by the Contractor for an equitable adjustment shall be allowed if asserted after final payment under this Contract.
5. Any materially differing site condition as between what is shown on the Drawings and Specifications and actually found on site shall be immediately reported to the Construction Manager in writing prior to the commencement of Work at the site. Failure of the Contractor to notify the Construction Manager in writing of the differing site condition prior to performance of Work at the site shall constitute a waiver of any claim for additional monies. Any Change Order necessitated by the differing site condition shall be processed as provided under "Changes in the Contract".

**C. REQUESTS FOR ADDITIONAL COST**

1. If the Contractor wishes to request an increase in the Contract Sum, the Contractor shall give the Construction Manager written notice thereof

within twenty (20) days after the occurrence of the event, or identification of the conditions, giving rise to such request. This notice shall be give by the Contractor before proceeding to execute the Work, except in an emergency endangering life or property in which case the Contractor shall proceed in accordance with Article 00700-25 and Subparagraph A.4 above. No such request shall be valid unless so made within the twenty (20) days specified above. If the County and the Contractor cannot agree on the amount of the adjustment in the Contract Sum, it shall be determined by the Construction Manager. Any change in the Contract Sum resulting from such claim shall be documented by Change Order.

2. If the Contractor claims that addition cost is involved because of, but not limited to (1) any written interpretation pursuant to General Condition 00700-17 of this Agreement, (2) any order by the County to stop the Work pursuant to Articles 00700-25 and 00700-37 of this Agreement where the Contractor was not at fault, or any such order by the Construction Manager as the County's agent, or (3) any written order for a minor change in the Work issued pursuant to Paragraph D below, the Contractor shall submit a request for an increase in the Contract Sum as provided in Subparagraph C.1 above. No such claim shall be valid unless the Contractor complies with Subparagraph C.1 above and approved by the County pursuant to Change Order Policy 800-6.

#### D. MINOR CHANGES IN THE WORK

The Construction Manager may order minor changes in the Work not involving an adjustment in the Contract Price, extension of the time allowed for performance of the work and not inconsistent with the intent of the Contract Documents. Such changes shall be effected by a written Change Directive issued by the Construction Manager, and shall be binding on the County and the Contractor. The Contractor shall carry out such written orders promptly.

#### E. BONDS

If any change order results in an increase in the contract price, the contractor shall increase the penal sum of the performance and payment bonds to equal the increased price.

#### **00700-88 DISAGREEMENT WITH ORDERS FOR CHANGE**

Contractor's written acceptance of a Change Order or other order for changes shall constitute his final and binding agreement to the provisions thereof and a waiver of all claims in connection therewith, whether direct or consequential in nature. Should Contractor disagree with any order for changes, he may submit a notice of potential claim to the Construction Manager, at such time as the order is set forth in the form of a Change Order. Disagreement with the provisions of an order for changes shall not relieve Contractor of his obligation under Article 00700-87 of this Agreement.

#### **00700-89 NO WAIVER OF REMEDIES**

Exercise by the County of any remedy is not exclusive of any other remedy available to County and shall not constitute a waiver of any such other remedies. Failure of the County to exercise any remedy, including breach of contract remedies, shall not preclude the County from exercising such remedies in similar circumstances in the future.

**00700-90 LAND AND RIGHTS-OF-WAY**

The owner will provide, as indicated in the Contract Documents and prior to Notice to Proceed, the lands upon which the work is to be done, right-of-way for access thereto, and such other lands which are designated for the use of the Contractor. The Contractor shall confine the Contractor's work and all associated activities to the easements and other areas designated for the Contractor's use. The Contractor shall comply with any limits on construction methods and practices which may be required by easement agreements. If, due to some unforeseen reason, the necessary easements are not obtained, the Contractor shall receive an equitable extension of contract time dependent upon the effect on the critical path of the project schedule or the County may terminate the Contract for its convenience.

**00700-91 COORDINATION WITH STATE DEPARTMENT OF TRANSPORTATION**

No clearing or grading shall be completed by Contractor within the State Department of Transportation (DOT) area under construction. The Contractor must coordinate his construction scheduling with DOT.

If the Contractor begins work before DOT's completion date, he must obtain the approval of DOT before starting work in the area. The state DOT has the right to stop the Contractor's work the DOT area.

The Contractor shall receive no additional compensation or damages resulting from delay or work stoppage from DOT actions or scheduling.

Contractor shall obtain DOT drawings of the DOT, project area for verification of road geometry, storm drains, etc. from Georgia Department of Transportation or Fulton County. The Contractor is responsible for obtaining any pertinent DOT revisions.

I N D E X

<u>SUBJECT</u>	<u>GENERAL CONDITION ARTICLE #</u>
Administration of Contract	17
Applicable Law	7
Assignment	13
Blasting and Excavation	26
Changes	87, 88
Clean Site	29
Codes	4
Commencement of Work	49
Contract Documents	2
Contractor's Representative	66
Defective Work	31, 32
Definitions	3
Delay	51, 52, 54, 55
Extension of Time	52, 53, 54
Familiarity of Time	1, 22
Final Payment	84
Governing Law	86
High Voltage Lines	27
Inclement Weather	53
Indemnification	15
Inspections	23, 61, 62, 68, 69
Interruption	48
Licenses	8
Liquidated Damages	46, 48
New Materials	33, 63
Notices	24
Payment	72, 73, 75
Payment of Subcontractors	75, 76
Payment Upon Substantial Completion	82, 84
Payroll Reports	65
Permits	8

Progress Payments	72, 73, 77, 78, 79, 80
Protection of Work	30, 64
Records Inspection	45
Retainage	11, 74
Safety	25
Scaffolding and Staging	28
Scheduling	70
Service of Process	14
Stop Work Order	37
Subcontractors	67, 76
Substantial Completion	81
Suspension	48
Supervision of Work	16, 66
Surety's Responsibility	17
Taxes	9, 10
Termination for Cause	38, 44, 47
Termination for Convenience	39, 40, 41
Time of the Essence	50
Warranties	33, 34, 35, 36
Work Behind Schedule	56

**EXHIBIT A**  
**FINAL AFFIDAVIT**

TO FULTON COUNTY, GEORGIA

I, \_\_\_\_\_, hereby certify that all suppliers of materials, equipment and service, subcontractors, mechanic, and laborers employed by \_\_\_\_\_ or any of his subcontractors in connection with the design and/or construction of \_\_\_\_\_ at Fulton County have been paid and satisfied in full as of \_\_\_\_\_, 200\_\_\_\_, and that there are no outstanding obligations or claims of any kind for the payment of which Fulton County on the above-named project might be liable, or subject to, in any lawful proceeding at law or in equity.

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Title

Personally appeared before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_, \_\_\_\_\_, who under Oath deposes and says that he is \_\_\_\_\_ of the firm of \_\_\_\_\_, that he has read the above statement and that to the best of his knowledge and belief same is an exact true statement.

\_\_\_\_\_  
Notary Public

\_\_\_\_\_  
My Commission expires

END OF SECTION

## SPECIAL CONDITIONS

The following **Special Conditions** are incorporated into the contract Phasing Plan as part of the Invitation to Bid (ITB) and provided to prospective bidders of the new Roof Replacement project for the Justice Center Tower Building.

1. The Contractor is fully aware that this work will be performed in an occupied building (9<sup>th</sup> Floor – Sheriff's Department) and Fulton County reserves the right to define excessive noise/dust produced.
2. Normal Court operation hours are 8am to 5pm Monday through Friday. The Fulton County Sheriff's Department normal daily hours of operation are 8am to 5pm Monday through Friday; with 7 day a week, 24 hour a day shifts.
3. The Contractor will have limited use of the freight elevator for materials & personnel.
4. The Contractor employees will have daily access to the freight elevator which will be provided by Deputies at 185 Central Avenue entrance between 7:00 am and 7:30 am.
5. The Contractor is specifically advised to insure that no interruption to the activities of the Courts or Sheriff's Department shall occur during the course of construction or as a result of the construction.
6. The Contractor, will be required to provide a field office for material, meetings & staging area.
7. Successful Bidder Requirement- The successful bidder and their staff will be required to submit to **Background Checks (at a cost of \$15/employee), submit a Criminal History Consent Form and a copy of a valid driver's license (PRIOR TO THE ISSUANCE OF A Temporary Fulton County Identification Badge through the Sheriff's Department). Any personnel found without a proper Identification Badge displayed shall be escorted from and/or denied access to the facility.**
8. The Contractor will have a restroom(s) (m/f) at the North End of the 9<sup>th</sup> Floor available for use by construction personnel. The Contractor shall be responsible for the daily cleaning the restroom(s) and shall have a designated employee for cleaning each (m/f) bathroom at the end of each work shift.

9. **No material deliveries, crane, construction or hoisting activities will be permitted on Central Avenue, Pryor Street or Mitchell Street.**
10. Material deliveries, crane or hoisting activities will be permitted between 11am and 3pm Monday to Friday or after 6:00 pm Monday- Friday.
11. The Contractor will be permitted to bring no more than 25% of materials on site at a time due to limited storage space. Modifications necessary to accommodate delivery to the existing building site (or conditions), shall be restored at the Contractor expense (i.e. protection of elevators, hoist, sidewalks, etc).
12. The location of a waste container, shall be coordinated with the Project Management and the Sheriff's Department. Contractor shall provide protection to the façade of the building for waste removal.
13. The Contractor will be granted the distance of 4 parking spaces available on Martin Luther King Street for use of debris removal waste container only. **There is no available employee parking on site or within designated waste container spaces or any kind.** The only available parking will be public parking areas on the street or non-County owned parking garages.
14. Contractor will be required to attend protocol meetings, independent from the mandatory pre-construction or construction meetings.
15. **ACCESS to 9<sup>th</sup> floor Patio will be from upper main roof. No Access will be permitted thru the Sheriff's Department Window Access Panel.**
16. Existing Utility Interruptions: Do not interrupt utilities service facilities occupied by Fulton County Government or others unless permitted under the following conditions and then only after arranging to provide temporary utility services according to requirements indicated:
  - a) Notify Owner not less than five (5) days in advance of proposed utility interruption or shutdown.
  - b) Do not proceed with utility interruptions without Owners written permission.
17. Any required asbestos removal throughout the building must be done when the building is vacant.

## EXHIBIT C

### CONTRACTOR SAFETY AND HEALTH MANAGEMENT PROCESS

### SAFETY POLICY STATEMENT

It is the policy of Fulton County to establish a comprehensive accident and loss prevention process for all Capital Projects implemented by Fulton County or its agents.

The goals of this comprehensive accident and loss prevention process are as follows:

- To prevent personal injury, property damage, and injury to the public.
- To implement safety and loss prevention processes as critical elements in the complete design and build process.
- To establish a proactive safety and health process that complies with all laws, regulations, consensus standards, and good management practices.
- To have the Contractors partner with Fulton County in the implementation of a Safety and Loss Prevention Process Program to minimize loss potential and to minimize risk.

Fulton County requires safety, health and loss prevention requirements and expectations to be included in project design, in the invitation to bid, in bid award and project meetings, and in the post job evaluations. The Contractor is required to develop and submit a project safety and health program for acceptance by Fulton County prior to Notice to Proceed. The Contractor is required to implement these requirements, and develop a management system to ensure compliance following the safety and health process outlined in this document and the bid documents.

The Contractor and other entities placed under contract with Fulton County will be obligated to implement, adhere to and enforce this Policy. The safety and health of the Contractor's employees, Sub-Contractors, and the public are the sole responsibility of the Contractor. The County may use and direct designated Representatives to implement and enforce this policy. **Failure of the Contractor to comply with this policy or any Safety related obligations may be grounds for contract termination.**

Fulton County's designated Representative will periodically inspect all Fulton County construction projects to identify safety hazards and make recommendations to resolve the issues. Contractor will be responsible for abating the identified issues in a timely manner, and submitting written description of corrective action within 48 hours to Fulton County designated Representatives. Failure to bring timely resolution to the issues may result in work stoppage at Contractor's expense.

Prior to commencing work under this contract, Contractor's Project Manager and Project Superintendent shall attend a Pre-Construction Meeting and Safety Pre-Planning meeting to address safety issues/requirements.

\*\*\*\*\*

## CONTRACTOR SAFETY AND HEALTH MANAGEMENT PROCESS

### 1.0 NOT USED

### 2.0 REFERENCES

- 2.1 Occupational Safety and Health Regulations (OSHA) 29CFR1910 and 29CFR1926
- 2.2 Environmental Protection Agency Regulations (EPA) 40CFR
- 2.3 Fulton County Safety and Health and Requirements
- 2.4 Georgia Department of Transportation Regulations and Requirements
- 2.5 US Department of Transportation Requirements
- 2.6 Manual of Uniform Traffic Control Devices for Streets and Highways (ANSI D6.1)
- 2.7 Georgia Department of Natural Resources Environmental Protection Division Regulations

Safety rules and regulations will be followed using federal, state or local regulations in force. Should a Contractor's rule be in use which is more effective, the most stringent rule or regulation will be enforced by the Contractor, Sub-Contractor's and Fulton County designated Safety Representative(s).

### 3.0 RESPONSIBILITY

The Contractor receiving the bid has the ultimate responsibility for the safety and health of all Sub-Contractors, all employees on the project, and the general public and complying with all governmental regulations and requirements (OSHA, EPA, DOT, state, local). Nothing contained herein shall relieve the Contractor or any Sub-Contractor of such responsibility or liability.

### 4.0 PROCEDURE

- 4.1 The Contractor and each Sub-Contractor must implement a written safety and health prevention process and program following the guidelines contained in this document and in any other relevant portion of the Contract Documents. This program must be accepted by Fulton County or its Representatives prior to Notice to Proceed.
- 4.2 The Contractor and each Sub-Contractor must implement a drug and alcohol policy following the guidelines contained in this document and in the bid specific actions. This program must be accepted by Fulton County or its Representatives prior to Notice to Proceed.
- 4.3 The Contractor must designate a person responsible for site safety. Each Sub-Contractor must designate a person responsible for site safety.
- 4.4 Not Used.
- 4.5 Contractor is responsible for providing all necessary safety supplies and personal protective equipment required to protect its employees, Sub-Contractors, and the general public.
- 4.6 Contractor shall make available certified First-aid services, First-aid supplies, and provisions for medical care for all employees at the construction site prior to beginning work on site.
- 4.7 Contractor shall maintain a competent person at the construction site at all times with an OSHA 10-hour certification. Said person shall have the knowledge to recognize hazards or potential hazards and has the authority to correct such hazards.
- 4.8 The status of project safety shall be included in the Contractor's agenda, which is required in Progress Meetings.

## 5.0 DRUG AND ALCOHOL POLICY

The Contractor and each Sub-Contractor must implement a drug and alcohol policy in order to maintain a safe and efficient work environment. This policy must include the following elements.

1. Written policy that prohibits the use, transportation, sale and possession of these materials.
2. Disciplinary action plan for violations
3. Any treatment or reinstatement/reemployment options
4. Drug and alcohol testing schedule that includes pre-employment, periodic for safety sensitive or critical jobs, and for cause

Note: AGC, ABC and/or Fulton County programs may be used as guidance documents.

## 6.0 OTHER CONTROLLED ITEMS

The Contractor and each Sub-Contractor is required to include in the Project Safety Program a prohibition against the use, possession, concealment, transportation, promotion or sale of the following controlled items

1. Firearms, weapons, and ammunition.
2. Switchblades
3. Unauthorized explosives including fireworks
4. Stolen property or contraband
5. Controlled chemicals or chemicals recognized as being able to be used for improper purposes.

## 7.0 EMERGENCY PROCEDURES/GUIDELINES

- 7.1 The Contractor is required to establish site specific emergency procedures in the Project Safety Program to manage emergencies that may occur at any time in the following categories:

1. Fire
2. Employee injury
3. Pedestrian injury due to work activity of any kind
4. Property damage and damage to various utilities (i.e., electrical, gas, sewerage, water, telephone or public roadways)
5. Public demonstrations
6. Bomb threats
7. Flood, Wind, Lightening, Hail
8. Terrorists Threats
9. Work place violence

- 7.2 These Emergency Procedures will be made part of the Contractor's Project Safety Program submittal and shall include but not be limited to the following elements:

1. A list of emergency phone numbers posted at the job site, along with information to be transmitted in such emergencies.
2. An incident command structure defining duties and responsibilities
3. A system to train supervisors and employees on this emergency plan
4. Procedures on how to handle emergencies including access to the site by emergency responders, accounting for workers, and securing the area.
5. Procedures for media releases. These releases must be coordinated through the Fulton County Information and Public Affairs Office in coordination with the County's designated Representative.
6. A plan that addresses serious incidents that includes notification to Fulton County, Fulton County's designated Representative immediately after the incident.

7. A review and updating frequency that includes forwarding a copy to Fulton County
8. and the County's designated Representative.

## 8.0 ACCIDENT AND INCIDENT INVESTIGATION AND REPORTING

- 8.1 The Contractor is responsible for reporting all accidents and incidents on the project site to the County's designated Representative within (1) business day. Accidents or incidents resulting in a fatality, property loss in excess of \$5,000, or involvement with the general public must be reported immediately to Fulton County's designated Representative and the investigation of the accident or incident coordinated with Fulton County Safety staff.
- 8.2 The Contractor will maintain a log of all injuries that occur on the job site. This log will be current and available for review.
- 8.3 For any incidents such as fires, explosions, fatalities, etc., the Contractor must notify Fulton County's designated Representative immediately and must coordinate any releases to the news media through the County's designated Representative and the County's Information and Public Affairs Office.
- 8.4 If a work-related injury should occur on this project, Contractor shall perform a thorough investigation of the incident and document the information.
- 8.5 A written accident investigation report containing the following information as a minimum must be forwarded to the Fulton County's designated Representative within 24 hours of incident.
  1. Company Name
  2. Location
  3. Date and Time of incident
  4. Description of incident
  5. Names of all parties involved and all witnesses
  6. Corrective action(s) taken to prevent recurrence
  7. If the incident involves injury or illness, the following information must be provided:
    - a) A medical description of the injury or illness
    - b) OSHA recordability status i.e. first aid, medical treatment, lost time, days of restricted work.
    - c) If the public is involved, information about treatment and treatment location.
  8. Any pictures, site drawings, etc. if they assist in describing the incident.

If the investigation cannot be completed in 24 hours, a preliminary report marked as such shall be forwarded and the report completed and forwarded as soon as possible.

## 9.0 JOB SAFETY ANALYSIS

- 9.1 The Contractor and each Sub-Contractor must implement a procedure to conduct a written job safety analysis or job hazard analysis for all project work tasks prior to beginning each task. Reference Appendix A.
- 9.2 The job safety analysis should follow National Safety Council, AGC, or other recognized guidelines and address all safety and health hazards for the work, identify personal protective and other safety equipment required, identify potential hazards to the general public if applicable, and identify any safety equipment, training, or controls that must be implemented prior to starting the work.

- 9.3 The Contractor must maintain a file for all job safety analysis forms, which is accessible for review.

## 10.0 SAFETY AND HEALTH COMPLIANCE AUDITING

### 10.1 Self Auditing Requirements

- 10.1.1 The Contractor and each Sub-Contractor must implement a procedure to assure that written safety and health audits or inspections are conducted at least biweekly (every 2 weeks). Safety checklists used by Fulton County's designated Representative may be used. The Contractor may use this checklist or an equivalent approved by Fulton County's designated Representative.
- 10.1.2 Each written safety audit must be filed on the site and a copy forwarded to Fulton County designated Representative.

### 10.2 NOT USED

### 10.3 INSPECTIONS BY REGULATORY AGENCIES

- 10.3.1 The Contractor must notify the Fulton County designated Representative whenever an OSHA compliance officer, health inspector, or EPA or Georgia Environmental Protection Division Representative arrives at the project site to conduct an inspection.
- 10.3.2 The Contractor is required to forward a copy of all regulatory citations, notice of violations, or similar for this project to Fulton County's designated Representative.
- 10.3.3 These records will be reviewed with Fulton County designated Representative and included in the Construction Project files.

### 10.4 SAFETY INSPECTION AND AUDIT FOLLOW UP

- 10.4.1 Every safety audit or regulatory inspection conducted per the requirements above may be reviewed by the Fulton County designated Representative. This review may identify serious and repeat safety items, look at trends, identify risks and potential losses, and site safety and loss prevention activities.
- 10.4.2 After this review the findings may identify areas needing improvement.
- 10.4.3 A copy of the audit and any areas identified, as needing improvement will be forwarded to the Contractor's senior management.
- 10.4.4 For findings that indicate major loss potential or serious concerns about site safety, the areas identified as needing improvement and the overall performance may be reviewed by Fulton County's designated Representative. A written action plan to address the Contractor's performance issues may be developed.
- 10.4.5 Fulton County or designated Representative may meet the Contractor's senior management to discuss the findings, contract requirements, and their plans to address the findings.
- 10.4.6 The number and frequency of safety audits and site visits may be increased until improvements are noted.

## 11.0 SAFETY MEETINGS

- 11.1 The Contractor will conduct weekly safety meetings with all Contractor and Sub-Contractor employees on the site.

- 11.2 The Contractor will keep safety-meeting records that include meeting topic(s), outline of items discussed, and attendance and sign in sheet. At this meeting any accidents or audit findings and corrective actions from the previous week will be discussed.
- 11.3 The Contractor will maintain a job site file that contains copies of the safety meeting records.

## 12.0 TRAINING, INSPECTION AND CERTIFICATION

### 12.1 Employee Training

- 12.1.1 The Contractor must be able to show when requested the required safety training for all Contractor and Sub-Contractor employees and competent persons working on the site including any required craft training.
- 12.1.2 The Contractor must be able to show when requested that all employees operating mobile equipment or cranes have met or exceeded training and licensing requirements.
- 12.1.3 The Contractor must be able to show when requested that all scaffolds are erected under the direction of a competent scaffold builder, that all users are properly trained, and that the scaffold is inspected daily.
- 12.1.4 The Contractor shall ensure that each employee is properly trained in the recognition and avoidance of unsafe conditions and the regulations applicable to his or her work environment to control or eliminate any hazards or other exposure to illness or injury.
- 12.1.5 If Contractor or Sub-Contractor employs anyone who cannot effectively communicate using the English language, a translator must be maintained on site who can relay instructions, questions, or concerns in a manner that the non-English and English-speaking employees will understand. The identification of this translator shall be provided to Fulton County's designated Representative.
- 12.1.6 Contractor shall orient all supervision and employees concerning safety requirements before working on the project site.

### 12.2 Equipment Certification and Inspection

- 12.2.1 The Contractor must be able to document that all cranes and mobile equipment used on the job site have current inspections and certifications.
- 12.2.2 The Contractor must assure that required daily and weekly equipment inspections are performed and documented in writing per governmental regulations and the requirements of this policy.
- 12.2.3 The Contractor must maintain a job site file for these required inspections and certifications.
- 12.2.4 Equipment identified as having safety problems or not meeting standards or codes shall be tagged as defective and shall not be used until those identified items have been corrected.
- 12.2.5 Contractor shall maintain, and have available for viewing, safety inspection reports for ladder, electrical cords, scaffolds, and trenches/excavations.

## 13.0 SAFETY AND HEALTH PROGRAM ELEMENTS

Note: Based on the project work activities and scope of work, some program elements may be not applicable to the project work and therefore do not have to be implemented. Elements marked with an asterisk are applicable to all Projects.

### 13.1 Return to Work Policy\*

The Contractor and each Sub-Contractor will be required to establish a transitional work program for employees injured at work, which provides modified duty within the employee's physical limitations.

### 13.2 Fire Prevention Program\*

The Contractor and each Sub-Contractor will be required to submit a temporary fire protection plan to be in effect for the duration of the contract. This plan must be submitted as part of the Contractor's Safety Program submittal. It must include provisions for fire protection systems and equipment, as identified in OSHA Safety and Health for Construction 1926, Sub-Part F, Fire Protection and Prevention.

### 13.3 Hazard Communication (HAZCOM)\*

The Contractor and each Sub-Contractor shall have a written HAZCOM Program. The program shall meet OSHA 1926 Requirements and provide for training so that all employees will be able to:

- Understand the program and identify hazardous chemicals with which they work.
- Understand product-warning labels.
- Have MSDSs for all potentially hazardous materials brought onto, used on, or stored at the job site.
- Know the physical location of the Material Safety Data Sheets (MSDS).

### 13.4 Personal Protective Equipment(PPE)\*

All Contractor and Sub-Contractor employees and other site visitors will be required to wear the PPE necessary to accomplish the work in a safe manner. PPE required will vary from job to job and must be based on a written hazard assessment. A list of PPE that is required is identified below:

- Hard Hats shall be worn at all times on all projects
- Hearing Protection for operations that create noise in excess of 85 dBA is required.
- Contractor shall provide eye or face protection equipment when machines or operations present potential eye or face injury from physical, chemical, or radiation agents.
- Work boots or work shoes made of leather shall be required. No open toed shoes or canvas shoes are allowed
- Shirts with sleeves at least 4 inches long are required. Tank tops and mesh shirt are not allowed.
- Full Body Safety Harnesses with shock absorbing lanyards for fall protection are required.
- Full body and chemical splash protection is required when handling hazardous chemicals.
- Respirators are required when employees maybe exposed to dust and/or chemicals in excess of the OSHA permissible exposure limits.
- Long pants are required.

### 13.5 Confined Space Entry

If the project work involves permit required confined spaces, a permit required confined space entry program that meets OSHA requirements must be established. This program must include but is not limited to the following elements.

- Confined Space Identification
- Environmental Testing
- Rescue
- Communication with employees in the confined space
- Employee Training
- Permit System for entry

### 13.6 Excavations

If the Contractor or Sub-Contractor must make a cut, cavity, trench or depression in an earth surface formed by earth removal, the work must comply with the OSHA Regulations on trenching and excavations. A competent person must be assigned for each excavation. Requirements include but are not limited to

- Employee Training
- Daily inspections
- Soil testing
- Protective or support systems.

### 13.7 Electrical Tools, Equipment, and Systems\*

- The Contractor and each Sub-Contractor must implement Assured Grounding Program or use Ground Fault Circuit Interrupter (GFCI) devices on all electrical tools and extension cords.
- All electrical work must be performed in accordance with the National Electrical Code (NEC) and OSHA.
- All electrical tools and extension cords must be in good repair and the Contractor must establish a written inspection program for all electrical tools. The frequency of inspection shall be at least monthly.

### 13.8 Lockout/Tagout Procedure

The Contractor and each Sub-Contractor will be required to implement a written Lockout/Tag procedure that meets OSHA requirements if their work requires energy isolation. Program elements include but are not limited to the following:

- Energy isolation lists for each piece of equipment
- Employee training
- Individually keyed locks and danger tags
- Written Procedure that assigns responsibilities

### 13.9 Fall Protection\*

Contractor shall provide an approved fall protection system for all employees working at an elevation of 6 feet or higher on this project, including scaffolding work and steel erection. Employees will be responsible for utilizing the fall protection 100% of the time. Sub-Contractor will be responsible for ascertaining their employees' compliance with this requirement. The plan must address the following items:

- Only full body harnesses with shock absorbing lanyards and double locking hooks shall be use.
- Falls should be limited to less than 6 feet such than employee can neither fall more than 6 feet nor contact any lower level.
- Fall protection systems must be planned into the job and must be designed to handle loads and forces expected. The project goal is 100% fall protection.
- Employee training and enforcement of these requirements are mandatory to assure an effective program.

#### 13.10 Scaffolding\*

All scaffolds and work platforms shall be constructed to meet the requirements of OSHA 1926.451 and ANSI A10.8. Some program elements include but are not limited to

- User training for all employees who may use scaffolds
- Scaffolding is to be designed and erected by competent person(s) following manufacturer's guidelines. Employees must use fall protection when erecting scaffolding.
- Daily inspection by competent person. Must implement daily tag system to document inspection.
- Must have engineering approval for scaffolds above 100 feet in height.
- Must be able to document competent person credentials.
- Scaffolds must have proper egress (ladder/stairs) and should have guardrails, complete deck, toe boards and netting if anything can fall on people below. If guardrails or decking is not complete, fall protection must be used.

#### 13.11 Cranes And Other Lifting Devices

- Trained and experienced operators shall operate Cranes in accordance with the applicable OSHA and ANSI/ASME.
- The Contractor is responsible for ensuring that the crane is properly sized for the job and that all required inspections and maintenance required by OSHA and ANSI/ASME standards have been conducted.
- All cranes should have anti-two block devices installed and operational. Cranes lifting employees in personnel baskets must have an anti-two block device to stops the crane if this condition occurs (positive acting).
- Tag lines are required to secure materials while being moved or handled by cranes.
- All cranes working in the vicinity of overhead power lines shall be grounded and be equipped with proximity guards.
- A lift plan must be submitted for all lifts that exceed 20,000 pounds or 75% of the crane's lift capacity. This plan must be reviewed and approved by the Contractor.
- Slings, hooks, and other lifting devices must be inspected on regular basis and stored properly.

#### 13.12 Use Of Personnel Baskets

- Personnel baskets should only be used as the last practical means after documenting that all other means are unacceptable.
- The personnel basket must be manufactured, tested, and used in accordance with OSHA 1926.550. The crane lifting the basket must also meet OSHA requirements.

#### 13.13 Personal Lifts With Articulating Booms (Jlg) And Scissors Lifts

- Operators must be trained in the safe operation of the lift including daily inspection procedures prior to use.
- Operators of JLG lifts must wear a full body harness with shock absorbing lanyard and be tied off while the lift is operation. Operators in a scissors lift must use fall protection anytime the guardrail system removed or altered.

#### 13.14 Ladders\*

- Ladders are acceptable means of access when used in compliance with OSHA 1926.1053.
- Ladders must be in good repair, have safety feet and be inspected.
- Extension ladders must be either held by an employee on the ground or tied off at the top.
- Homemade ladders not meeting OSHA requirements should not be used.
- Non-conducting ladders are required for electrical work.
- Fall protection is encouraged for employees working on ladders especially if they will be leaning and turning in their work activities.

#### 13.15 Tools And Equipment\*

All tools and equipment used on the project must be in a safe operating condition, with all guards in place, and must meet or exceed all governmental regulations (OSHA, EPA, DOT, etc.). Tools and equipment must be maintained, inspected, tested, and used in accordance with OSHA regulations.

#### 13.16 Compressed Gas Cylinders\*

- Compressed gas cylinders must be used, stored, and transported in accordance with OSHA requirements, DOT requirements, and Compressed Gas Association standards.
- Fuel and oxygen cylinders must be store separately or separated by a ½ hour rated firewall.
- Compressed gas cylinders are not allowed inside confined spaces.

#### 13.17 Welding, Burning, And Cutting\*

- The Contractor's program must meet or exceed OSHA and NFPA requirements.
- All flammables must be removed from work area and a fire watch posted in area until 30 minutes after the job is completed.
- At a minimum a 10 LB ABC rated fire extinguisher must be available in the immediate work area.
- Regulators must be in good working order and must have anti-flash back and check valves.
- Welding shields and burning goggles must be used.

#### 13.18 Sanitation And Housekeeping\*

- The project site shall have an adequate number of portable toilets and hand washing facilities.
- The project site must establish a housekeeping plan that includes daily site clean up and trash and debris removal.

13.19 Hearing Conservation\*

The Contractor and each Sub-Contractor who has employees exposed to noise levels exceeding 85 dBA must establish a hearing conservation program that meets or exceeds OSHA requirements. Minimum program elements include audiometric testing, noise monitoring, use of hearing protectors, and employee training.

13.20 Respiratory Protection

The Contractor and each Sub-Contractor who has employees who wear respiratory protection must implement a respiratory protection program that meets or exceeds OSHA requirements. Minimum program elements include risk based respirator selection, medical surveillance, employee training, respirator fit testing, and written operating procedures.

14.0 SPECIALIZED SAFETY PROGRAM ELEMENTS

If required by the project scope of work and specific work site or activities, specialized programs listed below shall be included in the Contractor's Safety Program submittal. The Contractor is required to implement the required programs and assure that they meet or exceed all contractual, regulatory and Fulton County's requirements applicable. Details for specific program elements may be included in the contract documents.

- 14.1 Asbestos Removal
- 14.2 Lead Based Paint Removal
- 14.3 Exposure Assessment and Employee Monitoring (Industrial Hygiene)
- 14.4 Hazardous Waste Operations and Training
- 14.5 Overhead Power Lines
- 14.6 Locating underground utilities
- 14.7 Dust Control
- 14.8 Guarding for floor holes and roof openings
- 14.9 Heavy Equipment, Truck and Earth Moving Equipment requirements
- 14.10 Environmental Requirements

15.0 ROAD AND TRANSPORTATION SAFETY REQUIREMENTS

The Contractor shall implement the following into its safety program whether required by the contract or any other authority having jurisdiction if required to perform the work and maintain vehicular and pedestrian traffic safety:

- 15.1 Barricades and Cones
- 15.2 Traffic and Warning Signs
- 15.3 Traffic control devices
- 15.4 Equipment and materials storage
- 15.5 Reflective Clothing and other personal protective equipment
- 15.6 Excavation and road hole protection
- 15.7 Erosion protection
- 15.8 Trained flaggers

16.0 ADDITIONAL REQUIREMENTS TO PROTECT THE GENERAL PUBLIC

Based on the Contractor's scope of work and specific work activities or location the Contractor may be required to implement the following into its safety program to protect the general public:

- 16.1 Fencing and other measures for site security
- 16.2 Warning, direction and no trespassing signs
- 16.3 Alternate public walk ways
- 16.4 Protection of the public from over head and other construction hazards
- 16.5 Site Traffic Control
- 16.6 Barricading off hazardous areas and open pits and holes



## **EXHIBIT C**

### **CONTRACTOR SAFETY AND HEALTH MANAGEMENT PROCESS**

### SAFETY POLICY STATEMENT

It is the policy of Fulton County to establish a comprehensive accident and loss prevention process for all Capital Projects implemented by Fulton County or its agents.

The goals of this comprehensive accident and loss prevention process are as follows:

- To prevent personal injury, property damage, and injury to the public.
- To implement safety and loss prevention processes as critical elements in the complete design and build process.
- To establish a proactive safety and health process that complies with all laws, regulations, consensus standards, and good management practices.
- To have the Contractors partner with Fulton County in the implementation of a Safety and Loss Prevention Process Program to minimize loss potential and to minimize risk.

Fulton County requires safety, health and loss prevention requirements and expectations to be included in project design, in the invitation to bid, in bid award and project meetings, and in the post job evaluations. The Contractor is required to develop and submit a project safety and health program for acceptance by Fulton County prior to Notice to Proceed. The Contractor is required to implement these requirements, and develop a management system to ensure compliance following the safety and health process outlined in this document and the bid documents.

The Contractor and other entities placed under contract with Fulton County will be obligated to implement, adhere to and enforce this Policy. The safety and health of the Contractor's employees, Sub-Contractors, and the public are the sole responsibility of the Contractor. The County may use and direct designated Representatives to implement and enforce this policy. **Failure of the Contractor to comply with this policy or any Safety related obligations may be grounds for contract termination.**

Fulton County's designated Representative will periodically inspect all Fulton County construction projects to identify safety hazards and make recommendations to resolve the issues. Contractor will be responsible for abating the identified issues in a timely manner, and submitting written description of corrective action within 48 hours to Fulton County designated Representatives. Failure to bring timely resolution to the issues may result in work stoppage at Contractor's expense.

Prior to commencing work under this contract, Contractor's Project Manager and Project Superintendent shall attend a Pre-Construction Meeting and Safety Pre-Planning meeting to address safety issues/requirements.

\*\*\*\*\*

## CONTRACTOR SAFETY AND HEALTH MANAGEMENT PROCESS

### 1.0 NOT USED

### 2.0 REFERENCES

- 2.1 Occupational Safety and Health Regulations (OSHA) 29CFR1910 and 29CFR1926
- 2.2 Environmental Protection Agency Regulations (EPA) 40CFR
- 2.3 Fulton County Safety and Health and Requirements
- 2.4 Georgia Department of Transportation Regulations and Requirements
- 2.5 US Department of Transportation Requirements
- 2.6 Manual of Uniform Traffic Control Devices for Streets and Highways (ANSI D6.1)
- 2.7 Georgia Department of Natural Resources Environmental Protection Division Regulations

Safety rules and regulations will be followed using federal, state or local regulations in force. Should a Contractor's rule be in use which is more effective, the most stringent rule or regulation will be enforced by the Contractor, Sub-Contractor's and Fulton County designated Safety Representative(s).

### 3.0 RESPONSIBILITY

The Contractor receiving the bid has the ultimate responsibility for the safety and health of all Sub-Contractors, all employees on the project, and the general public and complying with all governmental regulations and requirements (OSHA, EPA, DOT, state, local). Nothing contained herein shall relieve the Contractor or any Sub-Contractor of such responsibility or liability.

### 4.0 PROCEDURE

- 4.1 The Contractor and each Sub-Contractor must implement a written safety and health prevention process and program following the guidelines contained in this document and in any other relevant portion of the Contract Documents. This program must be accepted by Fulton County or its Representatives prior to Notice to Proceed.
- 4.2 The Contractor and each Sub-Contractor must implement a drug and alcohol policy following the guidelines contained in this document and in the bid specific actions. This program must be accepted by Fulton County or its Representatives prior to Notice to Proceed.
- 4.3 The Contractor must designate a person responsible for site safety. Each Sub-Contractor must designate a person responsible for site safety.
- 4.4 Not Used.
- 4.5 Contractor is responsible for providing all necessary safety supplies and personal protective equipment required to protect its employees, Sub-Contractors, and the general public.
- 4.6 Contractor shall make available certified First-aid services, First-aid supplies, and provisions for medical care for all employees at the construction site prior to beginning work on site.
- 4.7 Contractor shall maintain a competent person at the construction site at all times with an OSHA 10-hour certification. Said person shall have the knowledge to recognize hazards or potential hazards and has the authority to correct such hazards.
- 4.8 The status of project safety shall be included in the Contractor's agenda, which is required in Progress Meetings.

## 5.0 DRUG AND ALCOHOL POLICY

The Contractor and each Sub-Contractor must implement a drug and alcohol policy in order to maintain a safe and efficient work environment. This policy must include the following elements.

1. Written policy that prohibits the use, transportation, sale and possession of these materials.
2. Disciplinary action plan for violations
3. Any treatment or reinstatement/reemployment options
4. Drug and alcohol testing schedule that includes pre-employment, periodic for safety sensitive or critical jobs, and for cause

Note: AGC, ABC and/or Fulton County programs may be used as guidance documents.

## 6.0 OTHER CONTROLLED ITEMS

The Contractor and each Sub-Contractor is required to include in the Project Safety Program a prohibition against the use, possession, concealment, transportation, promotion or sale of the following controlled items

1. Firearms, weapons, and ammunition.
2. Switchblades
3. Unauthorized explosives including fireworks
4. Stolen property or contraband
5. Controlled chemicals or chemicals recognized as being able to be used for improper purposes.

## 7.0 EMERGENCY PROCEDURES/GUIDELINES

7.1 The Contractor is required to establish site specific emergency procedures in the Project Safety Program to manage emergencies that may occur at any time in the following categories:

1. Fire
2. Employee injury
3. Pedestrian injury due to work activity of any kind
4. Property damage and damage to various utilities (i.e., electrical, gas, sewerage, water, telephone or public roadways)
5. Public demonstrations
6. Bomb threats
7. Flood, Wind, Lightening, Hail
8. Terrorists Threats
9. Work place violence

7.2 These Emergency Procedures will be made part of the Contractor's Project Safety Program submittal and shall include but not be limited to the following elements:

1. A list of emergency phone numbers posted at the job site, along with information to be transmitted in such emergencies.
2. An incident command structure defining duties and responsibilities
3. A system to train supervisors and employees on this emergency plan
4. Procedures on how to handle emergencies including access to the site by emergency responders, accounting for workers, and securing the area.
5. Procedures for media releases. These releases must be coordinated through the Fulton County Information and Public Affairs Office in coordination with the County's designated Representative.
6. A plan that addresses serious incidents that includes notification to Fulton County, Fulton County's designated Representative immediately after the incident.

7. A review and updating frequency that includes forwarding a copy to Fulton County
8. and the County's designated Representative.

## 8.0 ACCIDENT AND INCIDENT INVESTIGATION AND REPORTING

- 8.1 The Contractor is responsible for reporting all accidents and incidents on the project site to the County's designated Representative within (1) business day. Accidents or incidents resulting in a fatality, property loss in excess of \$5,000, or involvement with the general public must be reported immediately to Fulton County's designated Representative and the investigation of the accident or incident coordinated with Fulton County Safety staff.
- 8.2 The Contractor will maintain a log of all injuries that occur on the job site. This log will be current and available for review.
- 8.3 For any incidents such as fires, explosions, fatalities, etc., the Contractor must notify Fulton County's designated Representative immediately and must coordinate any releases to the news media through the County's designated Representative and the County's Information and Public Affairs Office.
- 8.4 If a work-related injury should occur on this project, Contractor shall perform a thorough investigation of the incident and document the information.
- 8.5 A written accident investigation report containing the following information as a minimum must be forwarded to the Fulton County's designated Representative within 24 hours of incident.
  1. Company Name
  2. Location
  3. Date and Time of incident
  4. Description of incident
  5. Names of all parties involved and all witnesses
  6. Corrective action(s) taken to prevent recurrence
  7. If the incident involves injury or illness, the following information must be provided:
    - a) A medical description of the injury or illness
    - b) OSHA recordability status i.e. first aid, medical treatment, lost time, days of restricted work.
    - c) If the public is involved, information about treatment and treatment location.
  8. Any pictures, site drawings, etc. if they assist in describing the incident.

If the investigation cannot be completed in 24 hours, a preliminary report marked as such shall be forwarded and the report completed and forwarded as soon as possible.

## 9.0 JOB SAFETY ANALYSIS

- 9.1 The Contractor and each Sub-Contractor must implement a procedure to conduct a written job safety analysis or job hazard analysis for all project work tasks prior to beginning each task. Reference Appendix A.
- 9.2 The job safety analysis should follow National Safety Council, AGC, or other recognized guidelines and address all safety and health hazards for the work, identify personal protective and other safety equipment required, identify potential hazards to the general public if applicable, and identify any safety equipment, training, or controls that must be implemented prior to starting the work.

- 9.3 The Contractor must maintain a file for all job safety analysis forms, which is accessible for review.

## 10.0 SAFETY AND HEALTH COMPLIANCE AUDITING

### 10.1 Self Auditing Requirements

- 10.1.1 The Contractor and each Sub-Contractor must implement a procedure to assure that written safety and health audits or inspections are conducted at least biweekly (every 2 weeks). Safety checklists used by Fulton County's designated Representative may be used. The Contractor may use this checklist or an equivalent approved by Fulton County's designated Representative.
- 10.1.2 Each written safety audit must be filed on the site and a copy forwarded to Fulton County designated Representative.

### 10.2 NOT USED

### 10.3 INSPECTIONS BY REGULATORY AGENCIES

- 10.3.1 The Contractor must notify the Fulton County designated Representative whenever an OSHA compliance officer, health inspector, or EPA or Georgia Environmental Protection Division Representative arrives at the project site to conduct an inspection.
- 10.3.2 The Contractor is required to forward a copy of all regulatory citations, notice of violations, or similar for this project to Fulton County's designated Representative.
- 10.3.3 These records will be reviewed with Fulton County designated Representative and included in the Construction Project files.

### 10.4 SAFETY INSPECTION AND AUDIT FOLLOW UP

- 10.4.1 Every safety audit or regulatory inspection conducted per the requirements above may be reviewed by the Fulton County designated Representative. This review may identify serious and repeat safety items, look at trends, identify risks and potential losses, and site safety and loss prevention activities.
- 10.4.2 After this review the findings may identify areas needing improvement.
- 10.4.3 A copy of the audit and any areas identified, as needing improvement will be forwarded to the Contractor's senior management.
- 10.4.4 For findings that indicate major loss potential or serious concerns about site safety, the areas identified as needing improvement and the overall performance may be reviewed by Fulton County's designated Representative. A written action plan to address the Contractor's performance issues may be developed.
- 10.4.5 Fulton County or designated Representative may meet the Contractor's senior management to discuss the findings, contract requirements, and their plans to address the findings.
- 10.4.6 The number and frequency of safety audits and site visits may be increased until improvements are noted.

## 11.0 SAFETY MEETINGS

- 11.1 The Contractor will conduct weekly safety meetings with all Contractor and Sub-Contractor employees on the site.

- 11.2 The Contractor will keep safety-meeting records that include meeting topic(s), outline of items discussed, and attendance and sign in sheet. At this meeting any accidents or audit findings and corrective actions from the previous week will be discussed.
- 11.3 The Contractor will maintain a job site file that contains copies of the safety meeting records.

## 12.0 TRAINING, INSPECTION AND CERTIFICATION

### 12.1 Employee Training

- 12.1.1 The Contractor must be able to show when requested the required safety training for all Contractor and Sub-Contractor employees and competent persons working on the site including any required craft training.
- 12.1.2 The Contractor must be able to show when requested that all employees operating mobile equipment or cranes have met or exceeded training and licensing requirements.
- 12.1.3 The Contractor must be able to show when requested that all scaffolds are erected under the direction of a competent scaffold builder, that all users are properly trained, and that the scaffold is inspected daily.
- 12.1.4 The Contractor shall ensure that each employee is properly trained in the recognition and avoidance of unsafe conditions and the regulations applicable to his or her work environment to control or eliminate any hazards or other exposure to illness or injury.
- 12.1.5 If Contractor or Sub-Contractor employs anyone who cannot effectively communicate using the English language, a translator must be maintained on site who can relay instructions, questions, or concerns in a manner that the non-English and English-speaking employees will understand. The identification of this translator shall be provided to Fulton County's designated Representative.
- 12.1.6 Contractor shall orient all supervision and employees concerning safety requirements before working on the project site.

### 12.2 Equipment Certification and Inspection

- 12.2.1 The Contractor must be able to document that all cranes and mobile equipment used on the job site have current inspections and certifications.
- 12.2.2 The Contractor must assure that required daily and weekly equipment inspections are performed and documented in writing per governmental regulations and the requirements of this policy.
- 12.2.3 The Contractor must maintain a job site file for these required inspections and certifications.
- 12.2.4 Equipment identified as having safety problems or not meeting standards or codes shall be tagged as defective and shall not be used until those identified items have been corrected.
- 12.2.5 Contractor shall maintain, and have available for viewing, safety inspection reports for ladder, electrical cords, scaffolds, and trenches/excavations.

## 13.0 SAFETY AND HEALTH PROGRAM ELEMENTS

Note: Based on the project work activities and scope of work, some program elements may be not applicable to the project work and therefore do not have to be implemented. Elements marked with an asterisk are applicable to all Projects.

### 13.1 Return to Work Policy\*

The Contractor and each Sub-Contractor will be required to establish a transitional work program for employees injured at work, which provides modified duty within the employee's physical limitations.

### 13.2 Fire Prevention Program\*

The Contractor and each Sub-Contractor will be required to submit a temporary fire protection plan to be in effect for the duration of the contract. This plan must be submitted as part of the Contractor's Safety Program submittal. It must include provisions for fire protection systems and equipment, as identified in OSHA Safety and Health for Construction 1926, Sub-Part F, Fire Protection and Prevention.

### 13.3 Hazard Communication (HAZCOM)\*

The Contractor and each Sub-Contractor shall have a written HAZCOM Program. The program shall meet OSHA 1926 Requirements and provide for training so that all employees will be able to:

- Understand the program and identify hazardous chemicals with which they work.
- Understand product-warning labels.
- Have MSDSs for all potentially hazardous materials brought onto, used on, or stored at the job site.
- Know the physical location of the Material Safety Data Sheets (MSDS).

### 13.4 Personal Protective Equipment(PPE)\*

All Contractor and Sub-Contractor employees and other site visitors will be required to wear the PPE necessary to accomplish the work in a safe manner. PPE required will vary from job to job and must be based on a written hazard assessment. A list of PPE that is required is identified below:

- Hard Hats shall be worn at all times on all projects
- Hearing Protection for operations that create noise in excess of 85 dBA is required.
- Contractor shall provide eye or face protection equipment when machines or operations present potential eye or face injury from physical, chemical, or radiation agents.
- Work boots or work shoes made of leather shall be required. No open toed shoes or canvas shoes are allowed
- Shirts with sleeves at least 4 inches long are required. Tank tops and mesh shirt are not allowed.
- Full Body Safety Harnesses with shock absorbing lanyards for fall protection are required.
- Full body and chemical splash protection is required when handling hazardous chemicals.
- Respirators are required when employees maybe exposed to dust and/or chemicals in excess of the OSHA permissible exposure limits.
- Long pants are required.

### 13.5 Confined Space Entry

If the project work involves permit required confined spaces, a permit required confined space entry program that meets OSHA requirements must be established. This program must include but is not limited to the following elements.

- Confined Space Identification
- Environmental Testing
- Rescue
- Communication with employees in the confined space
- Employee Training
- Permit System for entry

### 13.6 Excavations

If the Contractor or Sub-Contractor must make a cut, cavity, trench or depression in an earth surface formed by earth removal, the work must comply with the OSHA Regulations on trenching and excavations. A competent person must be assigned for each excavation. Requirements include but are not limited to

- Employee Training
- Daily inspections
- Soil testing
- Protective or support systems.

### 13.7 Electrical Tools, Equipment, and Systems\*

- The Contractor and each Sub-Contractor must implement Assured Grounding Program or use Ground Fault Circuit Interrupter (GFCI) devices on all electrical tools and extension cords.
- All electrical work must be performed in accordance with the National Electrical Code (NEC) and OSHA.
- All electrical tools and extension cords must be in good repair and the Contractor must establish a written inspection program for all electrical tools. The frequency of inspection shall be at least monthly.

### 13.8 Lockout/Tagout Procedure

The Contractor and each Sub-Contractor will be required to implement a written Lockout/Tag procedure that meets OSHA requirements if their work requires energy isolation. Program elements include but are not limited to the following:

- Energy isolation lists for each piece of equipment
- Employee training
- Individually keyed locks and danger tags
- Written Procedure that assigns responsibilities

### 13.9 Fall Protection\*

Contractor shall provide an approved fall protection system for all employees working at an elevation of 6 feet or higher on this project, including scaffolding work and steel erection. Employees will be responsible for utilizing the fall protection 100% of the time. Sub-Contractor will be responsible for ascertaining their employees' compliance with this requirement. The plan must address the following items:

- Only full body harnesses with shock absorbing lanyards and double locking hooks shall be use.
- Falls should be limited to less than 6 feet such than employee can neither fall more than 6 feet nor contact any lower level.
- Fall protection systems must be planned into the job and must be designed to handle loads and forces expected. The project goal is 100% fall protection.
- Employee training and enforcement of these requirements are mandatory to assure an effective program.

#### 13.10 Scaffolding\*

All scaffolds and work platforms shall be constructed to meet the requirements of OSHA 1926.451 and ANSI A10.8. Some program elements include but are not limited to

- User training for all employees who may use scaffolds
- Scaffolding is to be designed and erected by competent person(s) following manufacturer's guidelines. Employees must use fall protection when erecting scaffolding.
- Daily inspection by competent person. Must implement daily tag system to document inspection.
- Must have engineering approval for scaffolds above 100 feet in height.
- Must be able to document competent person credentials.
- Scaffolds must have proper egress (ladder/stairs) and should have guardrails, complete deck, toe boards and netting if anything can fall on people below. If guardrails or decking is not complete, fall protection must be used.

#### 13.11 Cranes And Other Lifting Devices

- Trained and experienced operators shall operate Cranes in accordance with the applicable OSHA and ANSI/ASME.
- The Contractor is responsible for ensuring that the crane is properly sized for the job and that all required inspections and maintenance required by OSHA and ANSI/ASME standards have been conducted.
- All cranes should have anti-two block devices installed and operational. Cranes lifting employees in personnel baskets must have an anti-two block device to stops the crane if this condition occurs (positive acting).
- Tag lines are required to secure materials while being moved or handled by cranes.
- All cranes working in the vicinity of overhead power lines shall be grounded and be equipped with proximity guards.
- A lift plan must be submitted for all lifts that exceed 20,000 pounds or 75% of the crane's lift capacity. This plan must be reviewed and approved by the Contractor.
- Slings, hooks, and other lifting devices must be inspected on regular basis and stored properly.

#### 13.12 Use Of Personnel Baskets

- Personnel baskets should only be used as the last practical means after documenting that all other means are unacceptable.
- The personnel basket must be manufactured, tested, and used in accordance with OSHA 1926.550. The crane lifting the basket must also meet OSHA requirements.

#### 13.13 Personal Lifts With Articulating Booms (Jlg) And Scissors Lifts

- Operators must be trained in the safe operation of the lift including daily inspection procedures prior to use.
- Operators of JLG lifts must wear a full body harness with shock absorbing lanyard and be tied off while the lift is operation. Operators in a scissors lift must use fall protection anytime the guardrail system removed or altered.

#### 13.14 Ladders\*

- Ladders are acceptable means of access when used in compliance with OSHA 1926.1053.
- Ladders must be in good repair, have safety feet and be inspected.
- Extension ladders must be either held by an employee on the ground or tied off at the top.
- Homemade ladders not meeting OSHA requirements should not be used.
- Non-conducting ladders are required for electrical work.
- Fall protection is encouraged for employees working on ladders especially if they will be leaning and turning in their work activities.

#### 13.15 Tools And Equipment\*

All tools and equipment used on the project must be in a safe operating condition, with all guards in place, and must meet or exceed all governmental regulations (OSHA, EPA, DOT, etc.). Tools and equipment must be maintained, inspected, tested, and used in accordance with OSHA regulations.

#### 13.16 Compressed Gas Cylinders\*

- Compressed gas cylinders must be used, stored, and transported in accordance with OSHA requirements, DOT requirements, and Compressed Gas Association standards.
- Fuel and oxygen cylinders must be store separately or separated by a ½ hour rated firewall.
- Compressed gas cylinders are not allowed inside confined spaces.

#### 13.17 Welding, Burning, And Cutting\*

- The Contractor's program must meet or exceed OSHA and NFPA requirements.
- All flammables must be removed from work area and a fire watch posted in area until 30 minutes after the job is completed.
- At a minimum a 10 LB ABC rated fire extinguisher must be available in the immediate work area.
- Regulators must be in good working order and must have anti-flash back and check valves.
- Welding shields and burning goggles must be used.

#### 13.18 Sanitation And Housekeeping\*

- The project site shall have an adequate number of portable toilets and hand washing facilities.
- The project site must establish a housekeeping plan that includes daily site clean up and trash and debris removal.

13.19 Hearing Conservation\*

The Contractor and each Sub-Contractor who has employees exposed to noise levels exceeding 85 dBA must establish a hearing conservation program that meets or exceeds OSHA requirements. Minimum program elements include audiometric testing, noise monitoring, use of hearing protectors, and employee training.

13.20 Respiratory Protection

The Contractor and each Sub-Contractor who has employees who wear respiratory protection must implement a respiratory protection program that meets or exceeds OSHA requirements. Minimum program elements include risk based respirator selection, medical surveillance, employee training, respirator fit testing, and written operating procedures.

14.0 SPECIALIZED SAFETY PROGRAM ELEMENTS

If required by the project scope of work and specific work site or activities, specialized programs listed below shall be included in the Contractor's Safety Program submittal. The Contractor is required to implement the required programs and assure that they meet or exceed all contractual, regulatory and Fulton County's requirements applicable. Details for specific program elements may be included in the contract documents.

- 14.1 Asbestos Removal
- 14.2 Lead Based Paint Removal
- 14.3 Exposure Assessment and Employee Monitoring (Industrial Hygiene)
- 14.4 Hazardous Waste Operations and Training
- 14.5 Overhead Power Lines
- 14.6 Locating underground utilities
- 14.7 Dust Control
- 14.8 Guarding for floor holes and roof openings
- 14.9 Heavy Equipment, Truck and Earth Moving Equipment requirements
- 14.10 Environmental Requirements

15.0 ROAD AND TRANSPORTATION SAFETY REQUIREMENTS

The Contractor shall implement the following into its safety program whether required by the contract or any other authority having jurisdiction if required to perform the work and maintain vehicular and pedestrian traffic safety:

- 15.1 Barricades and Cones
- 15.2 Traffic and Warning Signs
- 15.3 Traffic control devices
- 15.4 Equipment and materials storage
- 15.5 Reflective Clothing and other personal protective equipment
- 15.6 Excavation and road hole protection
- 15.7 Erosion protection
- 15.8 Trained flaggers

16.0 ADDITIONAL REQUIREMENTS TO PROTECT THE GENERAL PUBLIC

Based on the Contractor's scope of work and specific work activities or location the Contractor may be required to implement the following into its safety program to protect the general public:

- 16.1 Fencing and other measures for site security
- 16.2 Warning, direction and no trespassing signs
- 16.3 Alternate public walk ways
- 16.4 Protection of the public from over head and other construction hazards
- 16.5 Site Traffic Control
- 16.6 Barricading off hazardous areas and open pits and holes



**SECTION 12**  
**APPENDICES**

### Appendix A

## Job Safety Analysis Worksheet Example and Information

### Job Safety Analysis/Job Pre-Planning Worksheet

<b>Job Name and #:</b>		<b>Completed By:</b>	
<b>Date:</b>		<b>Phase/Operation:</b>	
<b>Task</b>	<b>Hazard</b>	<b>Control</b>	

**PRE-OPERATIONAL PLANNING**  
**FACT FINDING GUIDE - GL**

**I. Evaluate present conditions at job site to determine items that could lead to liability claims during work and after completion of the project.**

**A. PRESENT OCCUPANCY OR USE OF THE SITE**

- Demolition to be done?
- Structures will remain (condition)?

**B. HISTORY OF THE SITE**

- For what was the site used before?
- Underground tanks?
- Underground utilities?

**C. GEOLOGY OF THE SITE**

- Rock to be blasted?
- Water to be removed/diverted?
- Fill needed? (where and how obtained?)
- Excavation needed? (where and how disposed of?)

**II. Evaluate controls needed in reference to site security and public protection.**

**A. FENCING NEEDED?**

**B. ACCESS/GATES**

- Can traffic be routed past office or checkpoint?
- "Non-Vendor" visitors escorted?
- Gate lockable after hours?

- "Hard Hat" signs at entrance?
- Dirt removal/tarping area at exit?
- Ready Mix chute wash area?

**C. PEDESTRIANS**

- Sidewalk maintained outside fence?
- Covered sidewalk needed?
- Special access requirements for neighboring occupants?
- Special after-hours considerations?

**D. ENVIRONMENTAL**

- Dust control?
- Silt control?
- Mud control on streets?
- Vibration control?

**E. UTILITIES**

- Underground utilities located?
- Overhead power lines in work area relocated, removed, or deenergized?
- Temporary power service away from high traffic areas?

**F. SUB-CONTRACTORS**

- Method to secure proof of adequate insurance coverage in place?
- List of hazardous materials obtained?
- List of hazardous materials provided?
- Responsibilities established

- Job site safety meetings
- Materials delivery
- Debris removal
- Access to site
- Weekly Sub-Contractors' meetings
- Schedule of safety inspections
- Emergency Procedures

**G. MATERIALS HANDLING**

- Crane selection criteria established
  - Maximum weight to be handled
  - Maximum lifting height
  - Maximum horizontal reach needed
  - Amount of travel needed
  - Swing radius available
  - Set-up area available
  - Ground bearing capacity
  - Approximate frequency of lifts
- Crane operations responsibilities established
  - Triangle or leasing company crane to be used?
  - Operator trained and experienced on specific machine?
  - Operator can accurately read and interpret machine load chart?
  - Critical lift identified (75% of net capacity)?
  - Machine fully inspected by a qualified outside agency?
  - Rigging hardware properly selected?
  - Inspecting and maintaining the crane per owner/manufacture specifications?

### III. Start Up.

#### A. ELECTRICAL

- Temporary Power
  - Underground service possible?
  - Maintenance responsibilities established?
  - Main circuit panel barricaded?
  - Lighting planned?
  
- Circuit Protection
  - Ground fault circuit interrupt protection?
  - Assured grounding conductor program?
  - Responsibilities established?

#### B. FIRE PROTECTION

- ABC extinguishers adequately distributed?
- Properly sized?
- Maintenance of fire extinguishers?
- Stand pipe/hydrant available? Adequate?
- Housekeeping checks/inspections?

#### C. FALL PROTECTION

- Critical Job Phases Identified?
  - Critical exposures identified by phase? (e.g. "Worker falls into basement excavation")
  - Scheduled start dates for critical phases?
  
- General Fall Protection Procedures
  - Perimeters

- Floor openings
- Working deck
- Work area access
- Ladders
- Elevator hatchways

**D. PERSONAL PROTECTIVE EQUIPMENT**

- General
  - Hard hats
  - Work shoes
- Specific by Task

**E. HAZARD COMMUNICATION PROGRAM ESTABLISHED AND EMPLOYEES TRAINED**

**F. CONFINED SPACE ENTRY**

- Procedures established and task(s) identified requiring use of procedures?

**G. TRENCHING**

- Procedures established and task(s) requiring procedures identified?

**H. PHASE PRE-PLANNING**

- Job schedules established?
- Agreed upon target dates for meeting?
- Follow up system

**END OF APPENDICES**



# RAYMOND

ENGINEERING

**ROOF SAMPLING AND ANALYSIS  
FULTON COUNTY JUSTICE CENTER TOWER  
185 CENTRAL AVENUE,  
ATLANTA, GEORGIA 30303**



**Prepared for:  
Ms. Michelle Cox  
Fulton County  
3977 Aviation Circle,  
Atlanta, Georgia 30336**

**March 26, 2015**

**Phil Pickens, E.I.T.**

**Anthony Dukes, P.E., R.R.O.**



## **1. Assignment**

- 1.1. Subject: Roof Openings and Condition Assessment
- 1.2. Location: 185 Central Avenue, Atlanta, Georgia
- 1.3. Purpose: At selected roof openings, examine roof composition, substrate conditions and retain limited samples of the roof system.
- 1.4. Date(s) of Services: March 26, 2015 and April 10, 2015

## **2. Scope of Services**

- 2.1. To visually inspect the materials removed at each opening measure thicknesses of insulation. Check the roof assembly with a Delmhorst meter to determine whether moisture is present at the openings.
- 2.2. To visually assess the condition of the existing roofing.
- 2.2 Prepare a report of findings.

## **3. Participating Personnel**

The following personnel were present during the inspection of the subject facility:

- 3.1. Mr. Phil Pickens, E.I.T., Raymond Engineering-Georgia, LLC
- 3.2. Mr. Anthony Dukes, P.E., R.R.O., Raymond Engineering-Georgia, LLC
- 3.3. Mr. Carson Finney, Ideal Building Solutions
- 3.4. Ms. Michelle Cox, Fulton County Government.

## **4. Field Inspections**

A visual inspection of eight roof openings was performed at the above referenced facility on March 26, 2015 to evaluate existing conditions. Our observations were as follows:

- 4.1. Three openings approximately, 2" x 2" to 4" x 4" were made at selected locations to evaluate the condition of the roof assembly. The membrane and insulation was retained for further examination. In general, the roof system consists of a single-ply membrane adhered to isocyanurate roof insulation over a concrete roof deck. The results were as follows:

- 4.1.1. Opening No. 1: Located on the main roof adjacent to the east parapet and south of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 2.5" thick isocyanurate and is dry to the touch. Delmorst reading of 10.5 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location. This sample was retained for the architect.
- 4.1.2. Opening No. 2: Located on the main roof near the ridge of one of the existing insulation crickets between the drains south of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 4.5" thick isocyanurate and is dry to the touch. Delmorst reading of 8.5 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location. This sample was retained for the architect.
- 4.1.3. Opening No. 3: Located on the main roof near the ridge north of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 8" thick isocyanurate and is dry to the touch. The 8" thick insulation is achieved through multiple layers of isocyanurate insulation. Delmorst reading of 9.3 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location.
- 4.1.4. Opening No. 4: Located on the main roof near an internal roof drain north of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 3.5" thick isocyanurate and is dry to the touch. The 3.5" thick insulation is achieved through multiple layers of isocyanurate insulation. Delmorst reading of 12.6 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location. This sample was retained for the architect.
- 4.1.5. Opening No. 5: Located on the main roof adjacent to the east parapet and north of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 2.5" thick isocyanurate and is dry to the touch. Delmorst reading of 6.4 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location.
- 4.1.6. Opening No. 6: Located on the upper roof housing the existing cooling tower south of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 2.5" thick isocyanurate and is dry to the touch. Delmorst reading of 8.0 on the

insulation indicated a sufficiently dry moisture level. Insulation was secured to the roof deck using fasteners and plates at this location.

- 4.1.7. Opening No. 7: Located on the main roof near the ridge south of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 7.5" thick isocyanurate and is dry to the touch. The 7.5" thick insulation is achieved through multiple layers of isocyanurate insulation. Delmorst reading of 5.7 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location.
- 4.1.8. Opening No. 8: Located on the main roof adjacent to the west parapet and south of the building expansion joint. Roof membrane is fully adhered to the insulation. Roof insulation is nominal 2.5" thick isocyanurate and is dry to the touch. Delmorst reading of 4.5 on the insulation indicated a sufficiently dry moisture level. Insulation was adhered to the roof deck at this location.

## 5. Condition Assessment

- 5.1. A visual inspection of the roofing was performed on April 10, 2015. Based on visual observations, previous roof cores, and the reported age of the roofing (20+ years), the existing roofing system at the Fulton County Justice Center Tower is in poor condition. There are several locations of water stained ceiling tiles along the main hall, and a roof leak diverter has been installed at one removed ceiling tile. The roofing membrane surfacing polymers and fillers have thinned leaving the scrim imprint more visible and exposed at isolated locations. Insulation fasteners and plates are reflected through the membrane at several locations. Rooftop units and condensation lines are rusted. At the roof access door, vegetation is growing on the roof between pavers. At the bellow-style expansion joint cover, splices have repairs with membrane. An Owner furnished infrared report from 2011 showed several locations of possible and probable water saturated roof insulation.
- 5.2. Based on the leak history, roof cores, visual observations, and the reported age of the roofing, the roof system at the facility has reached the end of its useful economic life and should be replaced at this time.

## 6. Closure

We trust that this report will assist you in analyzing your new roof design for this facility. If you should have any questions regarding the contents of this report or would like to discuss its contents in further detail, please do not hesitate to contact us directly. Additional photographs are on file and are available upon request.

Respectfully submitted,  
RAYMOND ENGINEERING-GEORGIA, LLC



Phillip Pickens, E.I.T.  
Staff Engineer




Anthony Dukes, P.E., R.R.O.  
Project Engineer



Photograph #	1	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Opening No. 1 depth. Thinned surfacing with scrim imprint visible.		
Address:	185 Central Avenue, Atlanta, Georgia		




Photograph #	2	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Opening No. 1 concrete deck, typical. Thinned surfacing with scrim imprint visible.		
Address:	185 Central Avenue, Atlanta, Georgia		

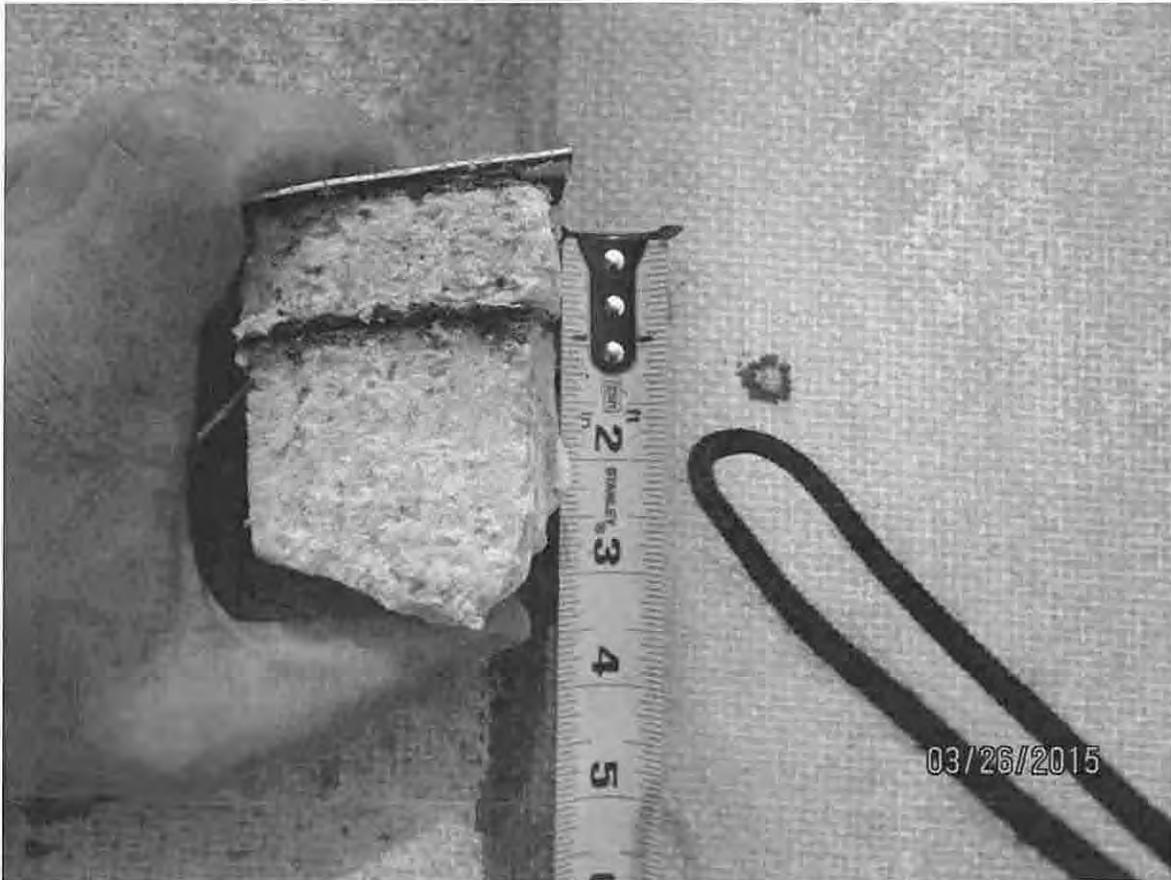


Photograph #	3	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Opening No. 4, multiple layers of isocyanurate insulation, typical.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	4	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Opening No. 6, concrete deck visible. Fastener and insulation plate securing isocyanurate insulation is rusted and rust has stained the bottom of the membrane.		
Address:	185 Central Avenue, Atlanta, Georgia		

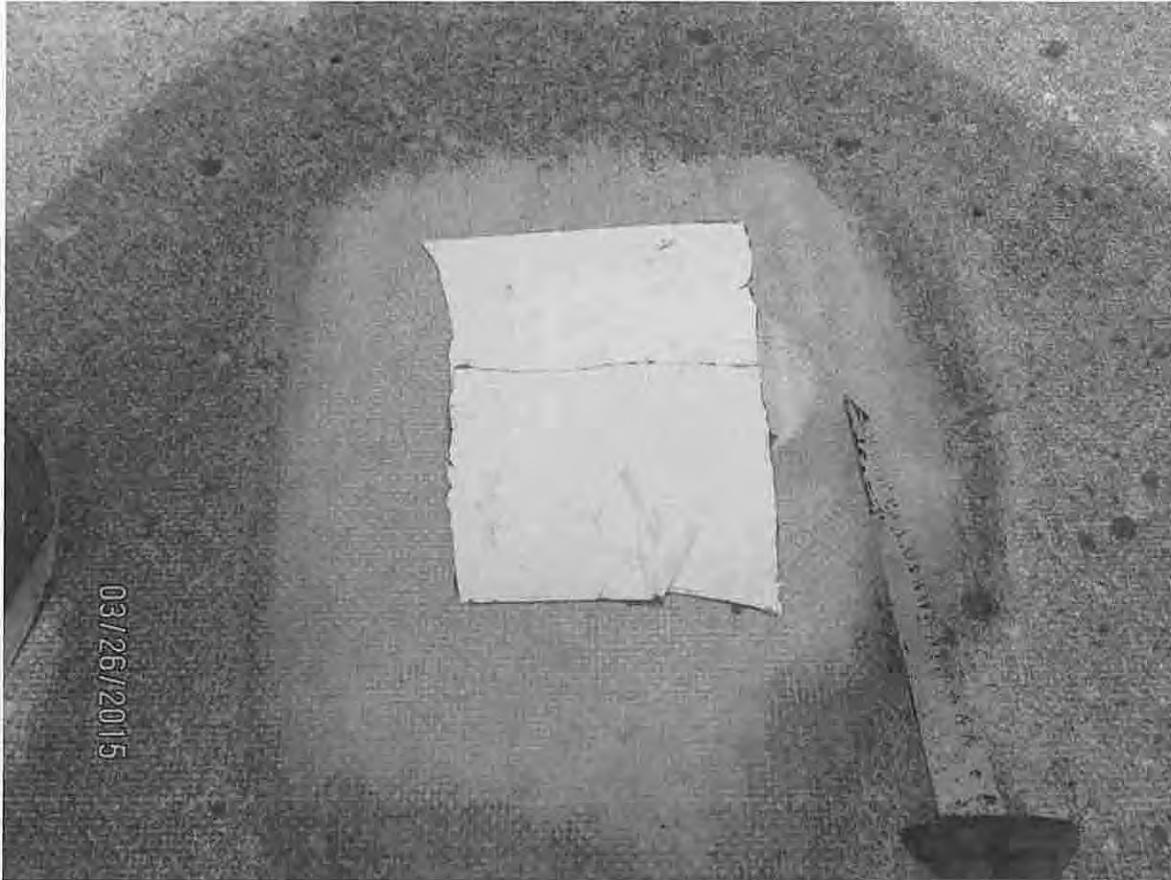

Photograph #	5	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Typical repair patch.		
Address:	185 Central Avenue, Atlanta, Georgia		

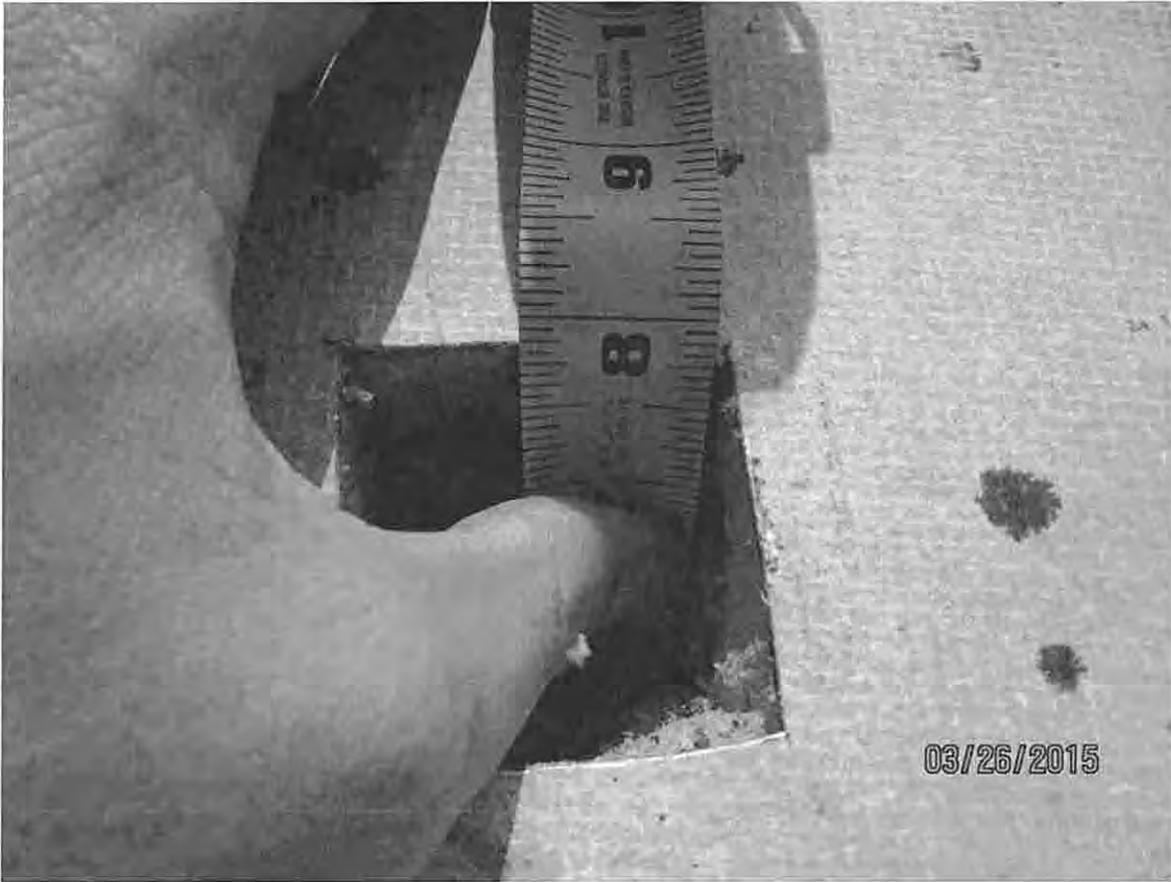

Photograph #	6	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Typical depth at interior ridge on main upper roof. Opening Nos. 3 and 7.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	7	REI Project No.	1001.061
Date Taken:	March 26, 2015		
Description of Photograph:	Opening No. 8 Delmhorst reading.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	8	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Typical stained ceiling tiles in the hall.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	9	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Leak diverter in hall.		
Address:	185 Central Avenue, Atlanta, Georgia		




Photograph #	10	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Roofing is in poor condition. Walkway pads are deteriorated. Lightning protection bases are loose.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	11	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Fasteners reflected through membrane.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	12	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Surfacing has thinned and scrim imprint is more visible.		
Address:	185 Central Avenue, Atlanta, Georgia		

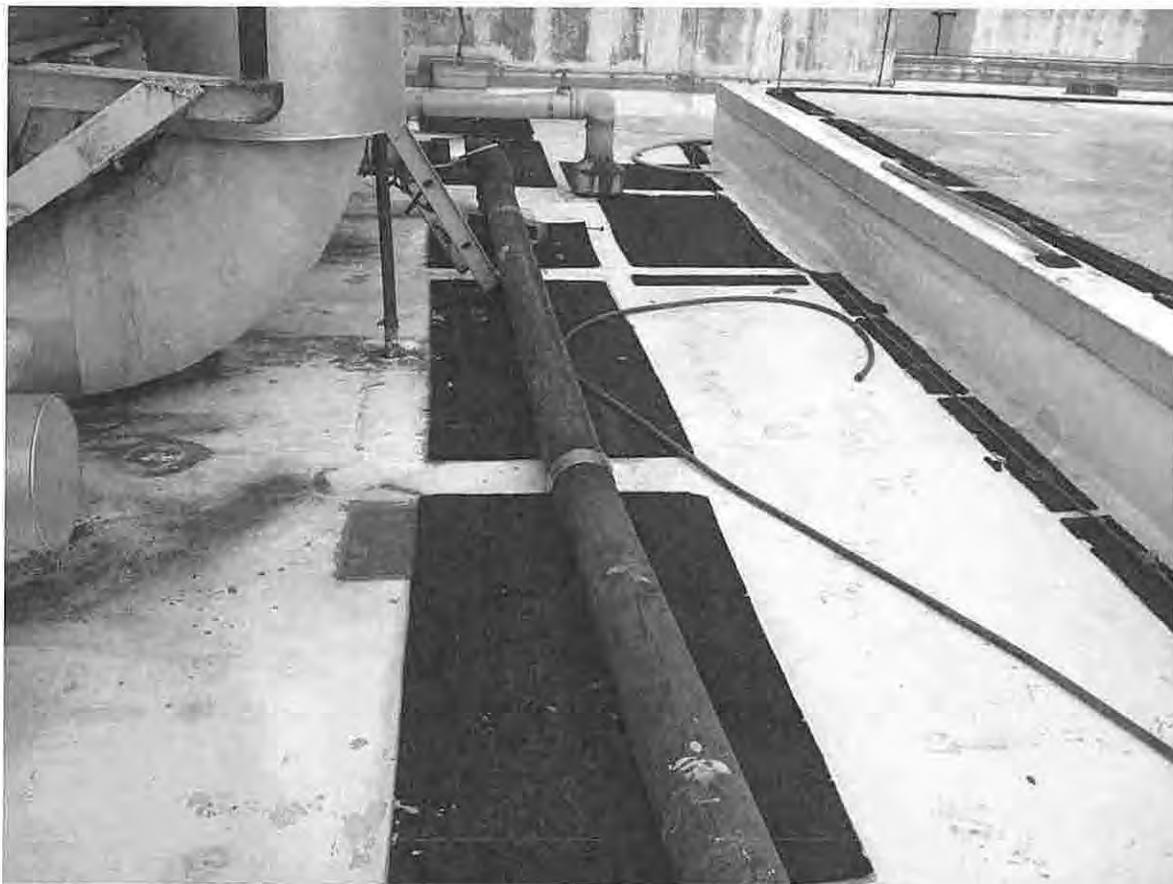

Photograph #	13	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Rusted rooftop equipment and condensation line.		
Address:	185 Central Avenue, Atlanta, Georgia		



Photograph #	14	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Vegetation growing at roof paver walkway.		
Address:	185 Central Avenue, Atlanta, Georgia		



**RAYMOND**  
ENGINEERING



Photograph #	15	REI Project No.	1001.061
Date Taken:	April 10, 2015		
Description of Photograph:	Repairs at expansion joint cover splices.		
Address:	185 Central Avenue, Atlanta, Georgia		

Roofing/Waterproofing Evaluation, Design, Construction Administration, & Litigation Support Services  
1224 Royal Drive, Suite 100, Conyers, Georgia 30094  
[www.RaymondEngineeringLLC.com](http://www.RaymondEngineeringLLC.com)

REVISIONS

NUMBER	DATE	BY
PROJECT NO.	1001060	

ORIGIN BY	POP
REVIEWED BY	ASH

DATE
04/01/2015

**LEGEND**

- EXISTING ROOF
- ▬ PARAPET
- - - EXPANSION JOINT
- ROOF TOP DRAIN
- C1 CORE LOCATION AND NUMBER

